

3  
CB

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI**  
**HEAD QUARTERS: DELHI FIRE SERVICE: NEW DELHI - 110001**

No F6/DFS/MS/2023/WZ/EH/ 30

Dated: 24/01/2023

**FIRE SAFETY CERTIFICATE**

Certified that the M/s RSK Hospitality, The Sial Kitchen, DDA Market, R-1, CSC-5, Sector-14, Rohini, Delhi-110085, is running at first floor in building comprised of **Ground + 01 upper floor** was inspected by the officer concerned of this department on **25.11.2022** in the presence of **Sh. Ghanshyam** and found that the said premises have complied with the fire prevention and fire safety requirements in accordance with Rule 33 of the Delhi Fire Service Rules, 2010 and that the premise is fit for occupancy **Group D "Assembly" (Eating House)** for **First floor in DDA Market, R-1, CSC-5**, with effect from 24/01/2023 for a period of **03 (Three) years** in accordance with Rule 36 unless renewed under Rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under Rule 38 of the Delhi Fire Service Rules, 2010.

Issued on .....24/01/2023... at New Delhi by

  
(Atul Garg)  
**DIRECTOR**  
Ph; 011-23414000

**Conditions for the validity of Fire Safety Certificate:**

1. All the fire safety arrangement provided there-in shall be maintained in good working conditions at all times.
2. Loss of life or property due to non functional fire safety measure shall be at the responsibility of the management/occupier.
3. The trained fire fighting staff should be available round the clock.
4. Any deviation with regard to the construction etc shall be verified by the concerned building sanctioning agency.
5. This certificate cannot be treated in any case for regularizations of unauthorized construction.
6. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director of Form 'J' [sub rule (1) of rule 37] along with a copy of this Certificate, six months prior to its expiry".
7. The owner / occupier shall submit a declaration every year in form "K" provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on
8. All the means of escape shall be kept free of any obstruction all the time to evacuate the occupant, in a safe manner, in the event of emergency.

[http://www.delhi.gov.in/wps/wcm/connect/doiit\\_fire/FIRE/Home/Fire+Safety+Acts+and+Rules/](http://www.delhi.gov.in/wps/wcm/connect/doiit_fire/FIRE/Home/Fire+Safety+Acts+and+Rules/)  
[http://www.delhi.gov.in/wps/wcm/connect/doiit\\_fire/FIRE/Home/Forms](http://www.delhi.gov.in/wps/wcm/connect/doiit_fire/FIRE/Home/Forms)

## INSPECTION REPORT

1. Name & address of the building : M/s RSK Hospitality, The Sial Kitchen, DDA Market, R-1, CSC-5, Sector-14, Rohini, Delhi-110085.
2. Type of Occupancy : Group-D "Assembly" **Restaurant is running in 1<sup>st</sup> floor**
3. Type of Case : New Case
4. Details of Previous NOC : NA
5. Fire Safety directives letter No : 2005 Circular
6. Date of inspection : 25.11.2022
7. Name of Inspecting Officer : A.K.Sharma ADO(Rohini)
8. Name and designation of officers  
From the building side : Sh. Ghanshyam
9. Year of Construction : 2000
10. Applicant's letter No. : Online application No. 2022092117951 dated 04.10.2022.

S. No.	Minimum Standards on fire prevention and fire safety U/R 33	2005 Circular Requirement	Provided at site	Remarks MR/NMR
1.	<b>Access to building</b>			
	<ul style="list-style-type: none"> <li>Road width</li> <li>Gate width</li> <li>Width of internal road</li> </ul>	6m -NA- -NA-	Provided -NA- -NA-	MR -NA- -NA-
2.	<b>Number, Width, Type &amp; Arrangement of Exits</b>			
	d. Number of staircases			
	<ul style="list-style-type: none"> <li>Upper Floors</li> <li>Basements</li> </ul>	02 -NA-	02 -NA-	MR -NA-
	e. Width of staircases			
	<ul style="list-style-type: none"> <li>Upper Floor</li> <li>Basements</li> </ul>	Required -NA-	1.5m -NA-	MR -NA-
	f. Protection of exits			
	<ul style="list-style-type: none"> <li>Fire check door</li> <li>Pressurization</li> </ul>	Required -NA-	Provided -NA-	MR -NA-
	d. No. of continuous staircases to terrace	Required	Provided	MR
	e. Width of Corridor	-NA-	-NA-	-NA-
	f. Door Size	Required	2.0m & 1.1m	MR
3.	<b>Compartmentation</b>			
	<ul style="list-style-type: none"> <li>Fire check door</li> <li>Sealing of electrical shafts</li> <li>Fire Rating of shaft door</li> <li>Water Curtain</li> <li>Fire Dampers</li> </ul>	-NA- -NA- -NA- -NA- -NA-	-NA- -NA- -NA- -NA- -NA-	-NA- -NA- -NA- -NA- -NA-
4.	<b>Smoke Management System</b>			
	<ul style="list-style-type: none"> <li>Basements</li> <li>Upper floors</li> </ul>	-NA- 12 ACPH	-NA- Natural ventilated	-NA- MR
5.	<b>Fire Extinguishers</b>			
	<ul style="list-style-type: none"> <li>Total numbers</li> <li>Types</li> <li>IS marking</li> </ul>	04nos. ABC/CO <sub>2</sub> ISI	06nos. AB-4C/CO-02 Provided	MR MR MR
6.	<b>First-Aid Hose Reels</b>			
	<ul style="list-style-type: none"> <li>Total numbers on each floor</li> <li>Length of hose reel hose</li> <li>Nozzle diameter</li> </ul>	01 30m 5mm	Provided Provided Provided	MR MR MR
7.	<b>Automatic fire detection and alarming system</b>			
	<ul style="list-style-type: none"> <li>Type of detectors</li> </ul>	Co2	Provided	MR

4/5

Is. Fire Co


	<ul style="list-style-type: none"> <li>Location of Main Panel</li> <li>Location of Repeater Panel</li> <li>Alternate source of power</li> <li>Hooters' Location</li> </ul>	-NA-	-NA-	-NA-
8.	<b>MOEFA</b>	-NA-	-NA-	-NA-
9.	<b>Public Address System</b>	Required	Provided	MR
10.	<b>Automatic Sprinkler System</b>	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> <li>Basement</li> <li>Ground &amp; Upper Floors</li> <li>Sprinkler above false ceiling</li> </ul>	-NA-	-NA-	-NA-
		-NA-	Provided	-NA-
11.	<b>Internal Hydrants</b>	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> <li>Size of riser/down-comer</li> <li>Number of hydrants per floor</li> <li>Hose Box</li> </ul>	Required	Provided	MR
		Required	Provided	MR
12.	<b>Yard Hydrants</b>	Required	Provided	MR
	<ul style="list-style-type: none"> <li>Total number of hydrants</li> <li>Hose Box</li> </ul>	-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
13.	<b>Pumping Arrangements</b>			
	<ul style="list-style-type: none"> <li>Ground Level <ul style="list-style-type: none"> <li>Discharge of main Pump</li> <li>Head of Main pump</li> <li>Number of main pumps</li> <li>Jockey Pump out put</li> <li>Jockey pump head</li> <li>Standby Pump out put</li> <li>Standby Pump Head</li> <li>Auto Starting/Manual Stopping</li> <li>Pump House Access</li> </ul> </li> <li>Terrace level <ul style="list-style-type: none"> <li>Discharge of pump</li> <li>Head of the pump</li> <li>Power Supply</li> <li>Auto Starting of pump</li> </ul> </li> </ul>	-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		450 LPM	450lpm	MR
		40m (each)	40m	MR
		Required	Provided	MR
		Required	Provided	MR
14.	<b>Captive Water Storage for fire fighting</b>			
	<ul style="list-style-type: none"> <li>Underground tank capacity <ul style="list-style-type: none"> <li>Draw-off connection</li> <li>Fire service inlet</li> <li>Access to tank</li> </ul> </li> <li>Overhead Tank capacity</li> </ul>	-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		5000ltr	10,000ltr	MR
15.	<b>Exit Signage.</b>	Required	Provided	MR
16.	<b>Provision of Lifts.</b>			
	<ul style="list-style-type: none"> <li>Pressurization of Lift Shaft</li> <li>Pressurization of Lift lobby</li> <li>Communication In lift Car</li> <li>Fireman's Grounding Switch</li> <li>Lift Signage</li> </ul>	-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
17.	<b>Standby power supply</b>	Required	Provided	MR
18.	<b>Refuge Area.</b>			
	<ul style="list-style-type: none"> <li>Total Area</li> <li>Location</li> </ul>	-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-

Fi  
uton


<b>19. Fire Control Room</b>			
<ul style="list-style-type: none"> <li>• Detector System Panel</li> <li>• Flow Switch Panel</li> <li>• PA System Panel</li> <li>• Batter backup</li> <li>• Building Floor Plans</li> </ul>	-NA-	-NA-	-NA-
	-NA-	-NA-	-NA-
	-NA-	-NA-	-NA-
	-NA-	-NA-	-NA-
	-NA-	-NA-	-NA-
<b>20. Special Fire Protection System for Protection of special Risks, if any:</b>			
	-NA-	-NA-	-NA-


The fire protection systems provided in the building were test checked and found functional at the time of inspection.


Keeping in view the substantial compliance of the minimum standards on fire prevention and fire safety required under the rules, and compliance of Shortcomings issued vide letter no. 490 dated 26.07.2022 along with submission of documentary evidence at C-12/13 for exiting restaurant since 2001 only, it is recommended to grant Fire Safety Certificate under rule 35 of the Delhi Fire Service Rule 2010.

  
 Signature of the Inspecting Officer  
 Name Ajay Kumar Sharma  
 Designation ADO (Rohini)

DO (NW)

  
 27/11/2022  
 Dy CFO (WZ)




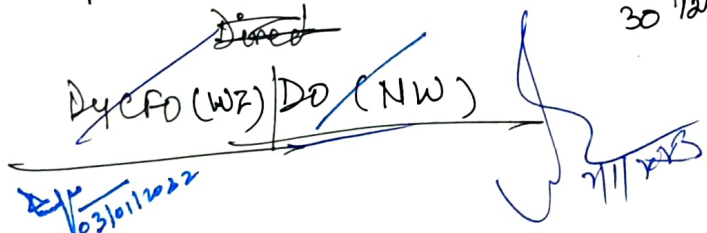
CFO  
  
 29/11/2022  
 Director

is it restaurant or a kitchen?

  
 29/11/22

CFO/HR Clarify as desired above.

  
 30/11/2022

  
 Dy CFO (WZ) / DO (NW)  
 03/10/2022  
 ADO (R)