



GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE: CONNAUGHT PLACE
NEW DELHI-110 001.

Dated: 13/04/2023

No.F.6/DFS/MS/School/2023/SZ/ 255

FIRE SAFETY CERTIFICATE

Certified that the **Vijay Model School**, D-736, Shiva Enclave, Vikas Nagar, Uttam Nagar, New Delhi-110059 comprised of ground floor only, owned/occupied by Vijay Model School was issued Fire Safety Certificate by this department vide letter No F.6/DFS/MS/School/2019/SZ/1224 dated 07/06/2019. The school building was re- inspected by the officer concerned of this department on 17/03/2023 in the presence of Smt. Neelam (Principal) and found that the School building have deemed complied with the fire prevention and fire safety requirements in accordance with the Circular No. F.16/Estate/CC/Fire Safety/2011/3298 to 3398 dated 01.03.2011 issued by the Director of Education and that the building/ premises is fit for occupancy class "Educational" w.e.f. the date of issue of this certificate for a period of three years, subject to compliance of the conditions printed as under.

Issued on.....13/04/2023..... at

(ATUL GARG)
DIRECTOR
DELHI FIRE SERVICE

Copy to:-

1. The Principal,
Vijay Model School, D-736, Shiva Enclave,
Vikas Nagar, Uttam Nagar New Delhi-110059
2. Director of Education,
Govt. of NCT of Delhi, Old Secretariat,
New Delhi - 110054.

Following fire safety directives must be adhered to:-

1. All the means of escape shall be kept free of all type of obstruction all the time.
2. All the employees shall be acquainted with the use and maintenance of all fire equipments and method of smooth and speedy safe evacuation of occupants in case of emergency.
3. All the fire fighting equipments shall be maintained in perfect working condition all the time and any lapse rendering non-functional of fire safety measures, management shall be responsible.
4. Any deviation, with regards to construction, ventilation, occupancy, electric installation etc. may be got verified from the concerned authorities.
5. This Fire Safety Certificate may not be treated in any case for regularizations of unauthorized construction unauthorized use of land if any.
6. The owner / occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rule 2010. The form is available on www.dfs.delhigovt.nic.in

N/23

INSPECTION REPORT

1. Name & address of the building : Vijay Model School, D-736, Shiva Enclave, Vikas Nagar, Uttam Nagar
New Delhi-110059
2. Building comprised of : Ground floor only.
3. Type of Occupancy : Educational
4. Type of Case : Renewal
5. Details of Previous NOC : F.6/DFS/MS/School/2019/SZ/1224 dated 07/06/2019
6. Fire Safety directives letter No : Circular No. F.16/Estate/CC/Fire Safety/2011/3298 to 3398 dated 01.03.2011
7. Date of inspection : 17/03/2023
8. Name of Inspecting Officer : A.D.O. R.K. Yadav
9. Name and designation of officers
From the building side : Smt. Neelam (Principal)
10. Year of Construction : 2006
11. Applicant's letter No. : Outdoor dairy no. 12031 dated 07/03/2023

S. No.	Minimum Standards on fire prevention and fire safety U/R 33	Dir. of Edu. Circular dt. 01.03.2011	Provided at site	Remarks MR/NMR
1.	Access to building			
	<ul style="list-style-type: none"> Road width Gate width Width of internal road 	Accessible 06 m 4.5 m N/A	05 m 3.3 & 03 m N/A	MR, being old case MR, being old case N/A
2.	Number, Width, Type & Arrangement of Exits			
	a. Number of staircases			
	<ul style="list-style-type: none"> Upper Floors Basements 	N/A N/A	N/A N/A	GF only N/A
	b. Width of staircases			
	<ul style="list-style-type: none"> Upper Floor Basements 	N/A N/A	N/A N/A	GF only N/A
	c. Protection of exits			
	<ul style="list-style-type: none"> Fire check door Pressurization 	N/A N/A	N/A N/A	N/A N/A
	d. No. of continuous staircases to terrace	N/A N/A	N/A N/A	N/A N/A
	e. Width of Corridor	1.0 m	.97/1.0 m	MR, being old case
	f. Class room Door Size			
3.	Compartmentation			
	<ul style="list-style-type: none"> Fire check door Sealing of electrical shafts Fire Rating of shaft door Water Curtain Fire Dampers 	N/A N/A N/A N/A N/A	N/A N/A N/A N/A N/A	N/A N/A N/A N/A N/A
4.	Smoke Management System			
	<ul style="list-style-type: none"> Basements Upper floors 	N/A N/A	N/A N/A	N/A N/A
5.	Fire Extinguishers			
	<ul style="list-style-type: none"> Total numbers Types IS marking 	03 No's ABC/CO ₂ type ISI marked	Provided Provided Provided	MR MR MR
6.	First-Aid Hose Reels			
	<ul style="list-style-type: none"> Total numbers on each floor Length of hose reel hose Nozzle diameter 	N/A N/A N/A	N/A N/A N/A	N/A N/A N/A

N/24

7.	Automatic fire detection and alarming system			
	• Type of detectors	N/A	N/A	N/A
	• Location of Main Panel	N/A	N/A	N/A
	• Location of Repeater Panel	N/A	N/A	N/A
	• Alternate source of power	N/A	N/A	N/A
	• Hooters' Location	N/A	N/A	N/A
8.	MOEFA	N/A	N/A	N/A
9.	Public Address System	N/A	N/A	N/A
10.	Automatic Sprinkler System			
	• Basement	N/A	N/A	N/A
	• Ground Floor	N/A	N/A	N/A
	• Sprinkler above false ceiling	N/A	N/A	N/A
11.	Internal Hydrants			
	• Size of riser/down-comer	N/A	N/A	N/A
	• Number of hydrants per floor	N/A	N/A	N/A
	• Hose Box	N/A	N/A	N/A
12.	Yard Hydrants			
	• Total number of hydrants	N/A	N/A	N/A
	• Hose Box	N/A	N/A	N/A
13.	Pumping Arrangements			
	• Ground Level			
	➤ Discharge of main Pump	N/A	N/A	N/A
	➤ Head of Main pump	N/A	N/A	N/A
	➤ Number of main pumps	N/A	N/A	N/A
	➤ Jockey Pump out put	N/A	N/A	N/A
	➤ Jockey pump head	N/A	N/A	N/A
	➤ Standby Pump out put	N/A	N/A	N/A
	➤ Standby Pump Head	N/A	N/A	N/A
	➤ Auto Starting/Manual Stopping	N/A	N/A	N/A
	➤ Pump House Access	N/A	N/A	N/A
	• Terrace level			
	➤ Discharge of pump	N/A	N/A	N/A
	➤ Head of the pump	N/A	N/A	N/A
	➤ Power Supply	N/A	N/A	N/A
	➤ Auto Starting of pump	N/A	N/A	N/A
14.	Captive Water Storage for fire fighting			
	• Underground tank capacity	N/A	N/A	N/A
	➤ Draw-off connection	N/A	N/A	N/A
	➤ Fire service inlet	N/A	N/A	N/A
	➤ Access to tank	N/A	N/A	N/A
	• Overhead Tank capacity	N/A	N/A	N/A
15.	Exit Signage.	N/A	N/A	N/A
16.	Provision of Lifts.			
		(No Lift)		
	• Pressurization of Lift Shaft	N/A	N/A	N/A
	• Pressurization of Lift lobby	N/A	N/A	N/A
	• Communication In lift Car	N/A	N/A	N/A
	• Fireman's Grounding Switch	N/A	N/A	N/A
	• Lift Signage	N/A	N/A	N/A
17.	Standby power supply	N/A	N/A	N/A
18.	Refuge Area.			
	➤ Total Area	N/A	N/A	N/A
	➤ Location	N/A	N/A	N/A

Fire Control Room			
<ul style="list-style-type: none">• Detector System Panel• Flow Switch Panel• PA System Panel• Battery backup• Building Floor Plans	N/A	N/A	N/A
	N/A	N/A	N/A
	N/A	N/A	N/A
	N/A	N/A	N/A
	N/A	N/A	N/A
Special Fire Protection System for Protection of special Risks, if any:	N/A	N/A	N/A


The fire protection systems provided in the building were tested, checked and found not functional at the time of inspection. The shortcoming issued vide letter No. F6/DFS/MS/SCHOOL/2022/SZ/534 dated 05/09/2023 has been complied.


In view of the deemed compliance of the minimum standards of fire prevention and fire safety measures as required under the rules the FSC issued vide letter number F.6/DFS/MS/School/2019/SZ/1224 dated 07/06/2019 renewal in accordance with the Circular No. F.16/Estate/CC/Fire Safety/2011/3298 to 3398 dated 01.03.2011 issued by the Director of Education is recommended.


Signature of Inspecting Officer
Name:- R.K. Yadav
Designation:- Asstt. Divisional Officer

Divisional Officer (South West)

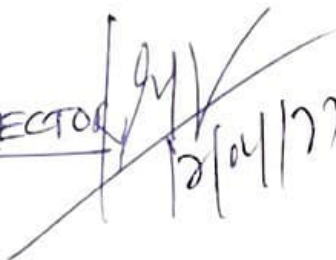
21/3/23


CFO (\$2)

21/3/2023

Director

22/03/23

Any/KP

RT letter is put up for sign please

DIRECTOR

22/04/23
n


24/3/2023