

C 45



GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE: NEW DELHI- 110001



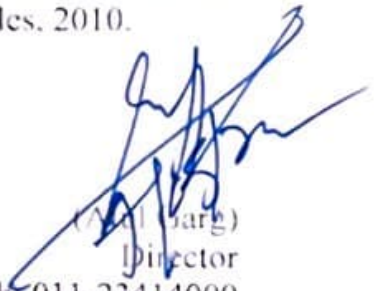
No. F6/DFS/MS/BNQT/2023/ 20

Dated: 04/05/2023

FIRE SAFETY CERTIFICATE

Certified that the M/s Sunrize Marriage And Party Hall located at A-1, Dheerpur Opposite Radha Swami Satsang Near Nirankari Colony, Delhi-110009 comprised of Ground floor & First floor only owned/ occupied by M/s Sunrize Marriage And Party Hall have complied with the fire prevention and fire safety requirements in accordance with rule 33 of the Delhi Fire Service Rules, 2010 and verified by the officer concerned of Fire Service on 01.05.2023 in the presence of Sh. Niranjan Gupta and that the building/ premise is fit for occupancy Class "Group D-3 Assembly (Banquet Hall)" with effect from 04/05/2023 for a period of 03 (Three) years in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010.

Issued on 04/05/2023 at New Delhi by


(A. J. Singh)
Director
Ph: 011-23414000
de p

Copy to:

1. The Dy. Commissioner, (Civil Line Zone) Municipal Corporation of Delhi, 16, Rajpura Road, New Delhi-110054.
2. The Manager, M/s Sunrize Marriage And Party Hall located at A-1, Dheerpur Opposite Radha Swami Satsang Near Nirankari Colony, Delhi-110009.

Conditions for the validity of Fire Safety Certificate:

1. All the fire safety arrangement provided there-in shall be maintained in good working conditions at all times.
2. Loss of life or property due to non functional fire safety measure shall be at the responsibility of the management.
3. The trained fire fighting staff should be available round the clock.
4. Any deviation with regard to the construction etc shall be verified by the concerned building sanctioning agency.
5. This certificate cannot be treated in any case for regularizations of unauthorized construction.
6. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director of Form 'J' [sub rule (1) of rule 37] along with a copy of this Certificate, six months prior to its expiry".
7. The owner / occupier shall submit a declaration every year in form "K" provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on WWW.dfs.Delhigovt.nic.in
8. All the means of escape shall be kept free of any obstruction all the time to evacuate the occupant, in a safe manner, in the event of emergency.

INSPECTION REPORT

1. Name & address of the building : Sunrize Marriage And Party Hall at A-1, Dheerpur Opposite Radha Swami Satsang Near Nirankari Colony, Delhi-110009.
2. Composition of building : Ground floor & first floor only ✓
3. Type of Occupancy : Assembly (Banquet Hall)
4. Type of Case : New Case
5. Details of previous NOC : Nil
6. Fire Safety directives letter No : F.6/DFS/MS/BP/2023/BNQT/81 Dated: 24.04.2023 ✓
7. Date of inspection : 01.05.2023
8. Name of the Inspecting Officers : ADO (RN)
9. Name and designation of officers from the building side : Sh. Niranjana Gupta
10. Year of Construction : 2013
11. Applicant's letter No. : Online Portal ID No. 2023042107038 dated: 24.04.2023

	Minimum Standards on fire prevention and fire safety U/R 33	As Per Directive of dated 24.04.2023	Provided at site	Remarks MR/NMR
1	Access to building			
	• Road width	06m	18m approx	MR
	• Gate width	Directly Accessible	Directly Accessible	MR
	• Width of internal road	NA	NA	NA
2	Number, Width, Type & Arrangement of Exits			
	a. Number of staircases			
	• Upper Floors	02	02	MR
	• Basements	NA	NA	NA
	b. Width of staircases			
	• Upper Floors	02m & 1.50m	02m iron & 1.50m	MR ✓
	• Basements	NA	NA	NA
	c. Protection of exits			
	• Fire check door	Required	Provided	MR
	• Pressurization	NA	NA	NA
	d. No. of continuous staircases to terrace	02	02	MR
	e. Width of Corridor	NA	NA	NA
	f. Door Size	02m & 1.50m	Provided	MR
3	Compartmentation.			
	• Fire check door	Required	Provided	MR
	• Sealing of electrical shafts	Required	Provided	MR
	• Fire Rating of shaft door	Required	Provided	MR
	• Water Curtain	NA	NA	NA
	• Fire Dampers	NA	NA	NA
4	Smoke Management System.			
	• Basements	12 a/c per hour	NA	NA
	• Upper floors	12 a/c per hour	Exhaust Fan	MR
5	Fire Extinguishers			
	• Total numbers	12nos	12nos	MR
	• Types	ABC & Co2	ABC-12	MR
	• ISI marking	Yes	Yes	MR ✓

6	First-Aid Hose Reels.				
	• Total numbers on each floor	01	01	MR	
	• Length of hose reel hose	30m	30m	MR	
	• Nozzle diameter	5mm	5mm	MR	
7	Automatic fire detection and alarming system.				
	• Type of detectors	NA	NA	NA	
	• Location of Main Panel	NA	NA	NA	
	• Location of Repeater Panel	NA	NA	NA	
	• Alternate source of power	NA	NA	NA	
	• Hooters' Location	NA	NA	NA	
8	MOEFA	Required	Provided	MR	
9	Public Address System.	NA	NA	NA	
10	Automatic Sprinkler System.				
	• Basement	NA	NA	NA	
	• Upper Floor	NA	NA	NA	
	• Sprinkler above false ceiling	NA	NA	NA	
11	Internal Hydrants				
	• Size of riser/down-comer	63mm	Provided	MR	
	• Number of hydrants per floor	01	01	MR	
	• Hose Box	01	01	MR	
12	Yard Hydrants.				
	• Total number of hydrants	NA	NA	NA	
	• Hose Box	NA	NA	NA	
13	Pumping Arrangements.				
	• Ground Level	➤ Discharge of main Pump	N/A	N/A	N/A
		➤ Head of Main pump	N/A	N/A	N/A
		➤ Number of main pumps	N/A	N/A	N/A
		➤ Jockey Pump out put	N/A	N/A	N/A
		➤ Jockey pump head	N/A	N/A	N/A
		➤ Standby Pump out put	N/A	N/A	N/A
		➤ Standby Pump Head	N/A	N/A	N/A
		➤ Auto Starting/ Manual stopping	N/A	N/A	N/A
		➤ Pump House Access	N/A	N/A	N/A
		• Terrace level	➤ Discharge of pump	900 LPM	900 LPM
	➤ Head of the pump		40m	40m	MR
	➤ Power Supply		Required	Provided	MR
	➤ Auto Starting of pump		Required	Provided	MR
14	Captive Water Storage for fire fighting.				
	• Underground tank capacity	➤ Draw-off connection	NA	NA	NA
		➤ Fire service inlet	NA	NA	NA
		➤ Access to tank	NA	NA	NA
		• Overhead Tank capacity	NA	NA	NA
		25,000ltr	Provided		MR
	15	Exit Signage.			
Required		Provided		MR	

Provision of Lifts.				
16	• Pressurization of Lift Shaft	N/A	N/A	N/A
	• Pressurization of Lift lobby	N/A	N/A	N/A
	• Communication In lift Car	NA	NA	NA
	• Fireman's Grounding Switch	NA	NA	NA
	• Lift Signage	NA	NA	NA
17	Standby power supply	Required	Provided	MR
18	Refuge Area.			
	➤ Total Area	N/A	N/A	N/A
	➤ Location	N/A	N/A	N/A
19	Fire Control Room			
	• Detector System Panel	N/A	N/A	N/A
	• Flow Switch Panel	N/A	N/A	N/A
	• PA System Panel	N/A	N/A	N/A
	• Batter backup	N/A	N/A	N/A
	• Building Floor Plans	N/A	N/A	N/A
20	Special Fire Protection Systems for Protection of special Risks, if any:	NA	NA	NA

The fire protection systems provided in the building were tested/ checked and found in working order at the time of inspection.

Keeping in view of the substantial compliance of the minimum standards on fire prevention and fire safety required under the rules it is recommended to grant Fire Safety Certificate under rule 35 of the Delhi Fire Service Rules 2010.

DO/NW

[Signature]
02/05/2023
D.B. Munkhaya
DO (NW)

[Signature]
21/5/2023

[Signature]
9/05/2023

[Signature]

[Signature]
Signature of the Inspecting Officer
Name: - C.L. Meena
Designation:- ADO/RN

As approved, F.T. letter is put up for your signature pl. - *[Signature]*
04/05/2023
A-DO/RN