

C 18



**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI**  
**HEADQUARTERS: DELHI FIRE SERVICE: NEW DELHI- 110001**

75  
 आज़ादी का  
 अमृत महोत्सव

No. F6/DFS/MS/School/WZ/2023/ 323

Dated: 17/05/2023

**FIRE SAFETY CERTIFICATE**

Certified that the **D.A.V. Public School located at Tarun Enclave, Pitampura, Delhi- 110034**, comprised of Ground Floor only, was issued Fire Safety Certificate by this department vide letter No. F6/DFS/MS/WZ/2020/163 dated 23.04.2020. The school building was re-inspected by the officer concerned of this department on 08.05.2023 in the presence of Sh. N.K. Nagar (Admin In-charge) and found that the premises / building have deemed complied with the fire prevention and fire safety requirements in accordance with Directorate of Education Circular No. 3298-3398 dated 01.03.2011 and that the premises/building is fit for occupancy class "Educational Building" Group B with effect from 17/05/2023 for a period of three years subject to compliance of the conditions, printed overleaf.

Issued on 17/05/2023 at New Delhi by:

(ATUL GARG)  
 DIRECTOR

Copy to: -

1. The Directorate of Education, GNCT of Delhi, Old Secretariat Delhi- 110054.
2. The Principal, D.A.V. Public School, Tarun Enclave, Pitampura, Delhi- 110034.

**INSPECTION REPORT**

1. Name & address of the building: D.A.V. Public School, Tarun Enclave, Pitampura, Delhi- 110034.
2. Type of Occupancy : Educational
3. Type of Case : Renewal
4. Details of previous NOC : F6/DFS/MS/WZ/2020/163 dated 23.04.2020
5. Fire Safety directives letter No : DOE Circular No. 3298-3398 dated 01.03.2011
6. Date of inspection : 08.05.2023
7. Name of the Inspecting Officers : M.K. Chattopadhyay, DO (West)
8. Name and designation of officers from the building side : Sh. S.K. Nagar, Admin In-charge
9. Year of Construction : 2005
10. Applicant's letter No. : Form 'J' dated 17.04.2023

The school building is comprised of Ground Floor only. ←

S. No.	Minimum Standards on fire prevention and fire safety U/R 33	Requirement as per Rule 35 (6) of DFS Rules 2010	Provided at site	Remarks MR/NMR
1	<b>Access to building</b>			
	• Road width	6 mts	Provided	MR
	• Gate width	Accessible	2.45 mts Provided	MR
	• Width of internal road	N/A	N/A	N/A
2	<b>Number, Width, Type &amp; Arrangement of Exits</b>			
	a. Number of staircases	-----	-----	-----
	• Upper Floors	N/A	N/A	N/A
	• Basements	N/A	N/A	N/A
	b. Width of staircases	-----	-----	-----
	• Upper Floors	N/A	N/A	N/A
	• Basements	N/A	N/A	N/A
	c. Protection of exits	-----	-----	-----
	• Fire check door	N/A	N/A	N/A
	• Pressurization	N/A	N/A	N/A
	e. No. of continuous staircases to terrace	N/A	N/A	N/A
	g. Width of Corridor	N/A	N/A	N/A
	h. Door Size	1.0 mt.	Provided (1.10 mts)	MR
3	<b>Compartmentation.</b>			
	• Fire check door	N/A	N/A	N/A
	• Sealing of electrical shafts	N/A	N/A	N/A
	• Fire Rating of shaft door	N/A	N/A	N/A
	• Water Curtain	N/A	N/A	N/A
	• Fire Dampers	N/A	N/A	N/A
4	<b>Smoke Management System.</b>			
	• Basements	N/A	N/A	N/A
	• Upper floors	N/A	N/A	N/A
5	<b>Fire Extinguishers</b>			
	• Total numbers	12 nos.	Provided	MR
	• Types	ABC, CO <sub>2</sub> type	Provided	MR
	• IS marking	ISI marked	Provided	MR



6	<b>First-Aid Hose Reels.</b>			
	• Total numbers on each floor	N/A	N/A	N/A
	• Length of hose reel hose	N/A	N/A	N/A
	• Nozzle diameter	N/A	N/A	N/A
7	<b>Automatic fire detection and alarming system</b>			
	• Type of detectors	N/A	N/A	N/A
	• Location of Main Panel	N/A	N/A	N/A
	• Location of Repeater Panel	N/A	N/A	N/A
	• Alternate source of power	N/A	N/A	N/A
	• Hooters' Location	N/A	N/A	N/A
8	<b>MOEFA</b>	N/A	N/A	N/A
9	<b>Public Address System.</b>	N/A	Provided	N/A
10	<b>Automatic Sprinkler System</b>			
	• Basement	N/A	N/A	N/A
	• Upper Floor	N/A	N/A	N/A
	• Sprinkler above false ceiling	N/A	N/A	N/A
11	<b>Internal Hydrants</b>			
	• Size of riser/down-comer	N/A	N/A	N/A
	• Number of hydrants per floor	N/A	N/A	N/A
	• Hose Box	N/A	N/A	N/A
12	<b>Yard Hydrants.</b>			
	• Total number of hydrants	N/A	N/A	N/A
	• Hose Box	N/A	N/A	N/A
13	<b>Pumping Arrangements</b>			
	• Ground Level	---	----	-----
	➤ Discharge of main Pump	N/A	N/A	N/A
	➤ Head of Main pump	N/A	N/A	N/A
	➤ Number of main pumps	N/A	N/A	N/A
	➤ Jockey Pump out put	N/A	N/A	N/A
	➤ Jockey pump head	N/A	N/A	N/A
	➤ Standby Pump out put	N/A	N/A	N/A
	➤ Standby Pump Head	N/A	N/A	N/A
	➤ Auto Starting/ Manual stopping	N/A	N/A	N/A
	➤ Pump House Access	N/A	N/A	N/A
	• Terrace level	----	-----	-----
	➤ Discharge of pump	N/A	N/A	N/A
	➤ Head of the pump	N/A	N/A	N/A
	➤ Power Supply	N/A	N/A	N/A
	➤ Auto Starting of pump	N/A	N/A	N/A
14	<b>Captive Water Storage for fire fighting</b>			
	• Underground tank capacity	N/A	N/A	N/A
	➤ Draw-off connection	N/A	N/A	N/A
	➤ Fire service inlet	N/A	N/A	N/A
	➤ Access to tank	N/A	N/A	N/A
	• Overhead Tank capacity	N/A	N/A	N/A
15	<b>Exit Signage.</b>	N/A	N/A	N/A
16	<b>Provision of Lifts.</b>			
	• Pressurization of Lift Shaft	N/A	N/A	N/A
	• Pressurization of Lift lobby	N/A	N/A	N/A
	• Communication In lift Car	N/A	N/A	N/A
	• Fireman's Grounding Switch	N/A	N/A	N/A
	• Lift Signage	N/A	N/A	N/A






standby power supply		N/A	N/A	N/A
<b>Refuge Area.</b>				
Total Area		N/A	N/A	N/A
Location		N/A	N/A	N/A
19	<b>Fire Control Room</b>			
• Detector System Panel		N/A	N/A	N/A
• Flow Switch Panel		N/A	N/A	N/A
• PA System Panel		N/A	N/A	N/A
• Batter backup		N/A	N/A	N/A
• Building Floor Plans		N/A	N/A	N/A
20	Special Fire Protection Systems for Protection of special Risks, if any:	Required 02 ABC type fire extinguishers near elect. panel	Provided	MR

The fire protection systems provided in the building were randomly test checked and found functional at the time of inspection.

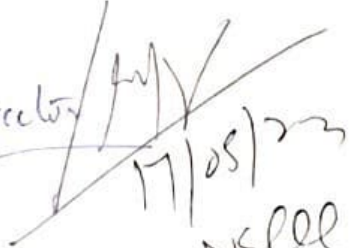
In view the deemed compliance of the minimum standards on fire prevention and fire safety measures as required under the rules, the renewal of the NOC issued vide letter No. F6/DFS/MS/WZ/2020/163 dated 23.04.2020, is recommended.

Accordingly DFA is put up for approval & signature please.

  
 Signature of the Inspecting Officer  
 M.K. Chattopadhyay  
 Divisional Officer (West Division)

C/o  
  
 12/5/2023  
 Director  
  
 15/5/23  
 Oxy/W

F.T. letter is put up for sign please.

Director  
  
 17/05/23  
 NSlee

  
 16/5/23