

C 22

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEAD QUARTERS, DELHI FIRE SERVICE, NEW DELHI - 110001

No.F6/DFS/MS/EH/NDZ/2023/ 199

Dated:- 19.06.2023

FIRE SAFETY CERTIFICATE

Certified that the M/s BIKANERVALA at ground floor of plot no. 10181-82, Chowk Gurudwara Road, Karol Bagh, New Delhi in a building comprised of Basement + Ground + 01 Upper floor (basement sealed and first floor other restaurant), was earlier granted FSC by this department vide letter No.F6/DFS/MS/EH/NDZ/2020/128 dated 03.09.2020. Now, the premises was re-inspected by the officer concerned of this department on 12/06/23 in the presence of Mr. Yogesh Gupta and found that the said restaurant at ground floor has deemed complied with the fire prevention and fire safety requirements in accordance with Rule 33 of the Delhi Fire Service Rules, 2010 and that the premises is fit for occupancy class **Assembly Building Group-D, Restaurant at Ground floor only** and valid up to **31.03.2026** from the date of issue in accordance with Rule 36 unless renewed under Rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under Rule 38 of the Delhi Fire Service Rules, 2010.

Issued on19.06.2023..... at New Delhi by.

(Atul Garg)
DIRECTOR
Delhi Fire Service

Copy to:-

1. The Commissioner, MCD, Civic Centre, New Delhi : to ensure the occupancy as detailed above and deviation if any .
2. The Addl. Commissioner of Police (Lic), First Floor, P.S. Defence Colony New Delhi online ID No. 2023060610324 dated 06.06.23.
3. The Manager, M/s Bikanervala, 10181-82, Chowk Gurudwara Road, Karol Bagh, New Delhi.

Conditions for the validity of Fire Safety Certificate

1. This FSC is valid only for ground floor restaurant.
2. All the fire safety arrangements provided therein shall be maintained in good working conditions at all times.
3. Any loss of life or property due to non functional fire safety measures shall be at the responsibility of the management.
4. The trained fire fighting staff should be available round the clock.
5. The compliance with regards to electrical installation, structural stability, set back area, occupancy and any deviation in construction etc. shall be verified from authority concerned. Basement shall not be used for any purpose.
6. This fire safety certificate may not be treated in any case for regularization of unauthorized construction, if any.
7. The owner / occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on www.dfs.delhigovt.nic.in
8. The means of escape shall be kept unobstructed / unlocked for unhindered evacuation in case of an emergency.
9. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in form 'J' [sub rule (I) of rule 37] along with a copy of this Certificate, six month prior to its expiry".
10. Any flammable material for interior decoration is prohibited.

INSPECTION REPORT

- Name & address of the building:- M/s BIKANERVALA at 10181-82, Chowk Gurudwara Road, Karol Bagh, New Delhi
B+ Gr. + 01 upper floor, basement not in use & 1st floor other restaurants
- Type of occupancy:- Assembly Building
Restaurant at ground floor only
- Type of case:- Renewal
- Details of previous NOC:- No.F6/DFS/MS/EH/NDZ/2020/128 dated 03.09.2020
- Fire safety directives No.- N/A
- Date of inspection:- 12/06/2023
- Name of the inspecting officer:- Sh. Rajinder Atwal (DO/CD) & Sh. Ravinder Singh (ADO/CC)
- Name & designation of officer
From the building side:- Mr. Yogesh Gupta
- Year of construction:- N/A
- Applicant's letter No:- Online ID no. 2023060610324 dated 06.06.23.

S.No.	Minimum Standards on fire Prevention and fire safety U/R 33	Required	Provided at site	Remarks MR/NMR
1.	Access to Building			
	1) Road width	09 mtr.	09 mtr. ✓	MR
	2) Gate width	N/A	N/A	N/A
	3) Width of internal road	N/A	N/A	N/A
2.	Number, Width Type & Arrangement of Exits			
	A. Number of staircases			
	1. Upper floors	N/A	02 Nos. ✓	N/A
	2. Basements	N/A	N/A	N/A
	B. Width of staircase			
	1. Upper floors	N/A	2 Nos. 1.5 mtr. ✓ 1 Nos. 1.0 mtr.	N/A
	2. Basements	N/A	N/A	N/A
	C. Protection of exits			
	1. Fire check door	N/A	N/A	N/A
	2. Pressurization	N/A	N/A	N/A
	D. No. of continuous staircase to terrace	N/A	N/A	N/A
	E. Width of corridor	N/A	N/A	N/A
	F. Door size	02 nos. - 2 mtr.	03 nos. - 2.0 mtr. 03 nos. - 1.0 mtrs ✓	MR
3.	Compartmentation			
	1) Fire check door	N/A	N/A	N/A
	2) Sealing of electrical shafts	N/A	N/A	N/A
	3) Fire rating of shaft door	N/A	N/A	N/A
	4) Water curtain	N/A	N/A	N/A
	5) Fire Dampers	N/A	N/A	N/A
4.	Smoke Management System			
	1) Basements	N/A	N/A	N/A
	2) Upper floors	12a/c per	Natural	MR
5.	Fire Extinguishers			
	1) Total numbers	04	08 ✓	MR
	2) Types	ABC & CO2	ABC & CO2	MR
	3) ISI marking	ISI	Provided	MR
6.	First-Aid Hose Reel			
	1) Total number each floor	01	01	MR

W 6 50

M7

	2) Length of hose reel hose	30 m	30 m	MR
	3) Nozzle diameter	5 mm	5 mm	MR
7.	Automatic Fire Detection & Alarming System			
	1) Type of detectors	N/A	Provided	N/A
	2) Location of main panel	N/A	N/A	N/A
	3) Location of repeater panel	N/A	N/A	N/A
	4) Alternate source of power	N/A	N/A	N/A
	5) Hooter's Location	N/A	N/A	N/A
8.	MOEFA	Required	Provided	MR
9.	Public Address System	N/A	N/A	N/A
10.	Automatic Sprinkler System			
	1) Basement	N/A	N/A	N/A
	2) Upper floors, Gr. & 1 st floor	Required	Provided	MR
	3) Sprinkler above false ceiling	N/A	N/A	N/A
11.	Internal Hydrants			
	1) Size of riser/down-comer	100 mm	100 mm	MR
	2) Number of hydrants	01	01	MR
	3) Hose box	01	01	MR
12.	Yard Hydrants			
	1) Total number of hydrants	N/A	N/A	N/A
	2) Hose box	N/A	N/A	N/A
13.	Pumping Arrangement			
	1) Ground level			
	a) Discharge of main pump	N/A	N/A	N/A
	b) Head of main pump	N/A	N/A	N/A
	c) Number of main pump	N/A	N/A	N/A
	d) Jockey pump out put	N/A	N/A	N/A
	e) Jockey pump head	N/A	N/A	N/A
	f) Stand by pump output	N/A	N/A	N/A
	g) Stand by pump head	N/A	N/A	N/A
	h) Auto starting/Manual stopping	N/A	N/A	N/A
	2) Terrace level			
	a) Discharge of pump	900 LPM	900 LPM ✓	MR
	b) Head of pump	40 mtr.	40 mtr. ✓	MR
	c) Power supply	Required	Provided	MR
	d) Auto starting of pump	Required	Provided	MR
14.	Captive Water Storage for Fire Fighting			
	1) Under ground tank capacity	N/A	N/A	N/A
	a) Draw-off connection	N/A	N/A	N/A
	b) Fire service inlet	N/A	N/A	N/A
	c) Access to tank	N/A	N/A	N/A
	d) Over head tank capacity	25,000 ltrs.	25,000 Ltr. ✓	MR
15.	Exit Signage.	Required	Provided	MR

J 60 w/


N/B

16.	Provision of Lifts.			
	a) Pressurization of lift shaft	N/A	N/A	N/A
	b) Pressurization of lift lobby	N/A	N/A	N/A
	c) Communication in lift car	N/A	N/A	N/A
	d) Fireman's switch	N/A	N/A	N/A
	e) Lift signage	N/A	N/A	N/A
17.	Stand by Power Supply	Required	Provided ✓	MR
18.	Refuge Area	N/A	N/A	N/A
	Total area location	N/A	N/A	N/A
19.	Fire Control Room	N/A	N/A	N/A
	a) Detector system panel	N/A	N/A	N/A
	b) Flow switch panel	N/A	N/A	N/A
	c) PA system panel	N/A	N/A	N/A
	d) Battery backup	N/A	N/A	N/A
	e) Building floor plan	N/A	N/A	N/A
20.	Special Fire Protection System for Protection of special Risk, if any:			MR


The fire protection systems provided in the building were randomly tested, checked and found functional at the time of inspection. The restaurant at First floor having separate FSC.


In view of the deemed compliance of the minimum standards of fire prevention and fire safety measures as required under the rules, if approved, we may renew the FSC issued vide letter no. F6/DFS/MS/EH/NDZ/2020/128 dated 03.09.2020, under rule 35(6) of the Delhi Fire Service rules 2010. Accordingly, DFA is put up for kind perusal and signature please.

Signature of the Inspecting Officer

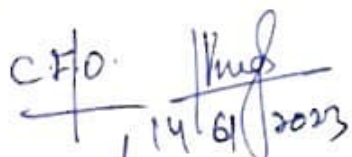

 Name :- Rajinder Atwal
 Designation :- DO (CD)

Signature of the Inspecting Officer



 Name :- Ravinder Singh
 Designation :- ADO (CC)


 12/6/23


 12/6/23


 14/6/2023


 Director


 ADO/CC

1. Spoken on 16/6/23
 2. Photo is placed on file. Resubmitted please.
 Director 16/6/23
 17/6/23
 20/6/23