

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI**  
**HEADQUARTERS: DELHI FIRE SERVICE: NEW DELHI-110001**

NO. F-6/DFS/MS/2023/School/WZ/college/18

Dated 30/06/2023

**FIRE SAFETY CERTIFICATE**

Certified that the M/s Jagan Nath Gupta Memorial Educational Society located at PSP Area-3, Sector-05, Rohini, Delhi-110085, comprised of 02 blocks-of Basement, Ground and 03 upper floors has already been issued FSC by this department vide letter No. F.6/DFS/MS/2020/WZ/275 dated 27.07.2020. The premises was re-inspected by the officer concerned of this department on 15.06.2023 in the presence of Sh. Akshay, Admn. Officer and found that the said building have deemed complied with the fire prevention and fire safety requirements in accordance with Rule 33 of the Delhi Fire Service Rules, 2010 and that the premises fit for occupancy class "Group B" Educational with effect from 30/06/2023 for a period of three years in accordance with Rule 36 unless renewed under Rule 37 or sooner cancelled under Rule 40 and subjected to compliance of the conditions under Rule 38 of the Delhi Fire Service Rules, 2010.

Issued on 30/06/2023 at New Delhi

  
(Atul Garg)  
**DIRECTOR**  
Ph; 011-23414000

**Copy to :-**

1. The Director, Education, Government of N.C.T of Delhi. Old Sect. Delhi - 54.
2. The Authorized Signatory, Jagan Nath Gupta Memorial Educational Society, PSP Area-3, Sector-05, Rohini, Delhi-110085.

**Conditions for the validity of Fire Safety Certificate:**

1. All the fire safety arrangement provided there-in shall be maintained in good working conditions at all times.
2. Loss of life or property due to non functional fire safety measure shall be at the responsibility of the management.
3. The trained fire fighting staff should be available round the clock.
4. Any deviation with regard to the construction etc shall be verified by the concerned building sanctioning agency.
5. This certificate cannot be treated in any case for regularizations of unauthorized construction.
6. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director of Form 'J' [sub rule (1) of rule 37] along with a copy of this Certificate, six months prior to its expiry".
7. The owner / occupier shall submit a declaration every year in form "K" provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on
8. All the means of escape shall be kept free of any obstruction all the time to evacuate the occupant, in a safe manner, in the event of emergency.

[http://www.delhi.gov.in/wps/wcm/connect/doit\\_fire/FIRE/Home/Fire+Safety+Acts+and+Rules/](http://www.delhi.gov.in/wps/wcm/connect/doit_fire/FIRE/Home/Fire+Safety+Acts+and+Rules/) [http://www.delhi.gov.in/wps/wcm/connect/doit\\_fire/FIRE/Home/Forms](http://www.delhi.gov.in/wps/wcm/connect/doit_fire/FIRE/Home/Forms)



# INSPECTION REPORT

1. Name & address of the building : Jagan Nath Gupta Memorial Educational Society, located at PSP Area-3, Sector-05, Rohini, Delhi-110085.
2. Type of Occupancy : Educational 2 Blocks (Basement, ground plus 03 floors)
3. Type of Case : New Case *Renewal*
4. Details of previous NOC : F.6/DFS/ MS/2020/WZ/275 dated 27.07.2020.
5. Fire Safety directives letter No : F.6/DFS/MS/BP/2002/919 dated 06.06.2002.
6. Date of inspection : 15.06.2023
7. Name of the Inspecting Officers : A.K.Sharma ADO (Rohini)
8. Name and designation of officers from the building side : Sh. Akshay (Admin Officer)
9. Year of Construction : 2003
10. Applicant's letter No. : OD No.2345 dated 29.05.2023

Minimum Standards on fire prevention and fire safety U/R 33	NBC Requirement	Provided at site	Remarks MR/NMR
<b>Access to building</b>			
• Road width	12 m	13 m	MR
• Gate width	5 m	6 m	MR
• Width of internal road	06 mtr	06 mtr	MR
<b>Number, Width, Type &amp; Arrangement of Exits</b>			
c. Number of staircases			
• Upper Floors	4	5	MR
• Basements	4	6	MR
d. Width of staircases			
• Upper Floors	4 X 1.5 M	3 X 1.5 M, 1X1.6m 1X 1.25	MR
• Basements	5 X 1.5 M	5 X 1.5 M 1 X 1.25 M	MR
e. Protection of exits			
• Fire check door	Required	Provided in basement	MR
• Pressurization	NA	NA	MR
g. No. of continuous staircases to terrace	4nos.	5 nos	MR
h. Width of Corridor	1.5m	Provided	MR
i. Door Size	1.00m	1.10 m	MR
<b>Compartmentation.</b>			
• Fire check door	Required	Provided in basement	MR
• Sealing of electrical shafts	Required	Provided	MR
• Fire Rating of shaft door	Required	Provided	MR
• Water Curtain	Required	Provided in basement	MR
• Fire Dampers	N/A	N/A	N/A
<b>Smoke Management System.</b>			
• Basements	12ACPH	Natural ventilation	MR
• Upper floors	12ACPH	Natural ventilation	MR
<b>Fire Extinguishers</b>			
• Total numbers	60nos	75 nos	MR
• Types	ABC/CO2	ABC/CO2-75	MR
• IS marking	Required	Provided	MR
<b>First-Aid Hose Reels.</b>			


	<ul style="list-style-type: none"> <li>Total numbers on each floor</li> <li>Length of hose reel hose</li> <li>Nozzle diameter</li> </ul>	01 no's each blocks	Provided	MR
		30m	30m	MR
		5mm	5mm	MR
7	<b>Automatic fire detection and alarming system.</b>			
	<ul style="list-style-type: none"> <li>Type of detectors</li> <li>Location of Main Panel</li> <li>Location of Repeater Panel</li> <li>Alternate source of power</li> <li>Hooters' Location</li> </ul>	NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
8	<b>MOEFA</b>	Required	Provided	MR
9	<b>Public Address System.</b>	N/A	N/A	N/A
10	<b>Automatic Sprinkler System.</b>			
	<ul style="list-style-type: none"> <li>Basement</li> <li>Upper Floor</li> <li>Sprinkler above false ceiling</li> </ul>	Required	Provided	MR
		NA	NA	NA
		NA	NA	NA
11	<b>Internal Hydrants</b>			
	<ul style="list-style-type: none"> <li>Size of riser/down-comer</li> <li>Number of hydrants per floor</li> <li>Hose Box</li> </ul>	NA	100mm Provided	MR
		01 no's	Provided	MR
		01nos each	Provided	MR
12	<b>Yard Hydrants.</b>			
	<ul style="list-style-type: none"> <li>Total number of hydrants</li> <li>Hose Box</li> </ul>	NA	02 no's	NA
		NA	02 no's	NA
13	<b>Pumping Arrangements.</b>			
	<ul style="list-style-type: none"> <li>➤ Ground Level</li> <li>➤ Discharge of main Pump</li> <li>➤ Head of Main pump</li> <li>➤ Number of main pumps</li> <li>➤ Jockey Pump out put</li> <li>➤ Jockey pump head</li> <li>➤ Standby Pump out put</li> <li>➤ Standby Pump Head</li> <li>➤ Auto Starting/ Manual stopping</li> <li>➤ Pump House Access</li> </ul>	NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
	<ul style="list-style-type: none"> <li>Terrace level</li> <li>➤ Discharge of pump</li> <li>➤ Head of the pump</li> <li>➤ Power Supply</li> <li>➤ Auto Starting of pump</li> </ul>	900 LPM	Provided	MR
		40 M	Provided	MR
		NA	NA	NA
		Required	Provided	MR
14	<b>Captive Water Storage for fire fighting.</b>			
	<ul style="list-style-type: none"> <li>Underground tank capacity</li> <li>➤ Draw-off connection</li> <li>➤ Fire service inlet</li> <li>➤ Access to tank</li> <li>Overhead Tank capacity</li> </ul>	NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		10,000 liters	40,000 liters	MR
		Required	Provided	MR
15	<b>Exit Signage.</b>			
16	<b>Provision of Lifts.</b>			



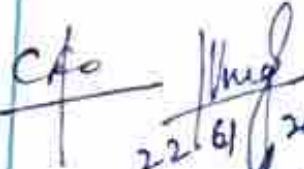

	MR	• Pressurization of Lift Shaft	NA	NA	NA
		• Pressurization of Lift lobby	NA	NA	NA
		• Communication In lift Car	Required	Provided	MR
		• Fireman's Grounding Switch	Required	Provided	MR
		• Lift Signage	Required	Provided	MR
		Standby power supply	Required	Provided DG Set	MR
18		Refuge Area.			
		➤ Total Area	NA	NA	NA
		➤ Location	NA	NA	NA
19		Fire Control Room			
		• Detector System Panel	NA	NA	NA
		• Flow Switch Panel	NA	NA	NA
		• PA System Panel	NA	NA	NA
		• Batter backup	NA	NA	NA
		• Building Floor Plans	NA	NA	NA
20		Special Fire Protection Systems for Protection of special Risks, if any:	NA	NA	NA

The fire protection systems provided in the building were test checked and found functional at the time of inspection.

In view of the deemed compliance of the minimum standards of the fire prevention and fire safety measures as required under the rules the NOC issued vide letter no. F.6/DFS/MS/2020/WZ/275 dated 27.07.2020 is recommended for renewal under rule 37 of the Delhi Fire Service rules 2010.

  
 Signature of Inspecting Officer  
 Name: A. K. Sharma  
 Designation: ADO (Rohini)

D.B Mukherjee - on d  
 DO (NW)

  
 22/6/2023  
  
 22/6/23

FT letter is put up for  
 kind perusal and signature  
 please.



  
 28/6/23

  
 27/6/23