

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEAD QUARTERS: DELHI FIRE SERVICE: NEW DELHI-110001**


No. F6/DFS/MS/School/SZ/2023/451

Dated: 03/07/2023

FIRE SAFETY CERTIFICATE

Certified that **Salwan Public School** located at **Girdharilal Salwan Marg, Rajendra Nagar, New Delhi- 110060**, having three blocks namely Old block, Admin block & Montessori block. Old block is comprised of ground plus two upper floors, admin block is comprised of ground plus one upper floor & Montessori block is comprised of ground plus two upper floors (2nd floor porta cabin), was granted FSC by this department vide letter No. F.6/DFS/MS/2020/School/524 dated 02.12.2020. The school building was re-inspected by the officers concerned of Delhi Fire Service on 20.06.2023 in the presence of Sh. Kallu Singh (admin officer) and found that the school management have complied with the fire prevention and fire safety requirements in accordance with Rule 33 of Delhi Fire Service Rules 2010 under Delhi Fire Service Act- 2007 and found that the school complex (**Old Block, Admin Block & Montessori Block**) is fit for occupancy class "Educational" with effect from 03/07/2023 for a period of 03 years in accordance with Rule 36 unless renewed under Rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under Rule 38 of the Delhi Fire Service Rules, 2010, printed below.

Issued on 03/07/2023 at New Delhi by.


(Atul Garg)
Director
Delhi Fire Service

Copy to: -

1. The Principal, Salwan Public School, Girdharilal Salwan Marg, Rajendra Nagar, New Delhi- 110060.
2. The Directorate of Education, Govt. of NCT of Delhi, Old Secretariat, New Delhi- 54.

Conditions for the Validity of Fire Safety Certificate

1. All the fire safety arrangements provided therein shall be maintained in good working conditions at all times.
2. Any loss of life or property due to non-functional of fire safety measures shall be at the risk & responsibility of the management.
3. The trained firefighting staffs should be available round the clock.
4. Any deviation w.r.t. construction etc. shall be verified by the concerned building sanctioning authority.
5. This fire safety certificate may not be treated in any case for regularization of unauthorized construction, if any.
6. The owner / occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on www.dfs.delhigovt.nic.in
7. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in Form "J" [sub rule (1) of rule 37] along with a copy of this certificate, six months prior to its expiry. The form is available on www.dfs.delhigovt.nic.in.
8. All the means of escapes /exits shall not be locked/blocked at any time for safe evacuation of the occupants in case of emergency.

INSPECTION REPORT

1. Name & address of the building : Salwan Public School, Girdharilal Salwan Marg. Rajender Nagar, New Delhi-60.
2. Type of Occupancy : Educational
3. Building Composition : The School building having three blocks (Old block, Montessori block and Admin block). Old block & Montessori block are comprised ground plus two upper floors and Admin block is comprised of ground and first floor.
4. Type of Case : Renewal
5. Details of previous NOC : F.6/DFS/MS/2020/School/524 dated 02.12.2020
6. Fire Safety directives letter No : N/A
7. Date of inspection : 20.06.2023
8. Name of the Inspecting Officers : Vedpal Chhikara, DO (SW) & P.V. Rathee, ADO(SRD)
9. Name and designation of officers
from the building side : Ms. Kallu Singh, Admin Officer
9. Year of Construction : 1998/ 2014 (construction of two new blocks)
10. Applicant's letter No. : Letter No. SPS/230/2023 dated 13.06.2023.

S. No.	Minimum Standards on fire prevention and fire safety U/R 33	Requirement as per FSC dt. 02.12.2020	Provided at site	Remarks MR/NMR
1	Access to building			
	• Road width	06 mts	Provided	MR
	• Gate width	4.5 mts	Provided	MR
	• Width of internal road	N/A	N/A	N/A
2	Number, Width, Type & Arrangement of Exits			
	a. Number of staircases	-----	-----	-----
	• Upper Floors	02 Nos. each block	Provided	MR
	• Basements	N/A	N/A	N/A
	b. Width of staircases	-----	-----	-----
	• Upper Floors	1.5 mts or less & 0.75 mt	Old Block- 1.30, 1.30 mts Admin- 1.50, 1.15 mts Montessori- 1.60, 1.25 mts	MR ✓
	• Basements	N/A	N/A	N/A
	c. Protection of exits	-----	-----	-----
	• Fire check door	N/A	N/A	N/A
	• Pressurization	N/A	N/A	N/A
	e. No. of continuous staircases to terrace	01	01	MR
	g. Width of Corridor	1.5 mts	Old Block- 2.60 mts Montessori- 1.60 mts Admin- N/A	MR ✓
	h. Door Size	1.0 mt.	Provided	MR
3	Compartmentation.			
	• Fire check door	N/A	N/A	N/A
	• Sealing of electrical shafts	N/A	N/A	N/A
	• Fire Rating of shaft door	N/A	N/A	N/A
	• Water Curtain	N/A	N/A	N/A
	• Fire Dampers	N/A	N/A	N/A
4	Smoke Management System.			
	• Basements	30 a/c per hour	N/A	N/A
	• Upper floors	12 a/c per hour	Natural ventilation	MR
5	Fire Extinguishers			

N-34

	<ul style="list-style-type: none"> Total numbers Types IS marking 	24 nos. ABC, CO ₂ type ISI marked	Provided	MR
			Provided	MR
			Provided	MR
6	First-Aid Hose Reels.			
	<ul style="list-style-type: none"> Total numbers on each floor Length of hose reel hose Nozzle diameter 	Old Block- 02 Nos. Montessori- 01 No. 30 m 5 mm	Provided	MR
			Provided	MR
			Provided	MR
7	Automatic fire detection and alarming system Not required			
	<ul style="list-style-type: none"> Type of detectors Location of Main Panel Location of Repeater Panel Alternate source of power Hooters' Location 	N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
8	MOEFA			
		N/A	N/A	N/A
9	Public Address System.			
		N/A	N/A	N/A
10	Automatic Sprinkler System			
	<ul style="list-style-type: none"> Basement Upper Floor Sprinkler above false ceiling 	N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
11	Internal Hydrants			
	<ul style="list-style-type: none"> Size of riser/down-comer ✓ Number of hydrants per floor Hose Box 	N/A	Provided	N/A
		N/A	N/A	N/A
		N/A	Provided	N/A
12	Yard Hydrants.			
	<ul style="list-style-type: none"> Total number of hydrants Hose Box 	N/A	N/A	N/A
		N/A	N/A	N/A
13	Pumping Arrangements			
	<ul style="list-style-type: none"> Ground Level <ul style="list-style-type: none"> Discharge of main Pump Head of Main pump Number of main pumps Jockey Pump out put Jockey pump head Standby Pump out put Standby Pump Head Auto Starting/ Manual stopping Pump House Access Terrace level <ul style="list-style-type: none"> Discharge of pump Head of the pump Power Supply Auto Starting of pump 	---	----	-----
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		450 LPM × 2	450 LPM × 2	MR
		40 mts	40 mts	MR
		N/A	N/A	N/A
		N/A	N/A	N/A
14	Captive Water Storage for fire fighting			
	<ul style="list-style-type: none"> Underground tank capacity Draw-off connection Fire service inlet Access to tank Overhead Tank capacity 	N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		10000 lts.	Provided	MR


		Required	Provided	MR
15	Exit Signage.	Not Applicable		
16	Provision of Lifts.	Not Applicable		
	• Pressurization of Lift Shaft	N/A	N/A	N/A
	• Pressurization of Lift lobby	N/A	N/A	N/A
	• Communication In lift Car	N/A	N/A	N/A
	• Fireman's Grounding Switch	N/A	N/A	N/A
	• Lift Signage	N/A	N/A	N/A
17	Standby power supply	Required	Provided	MR
18	Refuge Area.	Not Applicable		
	✓ Total Area	N/A	N/A	N/A
	✓ Location	N/A	N/A	N/A
19	Fire Control Room	Not Applicable		
	• Detector System Panel	N/A	N/A	N/A
	• Flow Switch Panel	N/A	N/A	N/A
	• PA System Panel	N/A	N/A	N/A
	• Batter backup	N/A	N/A	N/A
	• Building Floor Plans	N/A	N/A	N/A
20	Special Fire Protection Systems for Protection of special Risks, if any:	Required 02 ABC type fire extinguishers near elect. panel	Provided	MR

The fire protection systems provided in the building were tested / checked and found satisfactory at the time of inspection.

Note:- School management given an undertaking to certify that Porta Cabin on 2nd floor of Montessori Block (GD Block) near parking is used as a Store Room (Undertaking placed at C-85).

In view the deemed compliance of the minimum standards on fire prevention and fire safety measures as required under the rules, the FSC issued vide letter No. F.6/DFS/MS/2020/School/524 dated 02.12.2020, renewal under Rule 37 of Delhi Fire Service Rules 2010 is recommended.

Accordingly, DFA is put up for approval & signature please.

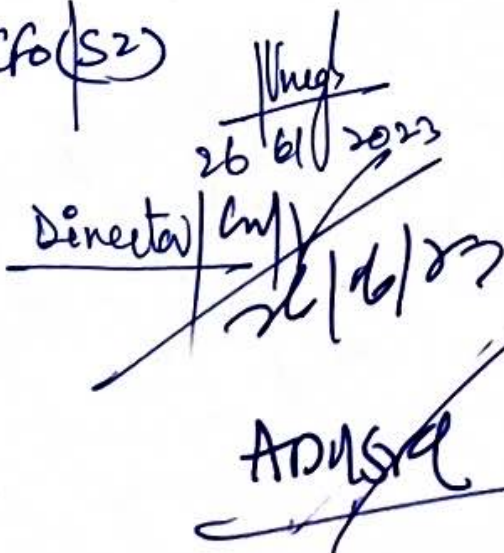
 22/6/23

Signature of the Inspecting Officer
Name- Vedpal Chhikara
Divisional Officer (SW)

 22/6/23

Signature of the Inspecting Officer
Name- P.V. Rathee
Asstt. Div. Officer (S.Rd)

CFO(S2)

 26/6/2023
26/6/23
ADUSP