

FORM 'II'  
FORM FOR ISSUING FIRE SAFETY CERTIFICATE  
[Refer sub - rule (1) of rule 35]  
GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI  
HEAD QUARTERS: DELHI FIRE SERVICE, CONNAUGHT PLACE  
NEW DELHI

No.F6/DFS/MS/SZ/2023/EH/223

Dated: 12/07/2023

**FIRE SAFETY CERTIFICATE**

Certified that Mardigras by Uncover (A unit of KIKI foods LLP) Located at Ground & 1<sup>st</sup> floor Plot No. 231 Sector - 9, Dwarka New Delhi, in a building comprised of Basement + Ground + 02 Upper Floors, owned/ occupied by **KIKI foods LLP**, have complied with the fire prevention and fire safety requirements in accordance with Rule 33 of the Delhi Fire Service Rule, 2010 and verified by the team of officers concerned of this department on 03/07/2023 in the presence of Sh. Sunny Chillar (Director) and found that the said building/premises is fit for occupancy class "Assembly" Group D (Ground floor & 1<sup>st</sup> floor) with effect from 12/07/2023 to 31/03/2026 in accordance with Rule 36 unless renewed under Rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under Rule 38 of the Delhi Fire Service Rules, 2010.

Issued on 12/07/2023 at New Delhi by.

  
(Atul Garg)  
Director  
Delhi Fire Service  
12/07/23

Copy to:

1. The Dy Health Officer, South Delhi Municipal Corporation, Najafgarh Zone, Dhansa Stand Najafgarh New Delhi.
2. The Manager, Mardigras by Uncover (A unit of KIKI foods LLP) Located at Ground & 1<sup>st</sup> floor Plot No. 231 Sector - 9, Dwarka New Delhi.

**Following fire safety directives must be adhered to:-**

1. All the fire safety arrangements provided therein shall be maintained in good working condition at all times.
2. Any loss of life or property due to non-functional fire safety measures shall be at the risk and responsibility of the management.
3. The trained staff should be available round the clock.
4. Any deviations w.r.t. construction shall be verified by the concerned building sanctioning agency.
5. The certificate may not be treated in any case for the regularization of the unauthorized construction, if any.
6. Basement shall be used as per building bye laws.
7. The owner/occupier shall submit a declaration every year in the form 'K' provided in the first schedule of Delhi Fire Service Rules 2010, form is available on [www.dfs.delhigovt.nic.in](http://www.dfs.delhigovt.nic.in).
8. The owner/ occupier shall apply for renewal of this Fire Safety Certificate to the Director in Form 'J' [sub rule (1) of rule 37] along with a copy of this certificate, six months prior to its expiry.

N13

**INSPECTION REPORT**

1. Name & address of the building: Mardigras by Uncover (A unit of KIKI foods LLP) Located Plot No. 231 Sector – 9, Dwarka New Delhi.
2. Type of Occupancy : Assembly 'D' Restaurant running at Ground & 1st Floor, (The building comprised of Basement+ Ground + 2 Upper Floor)
3. Type of Case ; New
4. Details of previous NOC : Nil
5. Fire Safety directives Letter No. : Nil
6. Date of inspection : 03/07/2023
7. Name of the Inspecting Officer : DO/SW & ADO (DWK)
8. Name and designation of Officer  
from the building side : Sh. Sunny Chillar (Director)
9. Year of Construction : Not known
10. Applicant's letter No. : Application No. 2023051709050, dated 22/06/2023

Basement= Vacant, others property  
G & 1<sup>st</sup> Floor= Restaurant  
2<sup>nd</sup> Floor= Office

| S No | Minimum standards on fire prevention and fire safety U/R 33 | As per NBC    | Provided at site    | Remarks MR/NMR |
|------|---|---------------|---------------------|----------------|
| 1.   | Access of building  |               |                     |                |
|      | • Road width  | 06 mtr        | 12 mtr              | MR             |
|      | • Gate width  | NA            | NA                  | NA             |
|      | • Width of internal road                                    | NA            | NA                  | NA             |
| 2.   | Number, width, Type & Arrangements of exits                 |               |                     |                |
|      | a. Number of staircases                                     |               |                     |                |
|      | • Upper floors  | 02 Nos.       | 02 Nos.             | MR             |
|      | • Basements   | NA            | NA                  | NA             |
|      | b. Width of staircases                                      |               |                     |                |
|      | • Upper floors  | 2x1.50 m      | Provided            | MR             |
|      | • Basements   | NA            | Others property     | NA             |
|      | c. Protection of exits                                      |               |                     |                |
|      | • Fire check door   | NA            | NA                  | NA             |
|      | • Pressurization  | NA            | NA                  | NA             |
|      | d. No of continuous staircase to terrace                    | 01            | 01 Nos.             | MR             |
|      | e. Width Of Corridor  | NA            | NA                  | NA             |
|      | f. Door Size  | 1.5 mtr       | Provided            | MR             |
| 3.   | Compartmentation  |               |                     |                |
|      | • Fire check door   | NA            | NA                  | NA             |
|      | • Sealing of electrical shafts                              | NA            | NA                  | NA             |
|      | • Fire Rating of shaft door                                 | NA            | NA                  | NA             |
|      | • Water Curtain   | NA            | NA                  | NA             |
|      | • Fire Dampers  | NA            | NA                  | NA             |
| 4.   | Smoke managements System                                    |               |                     |                |
|      | • Basements   | NA            | NA                  | NA             |
|      | • Upper floors  | 12 a/c charge | Natural ventilation | MR             |
| 5.   | Fire Extinguishers  |               |                     |                |


|     |   |   |  |  |
|-----|---|---|--|--|
| 5.  | Fire Extinguishers  |   |  |  |
|     | <ul style="list-style-type: none"> <li>Total numbers</li> <li>Types</li> <li>IS marking</li> </ul>  | 04 nos. each floor<br>ABC & CO <sub>2</sub><br>ISI marked   | Provided<br>ABC & CO <sub>2</sub><br>Provided  | MR<br>MR<br>MR   |
| 6.  | First – Aid Hose Reels  |   |  |  |
|     | <ul style="list-style-type: none"> <li>Total numbers on each floor</li> <li>Length of hose reel hose</li> <li>Nozzle diameter</li> </ul>  | 01 No<br>30m<br>5mm   | Provided<br>30m<br>5mm   | MR<br>MR<br>MR   |
| 7.  | Automatic fire detection and alarming system  |   |  |  |
|     | <ul style="list-style-type: none"> <li>Type of detectors</li> <li>Location of Main Panel</li> <li>Location of Repeater Panel</li> <li>Alternate source of power</li> <li>Hooters' Location</li> </ul>   | NA<br>NA<br>NA<br>NA<br>NA  | Provided<br>NA<br>NA<br>NA<br>NA   | NA<br>NA<br>NA<br>NA<br>NA   |
| 8.  | MOEFA   | Required  | Provided   | MR   |
| 9.  | Public Address System   | Required  | Provided   | MR   |
| 10. | Automatic Sprinkler System  |   |  |  |
|     | <ul style="list-style-type: none"> <li>Basements</li> <li>Upper Floor</li> <li>Sprinkler above false ceiling</li> </ul>   | NA<br>NA<br>NA  | Others property<br>NA<br>NA  | NA<br>NA<br>NA   |
| 11. | Internal Hydrants:  |   |  |  |
|     | <ul style="list-style-type: none"> <li>Size of riser/down- comer</li> <li>Number of hydrants per floor</li> <li>Hose Box</li> </ul>   | 100 mm<br>01<br>Required  | Provided<br>Provided<br>Provided   | MR<br>MR<br>MR   |
| 12. | Yard Hydrants   |   |  |  |
|     | <ul style="list-style-type: none"> <li>Total number of hydrants</li> <li>Hose Box</li> </ul>  | NA<br>NA  | NA<br>NA   | NA<br>NA   |
| 13. | Pumping Arrangements:   |   |  |  |
|     | <ul style="list-style-type: none"> <li>Ground Level</li> <li>Discharge of main pump</li> <li>➤ Head of main pump</li> <li>➤ Number of main pumps</li> <li>➤ Jockey pump out put</li> <li>➤ Jockey pump head</li> <li>➤ Standby Pump out put</li> <li>➤ Standby Pump Head</li> <li>➤ Auto Staring/Manual stopping</li> <li>➤ Pump House Access</li> <li>Terrace level</li> <li>➤ Discharge of pump</li> <li>➤ Head of the pump</li> <li>➤ Power supply</li> <li>➤ Auto starting of pump</li> </ul> | NA<br>NA<br>NA<br>NA<br>NA<br>NA<br>NA<br>NA<br>NA<br>NA<br>NA<br>900 lpm,<br>40Mtr<br>Required<br>Required | NA<br>NA<br>NA<br>NA<br>NA<br>NA<br>NA<br>NA<br>NA<br>NA<br>NA<br>Provided<br>40 mtr<br>DG Set<br>Provided | NA<br>NA<br>NA<br>NA<br>NA<br>NA<br>NA<br>NA<br>NA<br>NA<br>NA<br>MR<br>MR<br>MR<br>MR |
| 14. | Captive water Storage for fire fighting:  |   |  |  |
|     | <ul style="list-style-type: none"> <li>Under ground tank capacity</li> <li>➤ Draw off connection</li> <li>➤ Fire service inlet</li> <li>➤ Access to tank</li> <li>Overhead Tank capacity</li> </ul>   | NA<br>NA<br>NA<br>NA<br>20,000Ltr   | NA<br>NA<br>NA<br>NA<br>Provided   | NA<br>NA<br>NA<br>NA<br>MR   |
| 15  | Exit Signage  | Required  | Provided   | MR   |


A/S


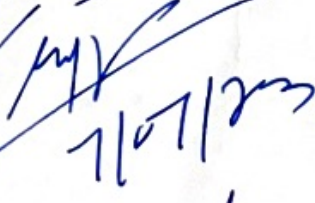
|     |  |          |  |    |
|-----|--|----------|--|----|
| 16. | Provision of Lifts   |          |  |    |
|     | ➤ Pressurization of Lift Shaft   | NA       | NA   | NA |
|     | ➤ Pressurization of lift lobby   | NA       | NA   | NA |
|     | ➤ Communication in lift Car  | Required | Provided   | MR |
|     | ➤ Fireman's Grounding Switch   | Required | Provided   | MR |
|     | ➤ Lift Signage   | Required | Provided   | MR |
| 17. | Standby power supply   | Required | Provided   | MR |
| 18. | Refuge Area  |          |  |    |
|     | ➤ Total area   | NA       | NA   | NA |
|     | ➤ Location   | NA       | NA   | NA |
| 19. | Fire control room  |          |  |    |
|     | ➤ Detector system panel  | NA       | NA   | NA |
|     | ➤ Flow Switch Panel  | NA       | NA   | NA |
|     | ➤ PA System Panel  | NA       | NA   | NA |
|     | ➤ Battery backup   | NA       | NA   | NA |
|     | ➤ Building Floor Plans   | NA       | NA   | NA |
| 20. | Special Fire Protection Systems for Protection of special Risks, if any; | Required | CO2 fire extinguisher provided near electric panel | MR |

The fire protection systems provided in the building were test checked at random and found functional at the time of inspection.


If agreed in view of the substantial compliance of the minimum standards on fire prevention and fire safety required under the Rules, it is recommended to grant fire safety certificate under Rule 35 of Delhi Fire Service Act- 2007 & Rules- 2010.

  
 Sign of Inspecting Officer  
 Name: Vedpal  
 Designation: DO/SW

  
 Sign of Inspecting Officer  
 Name: Udai vir Singh  
 Designation: ADO/DWK

CO (S2)   
 6/7/2023  
 Director   
 7/7/23  
 ADO/DWK

Fire fr letter is put up for sig

"DIRECTOR"   
 7/7/23

  
 7/7/23