

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEAD QUARTERS: DELHI FIRE SERVICE, CONNAUGHT PLACE
NEW DELHI

75-6123
जाजादी
अमृत महोत्सव

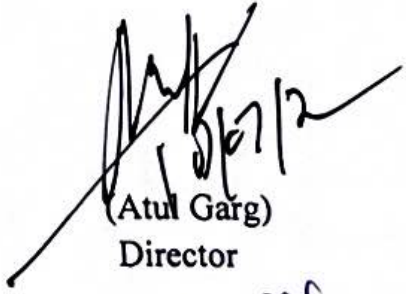
No. F6/DFS/MS/EH/WZ/2023/233

Dated: 19/07/2023

FIRE SAFETY CERTIFICATE

Certified that the M/s. **White and Black Hospitality Private Limited** located at Property no. 11-C, 2nd & 3rd Floor, Club Road, West Punjabi Bagh, New Delhi-110026 in a building comprised of Basement + Stilt + Ground + 03 Upper floors. Owned/Occupied by M/s. **White and Black Hospitality Private Limited**, Fire Safety Certificate was already issued by this department Vide letter no. F.6/DFS/MS/2020/EH/98 dated 02/07/2020 (Earlier FSC issued namely Night Walk (A unit of BS Hospitality). The Premises was re-inspected by the officer concerned of this department on 11/07/2023 in the presence of Sh. Salim Khan and observed that all the fire prevention and fire safety arrangements provided in the premises found in good working condition. The premises have deemed complied with fire prevention and fire safety requirements in accordance with Rule 33 of Delhi Fire Service Rules, 2010 and that the said floor is fit for occupancy class "Assembly" Group D (For 2nd & 3rd floor Only) with effect from 19/07/2023 for a period of three years in accordance with Rule 36 unless renewed under Rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under Rule 38 of the Delhi Fire Service Rules, 2010. conditions printed overleaf.

Issued on ..19/07/2023 at New Delhi by.


(Atul Garg)
Director


17/7/2023

Copy to: -

1. The Joint Commissioner of Police, Licensing Unit, 1st floor, Police Station, Defence Colony, New Delhi. Email-ID:- addlcp.lic-dl@nic.in
2. The Owner/Occupier M/s. **White and Black Hospitality Private Limited** located At Property no. 11-C, 2nd & 3rd Floor, Club Road, West Punjabi Bagh, New Delhi-110026. (Online ID No. 2023063011777 dated 01/07/2023)
3. Dy. Health Officer, SDMC, West Zone, Vishal Enclave, Rajouri Garden, New Delhi - 110027. Email-ID: - dhowestzone@gmail.com

INSPECTION REPORT

1. Name & address of the building	White and Black Hospitality Private Limited Located at Property No. 11-C, 2 nd & 3 rd floor, Club Road, Punjabi Bagh, New Delhi-110026.
2. Type of Occupancy	Eating House /Assembly Occupancy
3. Type of Case	Renewal
4. Details of previous NOC	F.6/DFS/MS/2020/EH/98 dated 02/07/2020 (Earlier FSC issued namely Night Walk (A unit of BS Hospitality))
5. Fire Safety directives letter No	NBC Part-IV
6. Date of inspection	11/07/2023
7. Name of the Inspecting Officers	Sarabjeet Singh ADO (MN)
8. Name and designation of officers from the building side	Sh. Salim Khan
9. Year of Construction	2000 (As per MHA Portal)
10. Applicant's letter No.	Online Application ID No. 2023063011777 dated 01/07/2023

The Said Restaurant is running at 2nd & 3rd floor in a Building Comprised of Basement + Stilt + Ground + 03 upper floors, earlier issued FSC by this department vide letter No. F.6/DFS/MS/2020/EH/98 dated 02/07/2020 namely Night Walk (A unit of BS Hospitality)

S. No.	Minimum Standards on fire prevention and fire safety U/R 33	Required as per Rule 35(6) of DFS Rule 2010	Provided at site	Remarks MR/NMR
1	Access to building			
	• Road width	9 m	Provided	MR
	• Gate width	NA	On Main Road	NA
	• Width of internal road	NA	NA	NA
2	Number, Width, Type & Arrangement of Exits			
	a. Number of staircases			
	• Upper Floors	02	02 Provided	MR
	• Basements	NA	NA	NA
	b. Width of staircases			
	• Upper Floors	2mtr & 1.5mtr	1 x 2m (iron), 1 x 1.5 (Concrete)	MR
	• Basements	NA	NA	NA
	c. Protection of exits			
	• Fire check door	NA	NA	NA
	• Pressurization	NA	NA	NA
	e. No. of continuous staircases to terrace	NA	NA	NA
	f. Width of Corridor	NA	NA	NA
	g. Door Size	2mtr & 1.5mtr	Provided	MR
3	Compartmentation.			
	• Fire check door	NA	NA	NA
	• Sealing of electrical shafts	NA	NA	NA
	• Fire Rating of shaft door	NA	NA	NA
	• Water Curtain	NA	NA	NA
	• Fire Dampers	NA	NA	NA
4	Smoke Management System.			
	• Basements	NA	NA	NA
	• Upper floors	Required	Provided	MR
5	Fire Extinguishers			
	• Total numbers	06 nos.	Provided	MR
	• Types	CO ₂ , ABC type	Provided	MR
	• IS marking	ISI marked	Provided	MR

4

8/1

6	First-Aid Hose Reels.			
	• Total numbers on each floor	01	Provided	MR
	• Length of hose reel hose	30m	Provided	MR
	• Nozzle diameter	5mm	Provided	MR
7	Automatic fire detection and alarming system.			
	• Type of detectors	Smoke & Heat	Provided	MR
	• Location of Main Panel	Required	Provided	MR
	• Location of Repeater Panel	Required	Provided	MR
	• Alternate source of power	Required	Provided	MR
	• Hooters' Location	Required	Provided	MR
8	MOEFA	Required	Provided	MR
9	Public Address System.	NR	NR	NR
10	Automatic Sprinkler System.			
	• Basement	NA	NA	NA
	• Upper Floor	NR	Provided	NR
	• Sprinkler above false ceiling	NA	NA	NA
11	Internal Hydrants			
	• Size of riser/down-comer	100 mm	Provided	MR
	• Number of hydrants per floor	01	Provided	MR
	• Hose Box	01	Provided	MR
12	Yard Hydrants.			
	• Total number of hydrants	NA	NA	NA
	• Hose Box	NA	NA	NA
13	Pumping Arrangements.			
	• Ground Level			
	➤ Discharge of main Pump	2280 LPM	Provided	MR
	➤ Head of Main pump	70 MH	Provided	MR
	➤ Number of main pumps	01	Provided	MR
	➤ Jockey Pump out put	180 LPM	Provided	MR
	➤ Jockey pump head	70 MH	Provided	MR
	➤ Standby Pump out put	2280 LPM	Provided	MR
	➤ Standby Pump Head	70 MH	Provided	MR
	➤ Auto Starting/ Manual stopping	Required	Provided	MR
	➤ Pump House Access	Required	Provided	MR
	• Terrace level			
	➤ Discharge of pump	450 LPM	Provided	MR
	➤ Head of the pump	40 MH	Provided	MR
	➤ Power Supply	Required	Provided	MR
	➤ Auto Starting of pump	Required	Provided	MR
14	Captive Water Storage for fire fighting.			
	• Underground tank capacity	1,00,000 ltrs	Provided	MR
	➤ Draw-off connection	Required	Provided	MR
	➤ Fire service inlet	Required	Provided	MR
	➤ Access to tank	Required	Provided	MR
	• Overhead Tank capacity	10,000 ltrs	Provided	MR
15	Exit Signage.	Required	Provided	MR

Provision of Lifts.			
16	• Pressurization of Lift Shaft	NA	NA
	• Pressurization of Lift lobby	NA	NA
	• Communication In lift Car	Required	Provided
	• Fireman's Grounding Switch	Required	Provided
	• Lift Signage	Required	Provided
17	Standby power supply	Required	Provided
18	Refuge Area.		
	> Total Area	NA	NA
	> Location	NA	NA
19	Fire Control Room		
	• Detector System Panel	NA	NA
	• Flow Switch Panel	NA	NA
	• PA System Panel	NA	NA
	• Batter backup	NA	NA
	• Building Floor Plans	NA	NA
20	Special Fire Protection Systems for Protection of special Risks, if any:	NA	NA

The fire protection systems provided in the building were checked and found functional at the time of inspection. The shortcoming issued by this department vide letter no. F.6/DFS/MS/GH/2022/WZ/399 dated 30/05/2022, F.6/DFS/MS/GH/WZ/2022/537 dated 23/08/2022 & F.6/DFS/MS/GH/WZ/2023/241 dated 05/06/2023 has been complied.

In view of the substantial compliance of the minimum standards on fire prevention and fire safety measures as required under the rules, the NOC issued vide letter No. F.6/DFS/MS/2020/EH/98 dated 02/07/2020 (Earlier FSC issued namely Night Walk (A unit of BS Hospitality), renewal under rule 35 of the Delhi Fire Service Rules 2010, is recommended.

DO (NOC)

Signature of the Inspecting Officer
13/7/2023

Signature of the Inspecting Officer
Name: Sarabjeet Singh
Designation: ADO (MN)

13/7/2023

Signature
13/7/2023

DCO (MNC)

Signature

M.K. CHATTERJAY

Signature
14/7/2023

Signature

Signature
14/7/2023

Signature