

C-47

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEAD QUARTERS: DELHI FIRE SERVICE: CONNAUGHT PLACE
NEW DELHI-110001**

No.F.6 DFS/MS/School/2023/SZ/ 507

Dated: 25/07/2023

FIRE SAFETY CERTIFICATE

Certified that the **Deepalaya School** located at A-14, Kalkaji Extn. New Delhi 110019 comprised of Basement, Ground plus Two Upper floors owned/occupied by Deepalaya School was issued Fire Safety Certificate by this department vide letter no. F6/DFS/MS/School/2020/SZ/382 dated 29/09/2020. The said premise was re-inspected by officer concerned of this department on 18/07/2023 in presence of Mr. AJI George and found that the said school building have deemed complied with the fire prevention and fire safety requirements in accordance with Rule 33 of Delhi Fire Service Rules, 2010 and that the building is fit for occupancy class "**Educational Building Group – B**" with effect from 25/07/2023 for a period of **Three years** in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under rule 38 of Delhi Fire Service Rules 2010.

Issued on 25/07/2023 at New Delhi by


(ATUL GARG)
DIRECTOR
DELHI FIRE SERVICE

Copy to: -

1. The Principal, Deepalaya School located at A-14, Kalkaji Extn. New Delhi 110019
2. The Directorate of Education, Govt. of NCT of Delhi, Old Secretariat, New Delhi- 110054

Conditions for the validity of Fire Safety Certificate

1. All the fire safety arrangements provided therein shall be maintained in good working condition at all time as seen during inspection. Any loss of life or property due to non-functional fire safety measures shall be at the responsibility of the management.
2. All the staff members must know the correct method of operation of firefighting system.
3. This certificate cannot be treated as regularization of unauthorized construction, if any.
4. The basement shall be used as per the provisions of BBL /NBC Part- IV.
5. The owner/ occupier shall submit a declaration every year in Form 'K' provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on www.dfs.delhigovt.nic.in
6. This fire safety certificate may not in any way be treated as regularization (Clause 2.8 of UBBL-2016) of unauthorized construction or Alteration (Clause 1.4.3 of UBBL-2016), if any.
7. "The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in Form 'J' [sub rule (1) of rule 37] along with a copy of this Certificate, six months prior to its expiry."

INSPECTION REPORT

1	Name & Address of the Building	Deepalaya School, A-14, Kalkaji Extn. New Delhi 110019		
2	Type of Occupancy	Educational, Group-B (School)		
3	Building Comprised of	Basement, Ground + 02 upper floors.		
4	Type of Case	Renewal		
5	Details of Previous NOC	F6/DFS/MS/School/2020/SZ/382 dated 29/09/2020		
6	Fire Safety Directives Letter No	F6/DFS/MS/BP/96/329 dated 08/03/1996		
7	Date of Inspection	18-07-2023		
8	Name of the Inspecting Officers	DO (South) & ADO (BCP)		
9	Name & Designation of Officers from the building side	Mr. AJI GEORGE		
10	Year of construction	1998		
11	Applicant letter No.	Outdoor diary no 3566 dated 06-07-2023		
S. No.	Minimum standards on Fire Prevention and Fire Safety U/R 33	As per old noc requirements	Provided at Site	Remarks MR/NMR
1	Access to Building.			
	• Road width	Required	06 mtr	MR
	• Gate width	Required	4.5mtr	MR
	• Width of internal road	-NA-	-NA-	-NA-
2	Number, width, type & arrangement of exits.			
	a) Number of Staircase			
	➤ Upper floors.	Required	03 Nos	MR
	➤ Basement floor.	Required	03 Nos	MR
	b) Width of Staircase			
	➤ Upper floors	Required	1.35m x 2 & 1.31 m	MR
	➤ Basement floor	Required	1.35m x 2 & 1.31 m	MR
	c) Protection of exits			
	➤ Fire check door	-NA-	-NA-	-NA-
	➤ Pressurization	-NA-	-NA-	-NA-
	d) No. of continuous staircase to terrace	Required	03 Provided	MR
	e) Width of corridor	-NA-	-NA-	-NA-
	f) Door size	1m	Provided	MR
3	Compartmentation.			
	• Fire check door.	-NA-	-NA-	-NA-
	• Sealing of electrical shafts.	-NA-	-NA-	-NA-
	• Fire rating of shaft door.	-NA-	-NA-	-NA-
	• Water curtain	-NA-	-NA-	-NA-
	• Fire dampers.	-NA-	-NA-	-NA-
4.	Smoke Management system.			
	• Basement	30 ACPH	Exhaust fan provided	MR
	• Upper floors	12 ACPH	Natural ventilation	MR
5.	Fire Extinguishers.			
	• Total numbers	20 Nos	20 Nos	MR
	• Types	ABC / CO2	ABC & Co2	MR
	• ISI Marking	ISI mark	Provided	MR
6.	First Aid Hose Reels.			
	• Total numbers on each floor.	02 Nos	Provided	MR
	• Length of hose-reel hose.	30m	Provided	MR
	• Nozzle Diameter	5mm	Provided	MR
7	Automatic fire detection & alarming system.			
	• Type of detectors	-NA-	-NA-	-NA-

(Handwritten signature)

(Handwritten mark)

N/17

	<ul style="list-style-type: none"> • Location of Main Panel • Location of Repeater Panel • Alternate source of power • Hooter's location 	-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
8.	MOEFA	-NA-	NA	-NA-
9.	Public Address System	Required	Provided	MR
10.	Automatic Sprinkler System			
	<ul style="list-style-type: none"> • Basement 	Required	Provided	MR
	<ul style="list-style-type: none"> • Upper floors 	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> • Sprinkler above false ceiling 	-NA-	-NA-	-NA-
11.	Internal Hydrants.			
	<ul style="list-style-type: none"> • Size of Riser/Down-comer 	Required	100 mm	MR
	<ul style="list-style-type: none"> • Number of Hydrant per floor 	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> • Hose box. 	-NA-	-NA-	-NA-
12.	Yard Hydrants.			
	<ul style="list-style-type: none"> • Total number of hydrants. 	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> • Hose box. 	-NA-	-NA-	-NA-
13.	Pumping arrangements.			
	<ul style="list-style-type: none"> • Ground Level 			
	<ul style="list-style-type: none"> ➤ Discharge of main pump. 	NA	NA	NA
	<ul style="list-style-type: none"> ➤ Head of main pump. 	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> ➤ Number of main pumps. 	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> ➤ Jockey Pump output. 	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> ➤ Jockey Pump head. 	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> ➤ Standby Pump output. 	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> ➤ Standby Pump head. 	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> ➤ Auto Starting/Manual Stopping. 	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> ➤ Pump house access. 	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> • Terrace Level 			
	<ul style="list-style-type: none"> ➤ Discharge of pump. 	Old case	900 & 180 LPM	MR
	<ul style="list-style-type: none"> ➤ Head of pump. 	Old case	35m	MR
	<ul style="list-style-type: none"> ➤ Power supply. 	Required	Provided	MR
	<ul style="list-style-type: none"> ➤ Auto starting of pump. 	Required	Provided	MR
14.	Captive water storage for fire fighting.			
	<ul style="list-style-type: none"> • Underground tank capacity. 	50,000 ltr	50,000 ltr	MR
	<ul style="list-style-type: none"> ➤ Draw-off connection. 	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> ➤ Fire Service Inlet. 	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> ➤ Access to tank. 	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> • Overhead tank capacity. 	20,000 ltrs	20,000 ltrs	MR
15.	Exit Signage.	Required	Provided	MR
16.	Provision of Lifts.			
	<ul style="list-style-type: none"> • Pressurization of lift shaft. 	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> • Pressurization of lift lobby. 	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> • Communication in lift car. 	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> • Fireman's switch. 	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> • Lift signage. 	-NA-	-NA-	-NA-
17.	Standby Power Supply	-NA-	-NA-	-NA-
18.	Refuge Area			
	<ul style="list-style-type: none"> • Total area 	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> • Location 	-NA-	-NA-	-NA-

W

h


N/18


19.	Fire Control Room.			
	• Detector system panel.	-NA-	-NA-	-NA-
	• Flow switch panel.	-NA-	-NA-	-NA-
	• PA system panel.	-NA-	-NA-	-NA-
	• Battery backup.	-NA-	-NA-	-NA-
	• Building floor plan.	-NA-	-NA-	-NA-
20.	Special Fire Protection System for the Protection of special Risk, if any.	-NA-	-NA-	-NA-

The fire protection system provided in the building were randomly checked and found functional at the time of inspection.


Keeping in view of the deemed compliance of the minimum standard on fire prevention and fire safety measures as required under the rules, the FSC issued vide letter no F6/DPS/MS/School/2020/SZ/382 dated 29/09/2020, renewal under rule 37 of the Delhi Fire Service rules, 2010 is recommended.

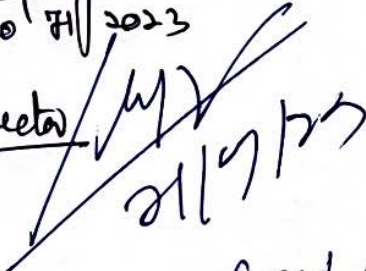
Accordingly, DFA is put up for approval and signature please.


Signature of the Inspection Officer
Name: Sh. Manoj Kumar Sharma
Design: DO (South)


Signature of the Inspecting Officer
Name: Sh. Rajesh Kumar
Design: ADO (BCP)

CFO (HQ)

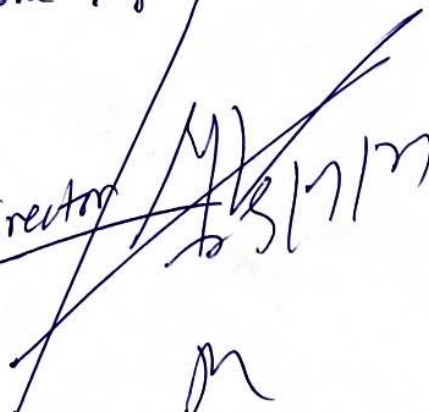

20/11/2023

~~Director~~ 
21/11/23

~~ADP~~

As approved, F-1. letter is put up for
your signature pl


25/11/23

~~Director~~ 
23/11/23