

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEAD QUARTERS : DELHI FIRE SERVICE : NEW DELHI - 110001**

No.F6/DFS/MS/2023/ School/ 543

Dated: 09/08/2023

FIRE SAFETY CERTIFICATE

Certified that the **Guru Harkrishan Public School**, located at **Near Gurudwara Road, Karol Bagh, New Delhi** is comprised of **Basement + Ground + 03 upper floor**, was inspected by the officer concerned of this department on 28-07-2023 in the presence of **Sh. Jasvinder Kaur** and found that the said school building has complied with the fire prevention and fire safety requirements in accordance with a circular of Director of Education 2011 and that the premises is fit for occupancy of class "**Group B "Educational Building"**" with effect from **09/08/2023** for a period of **three years** in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010 on the conditions printed below.

Issued on **09/08/2023** at New Delhi by.


(Atul Garg)
DIRECTOR
Delhi Fire Service

Copy to:-

1. The Commissioner, MCD, Civic Center, New Delhi.
2. Director of Education, Govt. of NCT, Delhi. Old Secretariat, New Delhi.
3. The Principal, Guru Harkrishan Public School, Near Gurudwara Road, Karol Bagh, New Delhi.

Condition for the validity of Fire Safety Certificate

1. All the fire safety arrangements provided there in shall be maintained in good working condition at all time. .
2. Any loss of life or property due to non-functional fire safety measures shall be at the responsibility of the management.
3. The trained fire fighting staff should be available round the clock.
4. The compliance with regards to electrical installation, structural stability, set back area, occupancy and any deviation in construction etc. shall be verified from authority concerned. Basement shall strictly be used as per concerned BBL
5. This fire safety certificate may not be treated in any case for regularization of unauthorized construction, if any.
6. The owner / occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on www.dfs.delhigovt.nic.in
7. The means of escape shall be kept unobstructed / unlocked for unhindered evacuation in case of an emergency.
8. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in form 'J' [sub rule (I) of rule 37] along with a copy of this Certificate, six month prior to its expiry.
9. Any flammable material for interior decoration is prohibited.

INSPECTION REPORT

1. Name & address of the building:- Guru Harkrishan Public School, Near Gurudwara Road, Karol Bagh, New Delhi. Educational Building, B + Gr. + 3 Floor
2. Type of occupancy:- New
3. Type of case:- N/A
4. Details of previous FSC:- F.16/Estate/CC/Fire safety/20113298 to3398 dated 01.03.11(Dir. of education Circular)
5. Fire safety directives No.- 28/07/23
6. Date of inspection:- Sh. Ravinder Singh (ADO/CC)
7. Name of the inspecting officer:- Sh. Jasvinder Kaur
8. Name & designation of officer From the building side:- 1977
9. Year of construction:- E-mail < ghpskb@dsgmc.in > dated 19.07.2023
10. Applicant's letter No:-

S.No.	Minimum Standards on fire Prevention and fire safety U/R 33	Requirement Exiting	Provided at site	Remarks MR/NMR
1.	Access to Building			
	1) Road width	06 mtr.	09 mtr.	MR
	2) Gate width	05 mtr.	05 mtr.	MR
	3) Width of internal road	N/A	N/A	N/A
2.	Number, Width Type & Arrangement of Exits			
	A. Number of staircases			
	1. Upper floors	02	02	MR
	2. Basements	02	02	MR ✓
	B. Width of staircase			
	1. Upper floors	1.5 mtr.	1.2 m & 1.0 m	MR
	2. Basements	1.5 mtr.	1.2 mtr. & .75	MR ✓
	C. Protection of exits			
	1. Fire check door	N/A	N/A	N/A
	2. Pressurization	N/A	N/A	N/A
	D. No. of continuous staircase to terrace	02	02	MR
	E. Width of corridor	NA	NA	NA
	F. Door size	1.0 mtr.	1.0 mtr	MR
3.	Compartmentation			
	1) Fire check door	N/A	N/A	N/A
	2) Sealing of electrical shafts	N/A	N/A	N/A
	3) Fire rating of shaft door	N/A	N/A	N/A
	4) Water curtain	N/A	N/A	N/A
	5) Fire Dampers	N/A	N/A	N/A
4.	Smoke Management System			
	1) Basements	12 ACPH	Provided	MR ✓
	2) Upper floors	12 ACPH	Natural	MR
5.	Fire Extinguishers			
	1) Total numbers	16 Nos.	16 Nos.	MR ✓
	2) Types	ABC & CO2	ABC, CO2 & W.CO2	MR
	3) ISI marking	Required	Provided	MR
6.	First-Aid Hose Reel			

✓ 6 ✓

N/G

	1) Total number of each floor	02	02	MR
	2) Length of hose reel hose	30 mtr.	Provided	MR
	3) Nozzle diameter	05 mm	Provided	MR
7.	Automatic Fire Detection & Alarming System			
	1) Type of detectors	N/A	N/A	N/A
	2) Location of main panel	N/A	N/A	N/A
	3) Location of repeater panel	N/A	N/A	N/A
	4) Alternate source of power	N/A	N/A	N/A
	5) Hooter's Location	N/A	N/A	N/A
8.	MOEFA	Required	Provided	MR
9.	Public Address System	N/A	N/A	N/A
10.	Automatic Sprinkler System			
	1) Basement (less than 200 m2)	N/A	N/A	N/A /
	2) Upper floors	N/A	N/A	N/A
	3) Sprinkler above false ceiling	N/A	N/A	N/A
11.	Internal Hydrants			
	1) Size of riser/down-comer	N/A	N/A	N/A
	2) Number of hydrants per floor	N/A	N/A	N/A
	3) Hose box	N/A	N/A	N/A
12.	Yard Hydrants			
	1) Total number of hydrants	N/A	N/A	N/A
	2) Hose box	N/A	N/A	N/A
13.	Pumping Arrangement			
	2) Ground level	N/A	N/A	N/A
	a) Discharge of main pump	N/A	N/A	N/A
	b) Head of main pump	N/A	N/A	N/A
	c) Number of main pump	N/A	N/A	N/A
	d) Jockey pump out put	N/A	N/A	N/A
	e) Jockey pump head	N/A	N/A	N/A
	f) Stand by pump output	N/A	N/A	N/A
	g) Stand by pump head	N/A	N/A	N/A
	h) Auto starting/Manual stopping	N/A	N/A	N/A
	3) Terrace level			
	a) Discharge of pump	450LPM	450LPM	MR /
	b) Head of pump	40 mtr.	40 mtr.	MR
	c) Power supply	Required	Provided	MR
	d) Auto starting of pump	Required	Provided	MR
14.	Captive Water Storage for Fire Fighting			
	1) Under ground tank capacity	N/A	N/A	N/A
	a) Draw-off connection	N/A	N/A	N/A


(Handwritten marks)

	b) Fire service inlet	N/A	N/A	N/A
	c) Access to tank	N/A	N/A	N/A
	d) Over head tank capacity	10,000 ltr.	10,000 ltr.	MR
15.	Exit Signage.	Required	Provided	MR
16.	Provision of Lifts.			
	a) Pressurization of lift shaft	N/A	N/A	N/A
	b) Pressurization of lift lobby	N/A	N/A	N/A
	c) Communication in lift car	N/A	N/A	N/A
	d) Fireman's switch	N/A	N/A	N/A
	e) Lift signage	N/A	N/A	N/A
17.	Stand by Power Supply	Required	Provided	MR
18.	Refuge Area	N/A	N/A	N/A
	Total area location	N/A	N/A	N/A
19.	Fire Control Room	N/A	N/A	N/A
	a) Detector system panel	N/A	N/A	N/A
	b) Flow switch panel	N/A	N/A	N/A
	c) PA system panel	N/A	N/A	N/A
	d) Battery backup	N/A	N/A	N/A
	e) Building floor plan	N/A	N/A	N/A
20.	Special Fire Protection System for Protection of special Risk, if any:			N/A

The fire protection system provided in the school building were tested, checked at random and found functional at the time of inspection.


In view of the substantial compliance of the minimum standards of fire prevention and fire safety measures as required under the rules, if agreed, we may issue the FSC to said school. Accordingly, DFA is prepared and put up for kind perusal and sig. please.


Signature of the Inspecting Officer

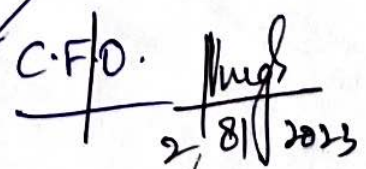


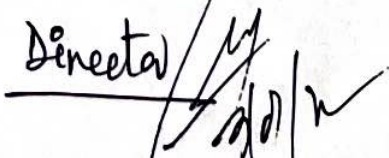
Name :- Ravinder Singh
Designation :- ADO (CC)


1/8/23


Dy. C.O. (AD2)


02/08/23

C.F/O. 
2/8/2023


Director

