

C 70

FORM 'H'  
FORM FOR ISSUING FIRE SAFETY CERTIFICATE  
[Refer sub - rule (1) of rule 35]  
GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI  
HEAD QUARTERS: DELHI FIRE SERVICE, CONNAUGHT PLACE  
NEW DELHI

No. F6/DFS/MS/SZ/2023 /School/ 578

Dated: 24/08/2023

**FIRE SAFETY CERTIFICATE**

Certified that the building of The Indian Heights School Located at Sector - 23, Dwarka, New Delhi - 110075, running at Ground+3 UFs in a building comprised of Basement, Ground+3 UFs was issued Fire Safety Certificate vide letter No. F6/DFS/MS/School/2020/SZ/110, dated 12/03/2020. The premises was re inspected by the officer concerned of this department on 17/08/2023 in the presence of Mr. Ravinder Puri (Admin Officer) All the fire prevention and fire safety arrangements provided in the premises found in good working condition. The premises have therefore deem complied with the fire prevention and fire safety requirements in accordance with DOE 3298-3398 dated 1-3-2011 issued by the Director of Education and that the building/ premises is fit for occupancy class "Educational" with effect from 24/08/2023 for a period of three years in accordance with Rule 36 unless renewed under Rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010.

Issued on 24/08/2023 at New Delhi by.

  
(Atul Garg)  
Director  
Delhi Fire Service.

ok  
24/8/23  
123

Copy to:

1. The Principal, The Indian Heights School Sector - 23, Dwarka, New Delhi - 110075.
2. Directorate of Education Old Secretariat Delhi - 110054.

**Following fire safety directives must be adhered to:-**

1. **Basement shall not be used for any purpose.**
2. All the fire safety arrangements provided therein shall be maintained in good working condition at all times.
3. Any loss of life or property due to non-functional fire safety measures shall be at the risk and responsibility of the management.
4. The trained staff should be available round the clock.
5. Any deviations w.r.t. construction shall be verified by the concerned building sanctioning agency.
6. The certificate may not be treated in any case for the regularization of the unauthorized construction, if any.
7. The owner/ occupier shall apply for renewal of this Fire Safety Certificate to the Director in Form 'J' [sub rule (1) of rule 37] along with a copy of this certificate, six months prior to its expiry.
8. The owner/occupier shall submit a declaration every year in the form 'K' provided in the first schedule of Delhi Fire Service Rules 2010, form is available on [www.dfs.delhi.gov.in](http://www.dfs.delhi.gov.in)

N/23

**INSPECTION REPORT**

1. Name & address of the building: The Indian Heights School Located at Sector - 23, Dwarka, New Delhi - 110075.
2. Type of Occupancy : Educational (Basement + Ground+ 3 Upper Floors & School running at G+3 UFs.)
3. Type of Case : Renewal
4. Details of previous NOC : F6/DFS/MS/School/2020/SZ/110, dated 12/03/20
5. Fire Safety directives Letter No. : 3298-3398 dated 01/03/2011
6. Date of inspection : 17/08/2023
7. Name of the Inspecting Officer : Sh. Udai vir singh, ADO (DWK)
8. Name and designation of Officer  
from the building side: Mr. Ravinder Puri (Admin Officer)
9. Year of Construction : 2007
10. Applicant's letter No. : Email dated 16/08/2023

S No	Minimum standards on fire prevention and fire safety U/R 33	As per N/12, N/13 & N/14	Provided at site	Remarks MR/NMR
1.	Access of building			
	• Road width	06 mtr	Provided	MR
	• Gate width	4.5 mtr	Provided	MR
	• Width of internal road	NA	NA	NA
2.	Number, width, Type & Arrangements of exits			
	a. Number of staircases	04 Nos.	Provided	MR
	• Upper floors	NA	Basement is closed	NA
	• Basements			
	b. Width of staircases	1.5 mtr each	Provided	MR
	• Upper floors	NA	Basement is closed	NA
	• Basements			
	c. Protection of exits	NA	NA	NA
	• Fire check door	NA	NA	NA
	• Pressurization	Required	Provided	MR
	d. No of continuous staircase to terrace	NA	2.5 mtr	NA
	e. Width Of Corridor	01 mtr	Provided	MR
	f. Door Size			
3.	Compartmentation			
	• Fire check door	NA	NA	NA
	• Sealing of electrical shafts	NA	NA	NA
	• Fire Rating of shaft door	NA	NA	NA
	• Water Curtain	NA	NA	NA
	• Fire Dampers	NA	NA	NA
4.	Smoke managements System			
	• Basements	NA	Basement is closed	NA
	• Upper floors	12 a/c charge	Natural ventilation	MR

J. L.

224


5.	Fire Extinguishers			
	• Total numbers	26 nos.	Provided	MR
	• Types	ABC & CO <sub>2</sub>	ABC & CO <sub>2</sub>	MR
	• IS marking	ISI marked	ISI marked	MR
6.	First – Aid Hose Reels			
	• Total numbers on each floor	03 Nos.	Provided	MR
		30 mtr	Provided	MR
	• Length of hose reel hose	05 mm	Provided	MR
	• Nozzle diameter			
7.	Automatic fire detection and alarming system			
	• Type of detectors	NA	NA	NA
	• Location of Main Panel	NA	NA	NA
	• Location of Repeater Panel	NA	NA	NA
	• Alternate source of power	NA	NA	NA
	• Hooters' Location	NA	NA	NA
8.	MOEFA	NA	NA	NA
9.	Public Address System	NA	Provided	NA
10.	Automatic Sprinkler System			NA
	• Basements	NA	Basement is closed	NA
	• Upper Floor	NA	NA	NA
	• Sprinkler above false ceiling	NA	NA	NA
11.	Internal Hydrants:			MR
	• Size of riser/down-comer	Required	Provided	
	• Number of hydrants per floor	03 Nos.	03 Nos.	MR
	• Hose Box	Required	Provided	MR
12.	Yard Hydrants			NA
	• Total number of hydrants	NA	NA	NA
	• Hose Box	NA	NA	NA
13.	Pumping Arrangements:			
	• Ground Level	NA	NA	NA
	• Discharge of main pump	NA	NA	NA
	➤ Head of main pump	NA	NA	NA
	➤ Number of main pumps	NA	NA	NA
	➤ Jockey pump out put	NA	NA	NA
	➤ Jockey pump head	NA	NA	NA
	➤ Standby Pump out put	NA	NA	NA
	➤ Standby Pump Head	NA	NA	NA
	➤ Auto starting/Manual stopping	NA	NA	NA
	➤ Pump House Access	NA	NA	NA
	• Terrace level			
	➤ Discharge of pump	2x450 lpm	900 lpm & 180 lpm	MR
	➤ Head of the pump	40 mtr	Provided	MR
	➤ Power supply	Required	Provided	MR
	➤ Auto starting of pump	Required	Provided	MR
14.	Captive water Storage for fire fighting:			
	• Under ground tank capacity	NA	50,000 ltr	NA
		NA	NA	NA
	➤ Draw off connection	NA	NA	NA
	➤ Fire service inlet	NA	NA	NA
	➤ Access to tank	15,000 ltr	Provided	MR
	• Overhead Tank capacity			



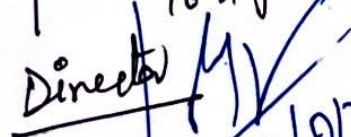

224

15	Exit Signage	Required	Provided	MR
16.	Provision of Lifts			
	➤ Pressurization of Lift Shaft	NA	NA	NA
	➤ Pressurization of lift lobby	NA	NA	NA
	➤ Communication in lift Car	Required	Provided	MR
	➤ Fireman's Grounding Switch	Required	Provided	MR
	➤ Lift Signage	Required	Provided	MR
17.	Standby power supply	Required	DG Set	MR
18.	Refuge Area			
	➤ Total area	NA	NA	NA
	➤ Location	NA	NA	NA
19.	Fire control room			
	➤ Detector system panel	NA	NA	NA
	➤ Flow Switch Panel	NA	NA	NA
	➤ PA System Panel	NA	NA	NA
	➤ Battery backup	NA	NA	NA
	➤ Building Floor Plans	NA	NA	NA
20.	Special Fire Protection Systems for Protection of special Risks, if any;	Required	CO2 & ABC, Fire extinguisher provided near electric panel	MR

The fire protection systems provided in the building were test checked and found functional at the time of inspection.

In view of the deemed compliance of minimum standards on fire prevention and fire safety as required under the rules the NOC issued vide letter F6/DFS/MS/School/2020/SZ/110, dated 12/03/2020 renewal under Rule 37 of the Delhi Fire Service Rules 2010 is recommended

  
 Sign of Inspecting Officer  
 Name Uday Kumar  
 Designation AO/DOA

  
  
 CFO (S2)  
  
 Director  
  
 AO/DOA