

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEAD QUARTERS: DELHI FIRE SERVICE: NEW DELHI-110001

No. F6/DFS/MS/EH/SZ/2023/ 414

Dated: 28/08/2023

FIRE SAFETY CERTIFICATE

Certified that the M/s. Utsav Sthal (Temporary), Sector- 10, Dwarka, New Delhi., running at Ground floor only, owned/occupied by DDA, have complied with the fire prevention and fire safety requirements in accordance with Rule 33 of the Delhi Fire Service Rules, 2010 and verified by the officers concerned of Delhi Fire Service on 28.08.2023 in presence of Sh. Pankaj Kumar (AE DDA) and the building/premises is fit for occupancy class Assembly, Utsav Sthal (Temporary) at Ground floor Only with effect from 28/08/2023 for a period of three years in accordance with Rule 36 unless renewed under Rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under Rule 38 of the Delhi Fire Service Rules 2010, printed below.

Issued on 28/08/2023 at New Delhi by.


(Anil Garg)
Director
Delhi Fire Service


Copy to:-

1. Executive Engineer (E), DDA, Electrical Division-5, Sector- 5, Central Nursery, Dwarka, New Delhi- 110075.

Conditions for the validity of Fire Safety Certificate: -

1. **The FSC shall be null & void, if the sprinkler system in whole Utsav Sathal is not be done within eight months.**
2. All the fire safety arrangements provided therein shall be maintained in good working conditions at all times.
3. Any loss of life or property due to non-functional of fire safety measures shall be at the risk & responsibility of the management.
4. The trained firefighting staffs should be available round the clock.
5. Any deviation w.r.t. construction etc. shall be verified by the concerned building sanctioning authority.
6. This fire safety certificate may not be treated in any case for regularization of unauthorized construction, if any.
7. All the means of escapes /exits shall not be locked/bolted/blocked at any time for safe evacuation of the occupants in case of any emergency.
8. The owner / occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on www.dfs.delhigovt.nic.in
9. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in Form "J" [sub rule (1) of rule 37] along with a copy of this certificate, six months prior to its expiry. The form is available on www.dfs.delhigovt.nic.in

N/13

INSPECTION REPORT

1. Name & address of the building : M/s. Utsav Sthal (Temporary), Sector- 10, Dwarka, New Delhi.
2. Type of Occupancy : Assembly
3. Building Composition : **Utsav Sthal (at ground floor).**
(Utility building ground plus one upper floor.)
4. Type of Case : New Case
5. Details of previous NOC : N/A
6. Fire Safety directives letter No : F6/DFS/MS/BP/2021/1636 dated 18.08.2021
7. Date of inspection : 28.08.2023
8. Name of the Inspecting Officers : Vedpal Chhikara, DO (SW) & Udai Vir Singh, ADO (DWK)
9. Name and designation of officers from the building side : Sh. Pankaj (AE DDA)
9. Year of Construction : 2021
10. Applicant's letter No. : Ex. Engr./Elec. Div-5/DDA/W-42/495 dated 26.08.2023

S. No.	Minimum Standards on fire prevention and fire safety U/R 33	Requirement as per NBC/UBBL	Provided at site	Remarks MR/NMR
1	Access to building			
	• Road width	06 mts	Provided	MR
	• Gate width	5.0 mts	5.0 mts.	MR
	• Width of internal road	N/A	Provided as per plan	N/A
2	Number, Width, Type & Arrangement of Exits			
	a. Number of staircases	-	-	-
	• Upper Floors	N/A	02 nos.(in utility building)	N/A
	• Basements	N/A	N/A	N/A
	b. Width of staircases	-	-	-
	• Upper Floors	N/A	2x 1.5m(in utility building)	N/A
	• Basements	N/A	N/A	N/A
	c. Protection of exits	-	-	-
	• Fire check door	N/A	N/A	N/A
	• Pressurization	N/A	N/A	N/A
	e. No. of continuous staircases to terrace	N/A	N/A	N/A
	g. Width of Corridor	N/A	N/A	N/A
	h. Door Size	2.0 & 1.5 mts	All side Open	MR
3	Compartmentation.			
	• Fire check door	N/A	N/A	N/A
	• Sealing of electrical shafts	N/A	N/A	N/A
	• Fire Rating of shaft door	N/A	N/A	N/A
	• Water Curtain	N/A	N/A	N/A
	• Fire Dampers	N/A	N/A	N/A
4	Smoke Management System.			
	• Basements	30 a/c per hour	N/A	N/A
	• Upper floors	12 a/c per hour	Natural ventilation	MR
5	Fire Extinguishers			
	• Total numbers	10	Provided	MR
	• Types	CO ₂ , ABC type	Provided	MR
	• IS marking	ISI marked	Provided	MR
6	First-Aid Hose Reels.			

J.P. W

	<ul style="list-style-type: none"> Total numbers on each floor Length of hose reel hose Nozzle diameter 	01 30 m 5 mm	Provided Provided Provided	MR MR MR
7	Automatic fire detection and alarming system.			
	<ul style="list-style-type: none"> Type of detectors Location of Main Panel Location of Repeater Panel Alternate source of power Hooters' Location 	N/A N/A N/A N/A N/A	N/A N/A N/A N/A N/A	N/A N/A N/A N/A N/A
8	MOEFA	Required	Provided	MR
9	Public Address System.	N/A	N/A	N/A
10	Automatic Sprinkler System.			
	<ul style="list-style-type: none"> Basement Entire pandal Sprinkler above false ceiling 	N/A Required N/A	N/A Undertaking given N/A	N/A ... N/A
11	Internal Hydrants			
	<ul style="list-style-type: none"> Size of riser/down-comer Number of hydrants per floor Hose Box 	01 01 01	Provided Provided Provided	MR MR MR
12	Yard Hydrants.			
	<ul style="list-style-type: none"> Total number of hydrants Hose Box 	N/A N/A	N/A N/A	N/A N/A
13	Pumping Arrangements.			
	<ul style="list-style-type: none"> Ground Level <ul style="list-style-type: none"> Discharge of main Pump Head of Main pump Number of main pumps Jockey Pump out put Jockey pump head Standby Pump out put Standby Pump Head Auto Starting/ Manual stopping Pump House Access Terrace level <ul style="list-style-type: none"> Discharge of pump Head of the pump Power Supply Auto Starting of pump 	--- N/A N/A N/A N/A N/A N/A N/A N/A N/A N/A N/A 900 LPM 40 mts Required Required	--- N/A N/A N/A N/A N/A N/A N/A N/A N/A N/A N/A 2x 450 lpm Provided Provided Provided Provided	--- N/A N/A N/A N/A N/A N/A N/A N/A N/A N/A N/A MR MR MR MR
14	Captive Water Storage for fire fighting.			
	<ul style="list-style-type: none"> Underground tank capacity Draw-off connection Fire service inlet Access to tank Overhead Tank capacity 	N/A N/A N/A N/A 25000 lts	N/A N/A N/A N/A Provided	N/A N/A N/A N/A MR
15	Exit Signage.	Required	Provided	MR MR

Handwritten signature and initials


16	Provision of Lifts.			
	• Pressurization of Lift Shaft	N/A	N/A	N/A
	• Pressurization of Lift lobby	N/A	N/A	N/A
	• Communication In lift Car	N/A	N/A	N/A
	• Fireman's Grounding Switch	N/A	N/A	N/A
	• Lift Signage	N/A	N/A	N/A
17	Standby power supply	Required	Provided	MR
18	Refuge Area.			
	➤ Total Area	N/A	N/A	N/A
	➤ Location	N/A	N/A	N/A
19	Fire Control Room			
	• Detector System Panel	N/A	N/A	N/A
	• Flow Switch Panel	N/A	N/A	N/A
	• PA System Panel	N/A	N/A	N/A
	• Batter backup	N/A	N/A	N/A
	• Building Floor Plans	N/A	N/A	N/A
20	Special Fire Protection Systems for Protection of special Risks, if any:	Required	Two ABC type fire extinguisher found provided near elect. panel	MR

The fire protection systems provided in the building were test/checked at random and found satisfactory at the time of inspection.

If agreed in view the substantial compliance of the minimum standards on fire prevention and fire safety required under the Rules, it is recommended to grant fire safety certificate under Rule 35 of Delhi Fire Service Act- 2007 & Rules- 2010.

Accordingly, DFA is put up for approval & signature please.


Note:- Vide letter No. Ex. Engr./Elec. Div-5/DDA/W-42/495 dated 26.08.2023, EE DDA undertake that the sprinkler system in whole Utsav Sathal shall be done within eight months and further he also certified that whole the structure is made of fire retardant/non-flammable material.



Signature of the Inspecting Officer
Name- Vedpal Chhikara
Divisional Officer (SW)



Signature of the Inspecting Officer
Name- Udai Vir Singh
Asstt. Div. Officer (S.Rd)

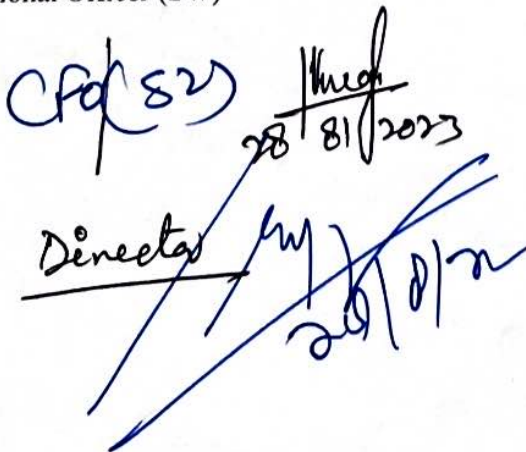
CFD/S2
28/8/2023
Director
28/8/23
