



GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI  
HEADQUARTERS: DELHI FIRE SERVICE: NEW DELHI- 110001

C-47



No. F6/DFS/MS/2023/School/ 603

Dated: 31/08/2023

**FIRE SAFETY CERTIFICATE**

Certified that the **Mata Sukhdevi Public School** located at **G.T. Karnal Road, Nangli Poona, Delhi-110036** comprised of 02 blocks, Ground + 02 upper floor & Ground + first floor-interconnected owned/ occupied by **Mata Sukhdevi Public School** was issued Fire Safety Certificated vide this office letter no. **F6/DFS/MS/2020/School/118 dated 17.03.2020**. have complied with the fire prevention and safety requirements in accordance with rule 33 of Delhi Fire Service Rules, 2010 and verified by the officer concerned of Fire Service on **23.08.2023** in the presence of **Mr. Vishwanath (Admin)** and observed that all the fire safety arrangements as provided in the premises found in good working condition. The premises have complied with requirements of circular issued by Director of Education vide letter no 3298-3398 dated 01.03.2011 and the building/ premise is fit for occupancy class '**Group B Educational**' for **ground & first floor only** with effect from **31/08/2023**.... for a period of **Valid up to 31.03.2026**, subject to compliance of the conditions mentioned below:

Issued on **31/08/2023**..... at New Delhi

  
(Atul Garg)  
Director  
Ph:-011-23414000  
o/c

Copy to: -

1. The Director, Education, Government of N.C.T of Delhi. Old Sectt. Delhi - 110054.
2. The Principal, Mata Sukhdevi Public School located at G.T. Karnal Road, Nangli Poona, Delhi-110036.

**Conditions for the validity of Fire Safety Certificate:**

1. All the means of escape/entry/exit shall be kept free from any obstruction.
2. All the fire safety arrangements provided therein shall be maintained in good working condition at all time as seen during inspection.
3. Any loss of life or property due to non-functional fire safety measures shall be at the responsibility of the management.
4. All the staff members must know the correct method of operation of firefighting system.
5. The owner / occupier shall submit a declaration **every year** in **Form "K"** provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on <http://delhi.gov.in/wps/wcm/connect/doiit/fire/FIRE/Home/Forms>.
6. This fire safety certificate may not in any way be treated as regularization (Clause 2.8 of UBBL-2016) of unauthorized construction or Alteration (Clause 1.4.3 of UBBL-2016), if any.
7. "The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in **Form 'J'** [sub rule (1) of rule 37] along with a copy of this Certificate, **six months** prior to its expiry".

**INSPECTION REPORT**

1. Name & address of the building : Mata Sukhdevi Public School located at G.T.K. Road, Nangli Poona, Delhi-36.
2. Type of Occupancy : Educational
3. Type of Case : Renewal
4. Composition of building : 02 blocks- Ground + 02 upper floors & G+first floor-interconnected but school is running at Ground & first floor only
5. Details of previous NOC : F6/DFS/MS/2020/School/118 dated 17.03.2020
6. Fire Safety directives letter No : Nil
7. Date of inspection : 23.08.2023
8. Name of the Inspecting Officers : ADO (RN)
9. Name and designation of officers from the building side : Mr. Vishwanath Yadav (Admin)
10. Year of Construction : 2009/2016
11. Applicant's letter No. : Letter No-1267 dated 16.8.2023

	Minimum Standards on fire prevention and fire safety U/R 33	Requirement as per Rule 35 (6)	Provided at site	Remarks MR/NMR
1	<b>Access to building</b>			
	• Road width	Accessible	Accessible	MR
	• Gate width	Accessible	Accessible	MR
	• Width of internal road	NA	NA	NA
2	<b>Number, Width, Type &amp; Arrangement of Exits</b>			
	<b>a. Number of staircases</b>			
	• Upper Floors	02	04	MR
	• Basements	NA	NA	NA
	<b>b. Width of staircases</b>			
	• Upper Floors	1.50m	1.50m (iron staircase G to first), 1.50m, 1.35m & 1.00m	MR
	• Basements	NA	NA	NA
	<b>c. Protection of exits</b>			
	• Fire check door	NA	NA	NA
	• Pressurization	NA	NA	NA
	d. No. of continuous staircases to terrace	NA	NA	NA
	e. Width of Corridor	NA	NA	NA
f. Door Size	1 m	1m	MR	
3	<b>Compartmentation.</b>			
	• Fire check door	NA	NA	NA
	• Sealing of electrical shafts	NA	NA	NA
	• Fire Rating of shaft door	NA	NA	NA
	• Water Curtain	NA	NA	NA
	• Fire Dampers	NA	NA	NA
4	<b>Smoke Management System.</b>			
	• Basements	NA	NA	NA
	• Upper floors	Required	Provided	MR
5	<b>Fire Extinguishers</b>			
	• Total numbers	10nos	20nos	MR

✍

✍

N/21


	<ul style="list-style-type: none"> <li>Types</li> <li>ISI marking</li> </ul>	ABC	ABC	MR
		ISI Marked	Yes	MR
6	<b>First-Aid Hose Reels.</b>	01	01	MR
	<ul style="list-style-type: none"> <li>Total numbers on each floor</li> </ul>	30m	30m	MR
	<ul style="list-style-type: none"> <li>Length of hose reel hose</li> </ul>	5mm	5mm	MR
	<ul style="list-style-type: none"> <li>Nozzle diameter</li> </ul>			
7	<b>Automatic fire detection and alarming system.</b>	NA	NA	NA
	<ul style="list-style-type: none"> <li>Type of detectors</li> </ul>	NA	NA	NA
	<ul style="list-style-type: none"> <li>Location of Main Panel</li> </ul>	NA	NA	NA
	<ul style="list-style-type: none"> <li>Location of Repeater Panel</li> </ul>	NA	NA	NA
	<ul style="list-style-type: none"> <li>Alternate source of power</li> </ul>	NA	NA	NA
	<ul style="list-style-type: none"> <li>Hooters' Location</li> </ul>	NA	NA	NA
8	<b>MOEFA</b>	NA	NA	NA
9	<b>Public Address System.</b>			
10	<b>Automatic Sprinkler System.</b>	NA	NA	NA
	<ul style="list-style-type: none"> <li>Basement</li> </ul>	NA	NA	NA
	<ul style="list-style-type: none"> <li>Upper Floor</li> </ul>	NA	NA	NA
	<ul style="list-style-type: none"> <li>Sprinkler above false ceiling</li> </ul>			
11	<b>Internal Hydrants</b>	NA	NA	NA
	<ul style="list-style-type: none"> <li>Size of riser/down-comer</li> </ul>	NA	NA	NA
	<ul style="list-style-type: none"> <li>Number of hydrants per floor</li> </ul>	NA	NA	NA
	<ul style="list-style-type: none"> <li>Hose Box</li> </ul>			
12	<b>Yard Hydrants.</b>	NA	NA	NA
	<ul style="list-style-type: none"> <li>Total number of hydrants</li> </ul>	NA	NA	NA
	<ul style="list-style-type: none"> <li>Hose Box</li> </ul>			
13	<b>Pumping Arrangements.</b>			
	<ul style="list-style-type: none"> <li>Ground Level</li> </ul>	N/A	N/A	N/A
	<ul style="list-style-type: none"> <li>➤ Discharge of main Pump</li> </ul>	N/A	N/A	N/A
	<ul style="list-style-type: none"> <li>➤ Head of Main pump</li> </ul>	N/A	N/A	N/A
	<ul style="list-style-type: none"> <li>➤ Number of main pumps</li> </ul>	N/A	N/A	N/A
	<ul style="list-style-type: none"> <li>➤ Jockey Pump out put</li> </ul>	N/A	N/A	N/A
	<ul style="list-style-type: none"> <li>➤ Jockey pump head</li> </ul>	N/A	N/A	N/A
	<ul style="list-style-type: none"> <li>➤ Standby Pump out put</li> </ul>	N/A	N/A	N/A
	<ul style="list-style-type: none"> <li>➤ Standby Pump Head</li> </ul>	N/A	N/A	N/A
	<ul style="list-style-type: none"> <li>➤ Auto Starting/ Manual stopping</li> </ul>	N/A	N/A	N/A
	<ul style="list-style-type: none"> <li>➤ Pump House Access</li> </ul>			
	<ul style="list-style-type: none"> <li>Terrace level</li> </ul>			
	<ul style="list-style-type: none"> <li>➤ Discharge of pump</li> </ul>	450 lpm	Provided	MR
	<ul style="list-style-type: none"> <li>➤ Head of the pump</li> </ul>	40m	Provided	MR
<ul style="list-style-type: none"> <li>➤ Power Supply</li> </ul>	Required	Provided	MR	
<ul style="list-style-type: none"> <li>➤ Auto Starting of pump</li> </ul>	Required	Provided	MR	
14	<b>Captive Water Storage for fire fighting.</b>			
	<ul style="list-style-type: none"> <li>Underground tank capacity</li> </ul>	NA	NA	NA
	<ul style="list-style-type: none"> <li>➤ Draw-off connection</li> </ul>	NA	NA	NA
	<ul style="list-style-type: none"> <li>➤ Fire service inlet</li> </ul>	NA	NA	NA
	<ul style="list-style-type: none"> <li>➤ Access to tank</li> </ul>	NA	NA	NA
	<ul style="list-style-type: none"> <li>Overhead Tank capacity</li> </ul>	10,000 ltrs	10,000 ltr.	MR

MR  
MR  
MR

		Required	Provided	MR
15	Exit Signage.			
16	Provision of Lifts.			
	• Pressurization of Lift Shaft	N/A	N/A	N/A
	• Pressurization of Lift lobby	N/A	N/A	N/A
	• Communication In lift Car	N/A	N/A	N/A
	• Fireman's Grounding Switch	N/A	N/A	N/A
	• Lift Signage	N/A	N/A	N/A
17	Standby power supply	N/A	N/A	N/A
18	Refuge Area.			
	➤ Total Area	N/A	N/A	N/A
	➤ Location	N/A	N/A	N/A
19	Fire Control Room			
	• Detector System Panel	N/A	N/A	N/A
	• Flow Switch Panel	N/A	N/A	N/A
	• PA System Panel	N/A	N/A	N/A
	• Batter backup	N/A	N/A	N/A
	• Building Floor Plans	N/A	N/A	N/A
20	Special Fire Protection Systems for Protection of special Risks, if any:	N/A	N/A	N/A


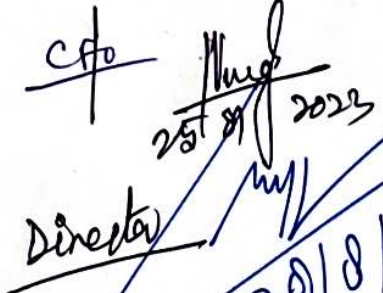


The fire protection systems provided in the building were tested/ checked randomly and found in good working condition, at the time of inspection.

Keeping in view the satisfactory compliance of the minimum standards on fire prevention and fire safety required as stipulated in director of education Circular dated 01.03.2011, it is recommended to renewal of fire safety certificate issued vide this department letter of even no. F6/DFS/MS/2020/School/118 dated 17.03.2020.

  
 Signature of the Inspecting Officer  
 Name :- C.L. Meena  
 Designation:- ADO/RN

M.K. Chattopadhyay  
 Dy. Chief Fire Officer (NWD)

01... 65  
 dated... 24/8/2023

  
 C.F.O.  
  
 Director  
 25/8/2023  
  
 20/8/22  
  
 Any other

Conf. P.T.O.