

211

FORM 'H'
FORM FOR ISSUING FIRE SAFETY CERTIFICATE
[Refer sub - rule (1) of rule 35]
GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEAD QUARTERS: DELHI FIRE SERVICE, CONNAUGHT PLACE
NEW DELHI


No.F-6/DFS/MS/SZ/2023/EH/299

Dated: 29/09/2023

FIRE SAFETY CERTIFICATE

Certified that the M/s Guruprasad Udipi Restaurant Located at 10204, Ground Floor, Block S, Ward No. 16, Padam Singh Road, Karol Bagh, Delhi 110005, running at Ground Floor only in a building comprised of Basement + Ground + 02Upper Floors, owned/occupied by M/s Guruprasad Udipi Restaurant have complied with the fire prevention and fire safety requirements in accordance with Rule 33 of the Delhi Fire Service Rule, 2010 and verified by the team of officers concerned of this department on 21/09/2023 in the presence of Ms. Meghna Rao (Partner) and found that the said building/premises is fit for occupancy class " Assembly" Group D (At Ground floor) with effect from 29/09/23 to 31/03/2026 in accordance with Rule 36 unless renewed under Rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under Rule 38 of the Delhi Fire Service Rules, 2010.

Issued on 29/09/2023 at New Delhi by.

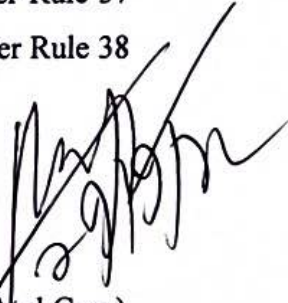
(Atul Garg)
Director
Delhi Fire Service
29/9/23

Copy to:

1. The Joint Commissioner Police, Licensing, 1st Floor, PS, Defence Colony, N Delhi.
2. The Manager, M/s Guruprasad Udipi Restaurant Located at 10204, Ground Floor, Block S, Ward No. 16, Padam Singh Road, Karol Bagh, Delhi 110005.


Following fire safety directives must be adhered to:-

1. All the fire safety arrangements provided therein shall be maintained in good working condition at all times.
2. Any loss of life or property due to non-functional fire safety measures shall be at the risk and responsibility of the management.
3. The trained staff should be available round the clock.
4. Any deviations w.r.t. construction shall be verified by the concerned building sanctioning agency.
5. The certificate may not be treated in any case for the regularization of the unauthorized construction, if any.
6. Basement shall be used as per building bye laws.
7. The owner/occupier shall submit a declaration every year in the form 'K' provided in the first schedule of Delhi Fire Service Rules 2010, form is available on www.dfs.delhigovt.nic.in.
8. The owner/ occupier shall apply for renewal of this Fire Safety Certificate to the Director in Form 'J' [sub rule (1) of rule 37] along with a copy of this certificate, six months prior to its expiry.

INSPECTION REPORT

1. Name & address of the building: M/s Guruprasad Udipi Restaurant Located at 10204, Ground Floor, Block S, Ward No. 16, Padam Singh Road, Karol Bagh, Delhi 110005.
2. Type of Occupancy : Assembly 'D' Restaurant running at Ground Floor, (The building comprised of B + G+ 2 U.Fs) :
3. Type of Case ; New
4. Details of previous NOC : Nil
5. Fire Safety directives Letter No. : UBBL & NBC Part IV
6. Date of inspection : 21/09/2023
7. Name of the Inspecting Officer : DO/SW & ADO (DWK)
8. Name and designation of Officer
from the building side : Ms. Meghna Rao (Partner)
9. Year of Construction : 2003
10. Applicant's letter No. : 2023090715727, dated 11-09-2023

S No	Minimum standards on fire prevention and fire safety U/R 33	As per NBC	Provided at site	Remarks MR/NMR
1.	Access of building			
	• Road width	06 mtr	12 mtr	MR
	• Gate width	4.5 mtr	Directly accessible from road	MR
	• Width of internal road	NA	NA	NA
2.	Number, width, Type & Arrangements of exits			
	a. Number of staircases			
	• Upper floors	NA	NA	NA
	• Basements	NA	NA	NA
	b. Width of staircases			
	• Upper floors	NA	NA	NA
	• Basements	NA	NA	NA
	c. Protection of exits			
	• Fire check door	NA	NA	NA
	• Pressurization	NA	NA	NA
	d. No of continuous staircase to terrace	NA	NA	NA
	e. Width Of Corridor	2x1.5 mtr	Provided	MR
	f. Door Size			
3.	Compartmentation			
	• Fire check door	NA	NA	NA
	• Sealing of electrical shafts	NA	NA	NA
	• Fire Rating of shaft door	NA	NA	NA
	• Water Curtain	NA	NA	NA
	• Fire Dampers	NA	NA	NA
4.	Smoke managements System			
	• Basements	NA	NA	NA
	• Upper floors	Required	Provided	MR



5.	Fire Extinguishers			
	<ul style="list-style-type: none"> Total numbers Types IS marking 	6 nos. ABC & CO ₂ ISI marked	Provided ABC & CO ₂ Provided	MR MR MR
6.	First – Aid Hose Reels			
	<ul style="list-style-type: none"> Total numbers on each floor Length of hose reel hose Nozzle diameter 	01 No. 30m 5mm	Provided 30m 5mm	MR MR MR
7.	Automatic fire detection and alarming system			
	<ul style="list-style-type: none"> Type of detectors Location of Main Panel Location of Repeater Panel Alternate source of power Hooters' Location 	NA NA NA Required NA	NA NA NA Battery Backup NA	NA NA NA MR NA
8.	MOEFA	Required	Provided	MR
9.	Public Address System	NA	NA	NA
10.	Automatic Sprinkler System			
	<ul style="list-style-type: none"> Basements Upper Floor Sprinkler above false ceiling 	NA NA NA	NA NA NA	NA NA NA
11.	Internal Hydrants:			
	<ul style="list-style-type: none"> Size of riser/down- comer Number of hydrants per floor Hose Box 	NA NA NA	NA NA NA	NA NA NA
12.	Yard Hydrants			
	<ul style="list-style-type: none"> Total number of hydrants Hose Box 	NA NA	NA NA	NA NA
13.	Pumping Arrangements:			
	<ul style="list-style-type: none"> Ground Level Discharge of main pump Head of main pump Number of main pumps Jockey pump out put Jockey pump head Standby Pump out put Standby Pump Head Auto Starting/Manual stopping Pump House Access Terrace level Discharge of pump Head of the pump Power supply Auto starting of pump 	NA NA NA NA NA NA NA NA NA NA NA NA 450 lpm, 40Mtr Required Required	NA NA NA NA NA NA NA NA NA NA NA Provided Provided Provided Provided	NA NA NA NA NA NA NA NA NA NA NA MR MR MR MR
14.	Captive water Storage for fire fighting:			
	<ul style="list-style-type: none"> Under ground tank capacity Draw off connection Fire service inlet Access to tank Overhead Tank capacity 	NA NA NA NA 20,000Ltr Required	NA NA NA NA Provided Provided	NA NA NA NA MR MR
15	Exit Signage	Required	Provided	MR

bw

Jb

Provision of Lifts			
	➤ Pressurization of Lift Shaft	NA	NA
	➤ Pressurization of lift lobby	NA	NA
	➤ Communication in lift Car	NA	NA
	➤ Fireman's Grounding Switch	NA	NA
	➤ Lift Signage	NA	NA
17.	Standby power supply	Required	Provided
18.	Refuge Area		
	➤ Total area	NA	NA
	➤ Location	NA	NA
19.	Fire control room		
	➤ Detector system panel	NA	NA
	➤ Flow Switch Panel	NA	NA
	➤ PA System Panel	NA	NA
	➤ Battery backup	NA	NA
	➤ Building Floor Plans	NA	NA
20.	Special Fire Protection Systems for Protection of special Risks, if any;	NA	NA

The fire protection systems provided in the building were test checked and found functional at the time of inspection.

Keeping in view the substantial compliance of the minimum standards on fire prevention and fire safety required under the rules it is recommended to grant Fire Safety Certificate under Rule 35 of the Delhi Fire Service Rules 2010.

1. M/s Guruprasad Udipi Restaurant Located at 10204, Ground Floor, Block S, Ward No. 16, Padam Singh Road, Karol Bagh, Delhi 110005.
2. As per letter/ plan submitted by the applicant the area of the restaurant is 188 m²
3. As per part IV, NBC-2016, table no 4.3 under clause 4.4.2.1 the occupant load for dining area and restaurant is 1.8. Accordingly the number of seats come out to be 104(188/1.8=104.4) for whole restaurant.
4. The total seating capacity comes out be 104.

Sign. Of Inspecting Officer
 Name Sh. Ved Pal
 Designation DO/SW

Sign of Inspecting Officer
 Name Uday Kumar Singh
 Designation AVO/SW

CFO(S2)
22/9/2023
Director
25/9/23

DO/SW
27/9/23
AVO Dwarika