

2/34

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE: CONNAUGHT PLACE
NEW DELHI-110 001.

No.F.6/DFS/MS/School/2032/SZ | 786

Dated: 03/11/2023

FIRE SAFETY CERTIFICATE

Certified that the **Guru Harkrishan Public School**, MS Block, Hari Nagar, New Delhi-110064, comprised of ground plus one upper floor, owned/occupied by Guru Nanak Public School was issued FSC by this department vide letter No. **F.6/DFS/MS/School/2019/SZ/889** dated **24/04/2019**. The School building was re-inspected by the officer concerned of this department on 31/10/2023 in the presence of Smt. Kulvinder Kaur (Principal) and found that School building have deemed complied with the fire prevention and fire safety requirements in accordance with the Circular No. F.16/Estate/CC/Fire Safety/2011/3298 to 3398 dated 01.03.2011 issued by the Director of Education and that the school building/ premises is fit for occupancy class "Educational" for a period of **three years**, subject to compliance of the conditions printed as under.

Issued on..... 03/11/2023at New Delhi.


(Kul Garg)
Director
Delhi Fire Service
24. 11. 23

Copy to:-

1. The Chairman,
Guru Harkrishan Public School, MS Block, Hari Nagar, New Delhi-110064.
2. Director of Education,
Govt. of NCT of Delhi, Old Secretariat, New Delhi - 110054.

Following fire safety directives must be adhered to:-

1. All the fire safety arrangements provided therein shall be maintained in good working condition at all times.
2. The means of escape shall be kept unlocked and unobstructed for unhindered evacuation of occupants in case of emergency.
3. Any loss of life or property due to non-functional fire safety measures shall be at the risk and responsibility of the management.
4. The trained staff should be available round the clock.
5. Any deviations w.r.t. construction shall be verified by the concerned building sanctioning agency.
6. The certificate may not be treated in any case for the regularization of the unauthorized construction, if any.
7. The owner/occupier shall submit a declaration every year in the form 'K' provided in the first schedule of Delhi Fire Service Rules 2010, form is available on www.dfs.delhigovt.nic.in.
8. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in the Form 'J' [sub rule (1) of rule 37] along with a copy of this Certificate, six months prior to its expiry.

INSPECTION REPORT

1. Name & address of the building : Guru Harkrishan Public School, MS Block, Hari Nagar, New Delhi-64
2. Building comprised of : Ground plus one upper floor.
3. Type of Occupancy : Educational
4. Type of Case : Renewal
5. Details of Previous NOC : F.6/DFS/MS/School/2019/SZ/889 dated 24/04/2019
6. Fire Safety directives letter No : Circular No. F.16/Estate/CC/Fire Safety/2011/3298 to 3398 dated 01.03.2011
7. Date of inspection : 31/10/2023
8. Name of Inspecting Officer : A.D.O. R.K.Yadav
9. Name and designation of officers
From the building side : Smt. Kulvinder Kaur (Principal)
10. Year of Construction : Before 2011
11. Applicant's letter No. : GHPS/HN/2496/23-24 dated 13/10/2023

S. No.	Minimum Standards on fire prevention and fire safety U/R 33	Dir. of Edu. Circular dt. 01.03.2011	Provided at site	Remarks MR/NMR
1.	Access to building			
	<ul style="list-style-type: none"> Road width Gate width Width of internal road 	Accessible N/A N/A	Provided N/A N/A	MR N/A N/A
2.	Number, Width, Type & Arrangement of Exits			
	a. Number of staircases	02 no.'s	02 no.'s	MR
	<ul style="list-style-type: none"> Upper Floors Basements 	N/A	N/A	N/A
	b. Width of staircases			
	<ul style="list-style-type: none"> Upper Floor Basements 	1.50 m	1.85 & 1.50 m	MR
		N/A	N/A	N/A
	c. Protection of exits			
	<ul style="list-style-type: none"> Fire check door Pressurization 	N/A	N/A	N/A
		N/A	N/A	N/A
	d. No. of continuous staircases to terrace	N/A	N/A	N/A
		N/A	N/A	N/A
	e. Width of Corridor			
	f. Class room Door Size	1.0 m	1.20 m	MR
3.	Compartmentation			
	<ul style="list-style-type: none"> Fire check door Sealing of electrical shafts Fire Rating of shaft door Water Curtain Fire Dampers 	N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
4.	Smoke Management System			
	<ul style="list-style-type: none"> Basements 	N/A	N/A	N/A
	<ul style="list-style-type: none"> Upper floors 	Required	Natural Ventilation provided	MR
5.	Fire Extinguishers			
	<ul style="list-style-type: none"> Total numbers Types IS marking 	12 No's ABC/CO ₂ type ISI marked	Provided	MR
			Provided	MR
			Provided	MR
6.	First-Aid Hose Reels			
	<ul style="list-style-type: none"> Total numbers on each floor Length of hose reel hose Nozzle diameter 	N/A N/A N/A	N/A N/A N/A	N/A N/A N/A

15

h

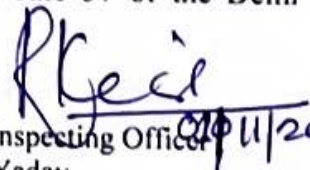
7.	Automatic fire detection and alarming system			
	<ul style="list-style-type: none"> Type of detectors Location of Main Panel Location of Repeater Panel Alternate source of power Hooters' Location 	N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
8.	MOEFA	N/A	N/A	N/A
9.	Public Address System	N/A	N/A	N/A
10.	Automatic Sprinkler System			
	<ul style="list-style-type: none"> Basement Ground Floor Sprinkler above false ceiling 	N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
11.	Internal Hydrants			
	<ul style="list-style-type: none"> Size of riser/down-comer Number of hydrants per floor Hose Box 	N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
12.	Yard Hydrants			
	<ul style="list-style-type: none"> Total number of hydrants Hose Box 	N/A	N/A	N/A
		N/A	N/A	N/A
13.	Pumping Arrangements			
	<ul style="list-style-type: none"> Ground Level <ul style="list-style-type: none"> Discharge of main Pump Head of Main pump Number of main pumps Jockey Pump out put Jockey pump head Standby Pump out put Standby Pump Head Auto Starting/Manual Stopping 	N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
	<ul style="list-style-type: none"> Pump House Access Terrace level <ul style="list-style-type: none"> Discharge of pump Head of the pump Power Supply Auto Starting of pump 	N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
14.	Captive Water Storage for fire fighting			
	<ul style="list-style-type: none"> Underground tank capacity <ul style="list-style-type: none"> Draw-off connection Fire service inlet Access to tank Overhead Tank capacity 	N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
15.	Exit Signage.	N/A	N/A	N/A
16.	Provision of Lifts. (No Lift)			
	<ul style="list-style-type: none"> Pressurization of Lift Shaft Pressurization of Lift lobby Communication In lift Car Fireman's Grounding Switch Lift Signage 	N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
17.	Standby power supply	N/A	N/A	N/A
18.	Refuge Area.			
	<ul style="list-style-type: none"> Total Area Location 	N/A	N/A	N/A
		N/A	N/A	N/A

Handwritten marks and scribbles at the bottom of the page.



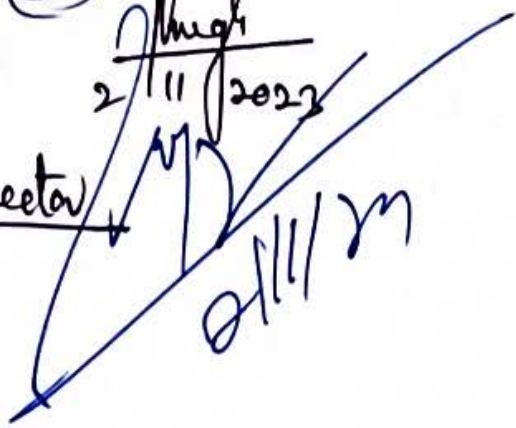
19.	Fire Control Room			
	• Detector System Panel	N/A	N/A	N/A
	• Flow Switch Panel	N/A	N/A	N/A
	• PA System Panel	N/A	N/A	N/A
	• Battery backup	N/A	N/A	N/A
	• Building Floor Plans	N/A	N/A	N/A
20.	Special Fire Protection System for Protection of special Risks, if any:	N/A	N/A	N/A

The fire protection systems provided in the building were tested, checked and found functional at the time of inspection. The shortcomings issued vide letter No. F.6/DFS/MS/School/2023/SZ/310 dated 07/08/2023 has been complied.

In view of the deemed compliance of the minimum standards of fire prevention and fire safety measures as required under the rules the FSC issued vide letter number F.6/DFS/MS/School/2019/SZ/889 dated 24/04/2019 renewal under rule 37 of the Delhi Fire Service Rules 2010 is recommended.


 Signature of Inspecting Officer
 Name:- R.K. Yadav
 Designation:- Asstt. Divisional Officer

Divisional Officer (South West)


 1/11/23
 CPO (SW)

 2/11/2023
Director

 2/11/23
