

C-33

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEAD QUARTERS: DELHI FIRE SERVICE: CONNAUGHT PLACE
NEW DELHI-110001.**

No.F.6 DFS/MS/School/2023/SZ/904

Dated: 18/12/2023

FIRE SAFETY CERTIFICATE

Certified that **MCD Primary Girls/Boys School**, located at Govindpuri-I Kalkaji New Delhi 110019 comprised of Ground plus Two upper floor owned/occupied by Municipal Corporation of Delhi have complied with the fire prevention and fire safety requirements in accordance with rule 33 of the Delhi Fire Service Rules, 2010 and verified by officer concern of this department on 11/12/2023 in the presence of Mr. Akhleshwar Narayan Pathak (Principal) and that the premises is fit for occupancy class "**Educational, Group-B**" (School) as above with effect from 18/12/2023 for period of **Three years** in accordance with Rule 36 unless renewed under Rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under Rule 38 of the Delhi Fire Service Rules, 2010.

Issued on 18/12/2023 at New Delhi by


(ATUL GARG)
DIRECTOR
DELHI FIRE SERVICE

Copy to: -

1. The Principal, MCD Primary Girls/Boys School, located at Govindpuri-I Kalkaji New Delhi 110019
2. The Director of Education, South MCD, Civic Centre, Minto Road, New Delhi-110002

Conditions for the validity of Fire Safety Certificate

1. All the means of escape/entry/exit shall be kept free from any obstruction.
2. All the fire safety arrangements provided therein shall be maintained in good working condition at all time as seen during inspection. Any loss of life or property due to non-functional fire safety measures shall be at the responsibility of the management.
3. This certificate cannot be treated as regularization of unauthorized construction, if any.
4. The owner/ occupier shall submit a declaration every year in Form 'K' provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on www.dfs.delhigovt.nic.in
5. This fire safety certificate may not in any way be treated as regularization (Clause 2.8 of UBBL-2016) of unauthorized construction or Alteration (Clause 1.4.3 of UBBL-2016), if any.
6. "The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in Form 'J' [sub rule (1) of rule 37] along with a copy of this Certificate, six months prior to its expiry."

M114

INSPECTION REPORT


1	Name & Address of the Building	SDMC Primary Girls/Boys School, Govindpuri Kalkaji New Delhi 110019		
2	Type of Occupancy	Educational, Group-B (School)		
3	Building Comprised of	Ground plus Two Upper Floor		
4	Type of Case	New Case		
5	Details of Previous NOC	Nil		
6	Fire Safety Directives Letter No	F.16/Estate/CC/Fire Safety/2011/3298 to 3398 dated 01.03.2011		
7	Date of Inspection	11-12-2023		
8	Name of the Inspecting Officers	Sh. Rajesh Kumar ADO (BCP)		
9	Name & Designation of Officers from the building side	Mr. Akhleshwar Narayan Pathak (Principal)		
10	Year of construction	1993		
11	Applicant letter No.	Email dated 14/11/2023		
S. No	Minimum standards on Fire Prevention and Fire Safety U/R 33	Old NOC requirements	Provided at Site	Remarks MR/NMR
1	Access to Building.			
	• Road width	6m	8m	MR
	• Gate width	-NA-	-NA-	-NA-
	• Width of internal road	-NA-	-NA-	-NA-
2	Number, width, type & arrangement of exits.			
	a) Number of Staircase			
	➤ Upper floors.	01 Nos	02 Nos	MR
	➤ Basement floor.	-NA-	-NA-	-NA-
	b) Width of Staircase			
	➤ Upper floors	1.50m/0.75m	1.42m & 1.25m	MR
	➤ Basement floor	-NA-	-NA-	-NA-
	c) Protection of exits			
	➤ Fire check door	-NA-	-NA-	-NA-
	➤ Pressurization	-NA-	-NA-	-NA-
	d) No. of continuous staircase to terrace	01 No	Provided	MR
	e) Width of corridor	1.50 mtr	Provided	MR
	f) Door size	1 mtr	Provided	MR
3	Compartmentation.			
	• Fire check door.	-NA-	-NA-	-NA-
	• Sealing of electrical shafts.	-NA-	-NA-	-NA-
	• Fire rating of shaft door.	-NA-	-NA-	-NA-
	• Water curtain	-NA-	-NA-	-NA-
	• Fire dampers.	-NA-	-NA-	-NA-
4	Smoke Management system.			
	• Basement	-NA-	-NA-	-NA-
	• Upper floors	-NA-	-NA-	-NA-
5	Fire Extinguishers.			
	• Total numbers	06 No	Provided	MR
	• Types	ABC	ABC & Co2 Type	MR
	• ISI Marking	ISI mark	Provided	MR
6	First Aid Hose Reels.			
	• Total numbers on each floor.	02 Nos each	Provided	MR
	• Length of hose-reel hose.	30m	Provided	MR
	• Nozzle Diameter	5mm	Provided	MR
7	Automatic fire detection & alarming system.			
	• Type of detectors	-NA-	-NA-	-NA-

n/16


	• PA system panel.	-NA-	-NA-	-NA-
	• Battery backup.	-NA-	-NA-	-NA-
	• Building floor plan.	-NA-	-NA-	-NA-
20.	Special Fire Protection System for the Protection of special Risk, if any.	-NA-	-NA-	-NA-


The fire protection system provided in the building were randomly checked and found functional at the time of inspection.
 Further, the party has complied all the observation / Shortcoming already issued & communicated by this department vide letter of even no 611 dated 27/09/2022.
 Keeping in view of the substantially satisfactory compliance of the minimum standards on fire prevention and fire safety measures as required under the rules, it is recommended to issue Fire Safety Certificate under rule 35 (3) of the Delhi Fire Service Rules, 2010

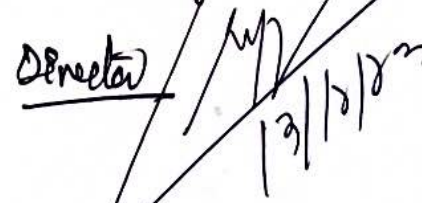
Accordingly, DFA is put up for approval and signature please.


 Signature of the Inspecting Officer
 Name: Sh. Rajesh Kumar
 Design: ADO (BCP)

DO (South)

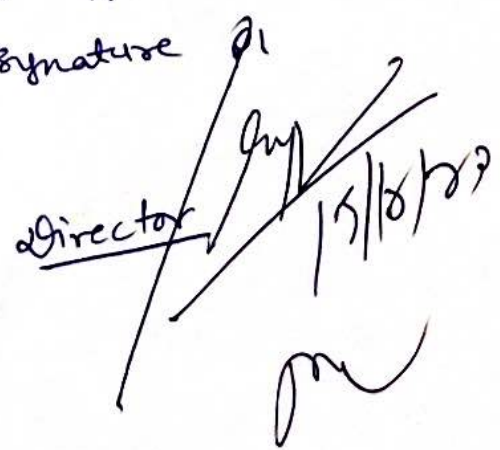

 12/12/23


 13/12/2023


 13/12/23



As approved, F.T. letter is put up for your signature


 15/12/23

1/14
15/12