

C-40

FORM 'H'

FORM FOR ISSUING FIRE SAFETY CERTIFICATE

[Refer sub - rule (1) of rule 35]

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEAD QUARTERS: DELHI FIRE SERVICE, CONNAUGHT PLACE
NEW DELHI

No.F6/DFS/MS/SZ/2023/C.C./39

Dated 28/12/2023

FIRE SAFETY CERTIFICATE

Certified that building of Coaching center Located at 2nd & 3rd Floor, Plot No. 60, Sector-12B, Dwarka, New Delhi – 110075 in the building comprised of Basement + Ground + 03 Upper Floors have complied with the fire prevention and fire safety requirements in accordance with Rule 33 of the Delhi Fire Service Rule, 2010 and verified by the officers concerned of this department on 14/12/2023 in the presence of Mr. Dinesh (Guard) and found that the said building is fit for occupancy class "Educational" Group B Sub Division B – 1 with effect from 28/12/2023 for a period of three years in accordance with Rule 36 unless renewed under Rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under Rule 38 of the Delhi Fire Service Rules, 2010.

Issued on ..28/12/2023 at New Delhi.


(Atul Garg)
Director
Delhi Fire Service.
27/12/23

Copy to:

1. Smt. Swarna Kanta Chopra, Coaching center Located at 2nd & 3rd Floor, Plot No. 60, Sector-12B, Dwarka, New Delhi – 110075.
2. The Executive Engineer (Bldg.) HQ, Municipal Corporation of Delhi, 9th floor, Minto Road New Delhi – 110002.

Following fire safety directives must be adhered to:-

1. All the exits passage leading to stairs & given at ground floor shall be kept clear and free from lock & keys.
2. All the fire safety arrangements provided therein shall be maintained in good working condition at all times.
3. Any loss of life or property due to non-functional fire safety measures shall be at the risk and responsibility of the management.
4. The trained staff should be available round the clock.
5. Any deviations w.r.t. construction shall be verified by the concerned building sanctioning agency.
6. The certificate may not be treated in any case for the regularization of the unauthorized construction, if any.
7. The owner/ occupier shall apply for renewal of this Fire Safety Certificate to the Director in Form 'J' [sub rule (1) of rule 37] along with a copy of this certificate, six months prior to its expiry. www.dfs.delhigovt.nic.in.
8. Basement shall be used strictly as per building bye laws.
9. The owner/occupier shall submit a declaration every year in the form 'K' provided in the first schedule of Delhi Fire Service Rules 2010, form is available on www.dfs.delhigovt.nic.in

N/9

INSPECTION REPORT

1. Name & address of the building: Coaching center Located at 2nd & 3rd Floor, Plot No. 60, Sector-12B, Dwarka, New Delhi – 110075.
2. Type of Occupancy : Educational ,(Basement +G +3 UFs) (Basement –Storage, Ground & 1st floor Business occupancy path lab, 2nd & 3rd floor Coaching Centre 2room each floor.)The FSC is for 2nd & 3rd floor only.
3. Type of Case : New
4. Details of previous NOC : Nil
5. Fire Safety directives Letter No. : F6/DFS/MS/BP/2023/3097, dated 12/10/2023
6. Date of inspection : 14-12-2023
7. Name of the Inspecting Officer :DO/SW & ADO (DWK)
8. Name and designation of Officer
from the building side : Mr. Dinesh (Guard)
9. Year of Construction :
10. Applicant's letter No. : Email, dated 11/12/2023


S No	Minimum standards on fire prevention and fire safety U/R 33	As per NBC	Provided at site	Remarks MR/NMR
1.	Access of building			
	• Road width	06mtrs	Provided	MR
	• Gate width	6 mtrs	On Road	MR
	• Width of internal road	NA	NA	NA
2.	Number, width, Type & Arrangements of exits			
	a. Number of staircases			
	• Upper floors	02 Nos.	Provided	MR
	• Basements	2	Provided	MR
	b. Width of staircases			
	• Upper floors	1.5m	Provided	MR
	• Basements	1.5m	Provided	MR
	c. Protection of exits			
	• Fire check door	NA	Provided	NA
	• Pressurization	NA	NA	NA
	d. No of continuous staircase to terrace	Required	Provided	MR
	e. Width Of Corridor	NA	NA	NA
	f. Door Size	01 mtr	Provided	MR
3.	Compartmentation			
	• Fire check door	Required in Basement	Provided	MR
	• Sealing of electrical shafts	NA	NA	NA
	• Fire Rating of shaft door	NA	NA	NA
	• Water Curtain	NA	NA	NA
	• Fire Dampers	NA	NA	NA
4.	Smoke managements System			
	• Basements	30 a/c charge per hour	Provided	MR
	• Upper floors	12 a/c charge per hour	Natural ventilation	MR


5.	Fire Extinguishers				
	<ul style="list-style-type: none"> • Total numbers • Types • IS marking 	10 nos..	Provided	MR	
		ABC & CO ₂	DCP, CO ₂ & Water	MR	
6.	First – Aid Hose Reels				
	<ul style="list-style-type: none"> • Total numbers on each floor • Length of hose reel hose • Nozzle diameter 	01 No.	Provided	MR	
		30m	Provided	MR	
		5mm	Provided	MR	
7.	Automatic fire detection and alarming system				
	<ul style="list-style-type: none"> • Type of detectors • Location of Main Panel • Location of Repeater Panel • Alternate source of power • Hooters' Location 	NA	NA	NA	
		NA	NA	NA	
		NA	NA	NA	
		NA	NA	NA	
		NA	NA	NA	
8.	MOEFA	NA	Provided	NA	
9.	Public Address System	NA	Provided	NA	
10.	Automatic Sprinkler System				
	<ul style="list-style-type: none"> • Basements • Upper Floor • Sprinkler above false ceiling 	Required	Provided	MR	
		NA	NA	NA	
		NA	NA	NA	
11.	Internal Hydrants:				
	<ul style="list-style-type: none"> • Size of riser/down-comer • Number of hydrants per floor • Hose Box 	NA	Provided	NA	
		NA	NA	NA	
		NA	NA	NA	
12.	Yard Hydrants				
	<ul style="list-style-type: none"> • Total number of hydrants • Hose Box 	NA	NA	NA	
		NA	NA	NA	
13.	Pumping Arrangements:				
	<ul style="list-style-type: none"> • Ground Level • Discharge of main pump • Head of main pump • Number of main pumps • Jockey pump out put • Jockey pump head • Standby Pump out put • Standby Pump Head • Auto Staring/Manual stopping • Pump House Access • Terrace level • Discharge of pump • Head of the pump • Power supply • Auto starting of pump 	NA	NA	NA	
		NA	NA	NA	
		NA	NA	NA	
		NA	NA	NA	
		NA	NA	NA	
		NA	NA	NA	
		NA	NA	NA	
		NA	NA	NA	
		NA	NA	NA	
		NA	NA	NA	
		450 lpm	Provided	MR	
		40 Mtr	40 mtr	MR	
		Required	Provided	MR	
		Required	Provided	MR	



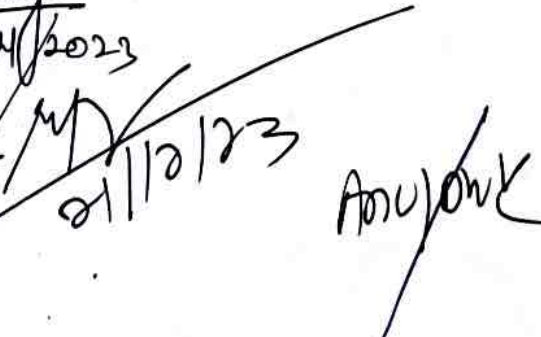
14.	Captive water Storage for fire fighting:			
	• Underground tank capacity	NA	NA	NA
	➤ Draw off connection	NA	NA	NA
	➤ Fire service inlet	Required	Provided	MR
	➤ Access to tank	NA	NA	NA
	• Overhead Tank capacity	10,000 L	Provided	MR
15	Exit Signage	Required	Provided	MR
16.	Provision of Lifts			
	➤ Pressurization of Lift Shaft	NA	NA	NA
	➤ Pressurization of lift lobby	NA	NA	NA
	➤ Communication in lift Car	Required	Provided	MR
	➤ Fireman's Grounding Switch	Required	Provided	MR
	➤ Lift Signage	Required	Provided	MR
17.	Standby power supply	Required	DG Set	MR
18.	Refuge Area			
	➤ Total area	NA	NA	NA
	➤ Location	NA	NA	NA
19.	Fire control room			
	❖ Detector system panel	NA	NA	NA
	❖ Flow Switch Panel	NA	NA	NA
	❖ PA System Panel	NA	NA	NA
	❖ Battery backup	NA	NA	NA
	❖ Building Floor Plans	NA	NA	NA
20.	Special Fire Protection Systems for Protection of special Risks, if any;	NA	NA	NA

The fire protection systems provided in the building were test checked and found functional at the time of inspection.

Keeping in view the substantial compliance of the minimum standards on fire prevention and fire safety required under the rules, it is recommended to grant Fire Safety Certificate under Rule 35 of the Delhi Fire Service Rules 2010


 Sign of Inspecting Officer
 Name: Sh. Vedpal
 Designation: DO/SW


 Sign of Inspecting Officer
 Name: Udai vir Singh
 Designation: ADO/DWK


 CFO (S2)

 Director

 Anuj
 21/11/2023
 21/11/2023