

C 30

FORM 'H'  
FORM FOR ISSUING FIRE SAFETY CERTIFICATE  
[Refer sub - rule (1) of rule 35]  
GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI  
HEAD QUARTERS: DELHI FIRE SERVICE, CONNAUGHT PLACE  
NEW DELHI

No. F6/DFS/MS/SCHOOL/SZ/2024/ 41

Dated: 19/01/2024

**FIRE SAFETY CERTIFICATE**

Certified that the building of Rajkiya Pratibha Vikas Vidhalaya Located at, Sector - 05, Dwarka, New Delhi comprised of Basement + Ground + 3UFs owned/ occupied by **Delhi Government** was issued FSC vide letter No: F6/DFS/MS/School/2018/SZ/850 Dated-26/04/2018. The premises was re inspected by the officers concerned of this department on 08/01/2024 in the presence of Ms. Monika Batra (Principal) and observed that all the fire prevention and fire safety arrangements provided in the premises found in good working condition. The premises have therefore deem complied with the fire prevention and fire safety requirements in accordance with Delhi Fire Service Rules 2010 under Delhi Fire Service Act 2007 and that the premises is fit for occupancy class "Educational" Group B with effect from 19/01/2024 for a period of **three years** in accordance with Rule 36 unless renewed under Rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under Rule 38 of the Delhi Fire Service Rules, 2010.

Issued on ...19/01/2024... at New Delhi by.

  
(Atul Garg)  
Director,  
Delhi Fire Service  
o/c  
16/1/24

Copy to:

1. Directorate of Education Old Secretariat Delhi - 110054.
2. The Principal, Rajkiya Pratibha Vikas Vidhalaya Located at, Sector - 05, Dwarka, New Delhi.

**Following fire safety directives must be adhered to:-**

1. All the fire safety arrangements provided therein shall be maintained in good working condition at all times.
2. Any loss of life or property due to non-functional fire safety measures shall be at the risk and responsibility of the management.
3. The trained staff should be available round the clock.
4. Any deviations w.r.t. construction shall be verified by the concerned building sanctioning agency.
5. The certificate may not be treated in any case for the regularization of the unauthorized construction, if any.
6. Basement shall be used strictly as per building bye laws.
7. The owner/occupier shall submit a declaration every year in the form 'K' provided in the first schedule of Delhi Fire Service Rules 2010, form is available on [www.dfs.delhigovt.nic.in](http://www.dfs.delhigovt.nic.in).
8. The owner/ occupier shall apply for renewal of this Fire Safety Certificate to the Director in Form 'J' [sub rule (1) of rule 37] along with a copy of this certificate, six months prior to its expiry.

N/11  
**INSPECTION REPORT**

1. Name & address of the building: Rajkiya Pratibha Vikas Vidhalaya Located at, Sector – 05, Dwarka, New Delhi.
2. Type of Occupancy : Educational (Ground+3 Upper Floors)
3. Type of Case : Renewal
4. Details of previous NOC : F6/DFS/MS/School/2018/SZ/850 Dated- 26/04/2018
5. Fire Safety directives Letter No. : UBBL/NBC of India
6. Date of inspection : 08-01-2024
7. Name of the Inspecting Officer : Udai vir Singh, ADO (DWK)
8. Name and designation of Officer  
from the building side : Ms. Monika Batra (Principal)
9. Year of Construction : 2017
10. Applicant's letter No. : Form J dated nil

S No	Minimum standards on fire prevention and fire safety U/R 33	BBL/NBC Requirement As per N/1, N/2 & N/3	Provided at site	Remarks MR/NMR
1.	<b>Access of building</b>			
	• Road width	06mtrs	12 mtrs	MR
	• Gate width	4.5mtrs	5.7 mtr	MR
	• Width of internal road	NA	NA	NA
2.	<b>Number, width, Type &amp; Arrangements of exits</b>			
	a. Number of staircases			
	• Upper floors	04 Nos.	04 Nos.	MR
	• Basements	NA	NA	NA
	b. Width of staircases			
	• Upper floors	1.5m	4x1.5 mtr including railing	MR (Old case)
	• Basements	NA	NA	NA
	c. Protection of exits			
	• Fire check door	NA	NA	NA
	• Pressurization	NA	NA	NA
	d. No of continuous staircase to terrace	04 Nos	04 Nos	MR
	e. Width Of Corridor	1.5 mtr	185cm	MR(Old case)
	f. Door Size	1.20 mtr	105cm	MR(Old case)
3.	<b>Compartmentation</b>			
	• Fire check door	NA	NA	NA
	• Sealing of electrical shafts	NA	NA	NA
	• Fire Rating of shaft door	NA	NA	NA
	• Water Curtain	NA	NA	NA
	• Fire Dampers	NA	NA	NA


N/12




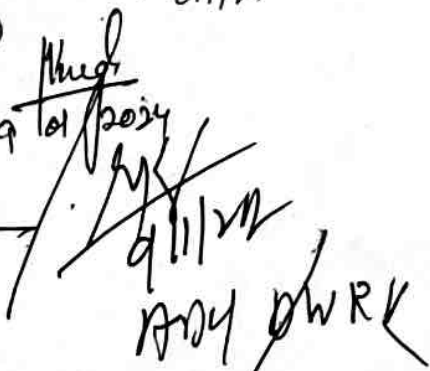
4.	Smoke managements System			
	• Basements	NA	NA	NA
	• Upper floors	NA	Natural ventilation	MR
5.	Fire Extinguishers			
	• Total numbers	08 nos.each floor	Provided	MR
	• Types	ABC & CO <sub>2</sub>	Provided	MR
	• IS marking	ISI marked	Provided	MR
6.	First – Aid Hose Reels			
	• Total numbers on each floor	04	Provided	MR
	• Length of hose reel hose	30m	Provided	MR
	• Nozzle diameter	5mm	Provided	MR
7.	Automatic fire detection and alarming system			
	• Type of detectors	NA	NA	NA
	• Location of Main Panel	NA	NA	NA
	• Location of Repeater Panel	NA	NA	NA
	• Alternate source of power	NA	NA	NA
	• Hooters' Location	NA	NA	NA
8.	MOEFA		NA	NA
9.	Public Address System		NA	NA
10.	Automatic Sprinkler System			
	• Basements	NA	NA	NA
	• Upper Floor	NA	NA	NA
	• Sprinkler above false ceiling	NA	NA	NA
11.	Internal Hydrants:			
	• Size of riser/down-comer	NA	100 mm	NA
	• Number of hydrants per floor	NA	04 Nos.	NA
	• Hose Box	NA	04 nos. each floor	NA
12.	Yard Hydrants			
	• Total number of hydrants	NA	08 Nos.	NA
	• Hose Box	NA	08 Nos.	NA
13.	Pumping Arrangements:			
	• Ground Level			
	• Discharge of main pump	NA	450 lpm (02 nos.)	NA
	➤ Head of main pump	NA	NA	NA
	➤ Number of main pumps	NA	NA	NA
	➤ Jockey pump out put	NA	NA	NA
	➤ Jockey pump head	NA	NA	NA
	➤ Standby Pump out put	NA	NA	NA
	➤ Standby Pump Head	NA	NA	NA
	➤ Auto Staring/Manual stopping	NA	NA	NA
	➤ Pump House Access	NA	NA	NA
	• Terrace level			
	➤ Discharge of pump	450 lpm	450 lpm (02 nos.)	MR
	➤ Head of the pump	40Mtr	40 m	MR
	➤ Power supply	Required	Provided	MR
	➤ Auto starting of pump	Required	Provided	MR

14	Captive water Storage for fire fighting:			
	• Underground tank capacity	NA	50000 ltr	NA
	➤ Draw off connection	NA	NA	NA
	➤ Fire service inlet	NA	Provided	NA
	➤ Access to tank	NA	NA	NA
	• Overhead Tank capacity	10,000Ltrs	10,000 ltrs	MR
15	Exit Signage	Required	Provided	MR
16	Provision of Lifts			
	➤ Pressurization of Lift Shaft	NA	NA	NA
	➤ Pressurization of lift lobby	NA	NA	NA
	➤ Communication in lift Car	Required	Provided	MR
	➤ Fireman's Grounding Switch	Required	Provided	MR
	➤ Lift Signage	Required	Provided	MR
17	Standby power supply	Required	DG Set 63 KVA	MR
18	Refuge Area			
	➤ Total area	NA	NA	NA
	➤ Location	NA	NA	NA
19	Fire control room			
	➤ Detector system panel	NA	NA	NA
	➤ Flow Switch Panel	NA	NA	NA
	➤ PA System Panel	NA	NA	NA
	➤ Battery backup	NA	NA	NA
	➤ Building Floor Plans	NA	NA	NA
20	Special Fire Protection Systems for Protection of special Risks, if any;	NA	CO2 fire extinguisher provided near electric panel	NA

The fire protection systems provided in the building were test checked and found functional at the time of inspection.

In view of the deemed compliance of minimum standards on fire prevention and fire safety as required under the rules the NOC issued vide letter No. F6/DFS/MS/School/2018/SZ/850 Dated-26/04/2018 renewal under Rule 37 of the Delhi Fire Service Rules 2010 is recommended.

  
 Sign of Inspecting Officer  
 Name Uday Vir Singh  
 Designation ADDT/BUK

  
 DofSU  
  
 CofSU  
  
 Director  
  
 ADT/BUK