



No. F6/DFS/MS/School/NDZ/2024/ 80

Dated: 31/01/2024

FIRE SAFETY CERTIFICATE

Certified that the **Lovely Heritage School** located at **Pocket - E, Phase- II, Mayur Vihar, Delhi - 110091** building comprised of basement, ground plus three upper floors, owned /occupied by **Lovely Heritage School** have complied with the Fire prevention and fire safety requirements in accordance with Rule 33 of the Delhi Fire Service Rules,2010 and verified by the officer concerned of this department on 24.01.2024 in the presence of Mr. Vipin Kumar (Manager) and found that the building / premises is fit for occupancy class '**Educational (Group-B)**' with effect from 31/01/2024 for a period of **three years** in accordance with Rule 36 unless renewed under Rule 37 of sooner cancelled under Rule 40 and subject to compliance of the conditions under Rule 38 of the Delhi Fire Service Rules 2010 and also conditions printed below.

Issued on 31/01/2024 at New Delhi by.


(ATUL GARG)
DIRECTOR
DELHI FIRE SERVICE
o/c @

Copy to:-

1. The Dy. Director of Education, B-Block, Anand Vihar, Delhi-110053.
2. The Manager, Lovely Heritage School located at Pocket - E, Phase- II, Mayur Vihar, Delhi - 110091.

Conditions for the validity of Fire Safety Certificate

1. The owner /occupier shall apply for renewal of this fire safety certificate to the Director in form 'J' [sub rule(1) of rule 37] along with a copy of this certificate, six months prior to its expiry
2. All the means of escape shall be kept free of all the type of obstruction all the time.
3. All the employees shall be acquainted with the use and maintenance of all fire equipments and method of smooth and speedy safe evacuation of occupants in case of emergency.
4. All the fire fighting equipments shall be maintained in perfect working condition all the time and any lapse rendering non-functional of fire safety measures, management shall be responsible.
5. The clarification with regards electrical installation, ventilation, structure stability set back areas, occupancy and constructional deviation in building etc .may be got verified from the authorities concerned.
6. This Fire Safety Certificate cannot be treated in any case for regularizations of unauthorized construction unauthorized use of land if any.
7. Basement shall be used strictly as per Building By-Laws 1983.
8. The owner / occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rule 2010. The form is available on www.dfs.delhigovt.nic.in.

INSPECTION REPORT

1	Name & address of the building	Lovely Heritage School located at Pocket - E, Phase- II, Mayur Vihar, Delhi - 110091.			
2	Building is comprised of	Basement + Ground + 03 upper floors only.			
3	Type of occupancy	Educational Building			
4	Type of case	New Case			
5	Details of previous FSC	Nil			
6	Fire safety directives letter no.	F6/DFS/MS/2022/12 dated 13.01.2020.			
7	Date of inspection	24.01.2024			
8	Name of the inspecting officers	Yashwant Singh Meena ADO (L.N)			
9	Name of the designation of officer from the building side	Mr. Vipin Kumar (Manager)			
10	Year of construction	2022-2024			
11	Applicant's letter no.	Outdoor Diary no. 12003 dated 17.01.2024			
S.No	Minimum standard of fire prevention and fire safety U/R 33	Requirement	Provided at site	Remarks MR/NMR	
1	Access to Building:				
	A	Road width	18 mtrs.	18 mtrs.	MR
	B	Gate width	6.0 mtrs	6.0 mtrs	MR
	C	Width of internal road	9.0 mtrs.	9.0 mtrs.	MR
2	Number, Width, Type and Arrangement of Exits:				
	A	Number of staircases			
	a	Upper floor	02 nos.	02 nos. ✓	MR
	b	Basement	02 nos.	02 nos.	MR
	B	Width of staircases			
	a	Upper floor	1.50 mtrs.	1.50 mtrs. each	MR
	b	Basement	1.50 mtrs.	1.50 mtrs. each	MR
	C	Protection of exits			
	a	Fire check door	Required	Provided	MR
	b	Pressurization	N/A	N/A	N/A
	D	No. of continuous staircases to terrace	01 no.	02 no. ✓	MR
	E	Width of corridor	1.50 mtrs.	1.80 mtrs.	MR
	F	Door size	1.0 mtrs.	1.0 mtrs. ✓	MR
3	Compartmentation:				
	A	Fire check door	Required	Provided	MR
	B	Sealing of electrical shafts	N/A	N/A	N/A
	C	Fire rating of shaft door	N/A	N/A	N/A
	D	Water curtain	N/A	N/A	N/A
	E	Fire dampers	N/A	N/A	N/A
4	Smoke Management System:				
	A	Basement	Required	Exhaust fan ✓	MR
	B	Upper floor	Required	Natural Ventilation	MR

W

5.	Fire Extinguisher:			
	A	Total numbers	18 nos.	25 nos. / MR
	B	Types	CO ₂ & ABC	CO ₂ & ABC / MR
	C	ISI marking	ISI Marked	Provided / MR
6	First-Aid-Hose Reel:			
	A	Total numbers of each floor	02 nos.	02 nos. / MR
	B	Length of hose reel hose	30 mtrs	30 mtrs / MR
	C	Nozzle diameter	05 mm	05 mm / MR
7	Automatic Fire Detection and Alarming System:			
	A	Type of detectors	N/A	N/A / N/A
	B	Location of main panel	N/A	N/A / N/A
	C	Location of repeater panel	N/A	N/A / N/A
	D	Alternate source of power	N/A	N/A / N/A
	E	Hooters	N/A	N/A / N/A
8	MOEFA:		Required	Provided / MR
9	Public Address System:		Required	Provided / MR
10	Automatic Sprinkler System:			
	A	Basement	Required	Provided / MR
	B	Upper floor	N/A	N/A / N/A
	C	Sprinkler above false ceiling	N/A	N/A / N/A
11	Internal Hydrants:			
	A	Size of riser/down-comer	100 mm	100 mm / MR
	B	Number of hydrants per floor	02 nos.	02 nos. / MR
	C	Hose box	02 nos.	02 nos. / MR
12	Yard Hydrants:			
	A	Total number of hydrants	N/A	N/A / N/A
	B	Hose box	N/A	N/A / N/A
13	Pumping Arrangements:			
1	Ground level			
	A	Discharge of main pump	2280 LPM	2280 LPM / MR
	B	Head of main pump	60 m	60 m / MR
	C	Number of main pumps	01 no.	01 no. / MR
	D	Jockey pump out put	180 LPM	180 LPM / MR
	E	Jockey pump head	60 m	60 m / MR
	F	Standby pump out put	2280 LPM	2280 LPM / MR
	G	Standby pump head	60 m	60 m / MR
	H	Auto starting /manual stopping	Required	Provided / MR
	I	Pump house access	Required	Provided / MR
2	Terrace Level			
	A	Discharge of pump	900 LPM	900 LPM / MR
	B	Head of the pump	40 mtrs	40 mtrs. / MR
	C	Power supply	Required	Provided / MR
	D	Auto starting of pump	Required	Provided / MR

14	Captive Water Storage for Fire Fighting:			
A	Underground tank capacity	1,50,000 liters.	1,50,000 liters. ✓	MR
B	Draw-off connection	Required	Provided	MR
C	Fire service inlet	Required	Provided	MR
D	Access to tank	Required	Provided	MR
E	Overhead tank capacity	25,000 liters.	25,000 liters. ✓	MR
15	Exit Signage:	Require	Provided	MR
16	Provision of Lifts:			
A	Pressurization of lift shaft	N/A	N/A	N/A
B	Pressurization of lift lobby	N/A	N/A	N/A
C	Communication in lift car	N/A	N/A	N/A
D	Firemen's grounding switch	N/A	N/A	N/A
E	Lift signage	N/A	N/A	N/A
17	Standby Power Supply:	Required	Provided ✓	MR
18	Refuge Area:			
A	Total area	N/A	N/A	N/A
B	Location	N/A	N/A	N/A
19	Fire Control Room:			
A	Detector system panel	N/A	N/A	N/A
B	Flow switch panel	N/A	N/A	N/A
C	PA system panel	N/A	N/A	N/A
D	Battery backup	N/A	N/A	N/A
E	Building floor plans	N/A	N/A	N/A
20	Special Fire Protection systems for protection of special Risks, if any:	N/A	N/A	N/A

The fire protection systems provided in the building were tested, checked and found functional at the time of inspection.


Keeping in view of the substantial compliance of the minimum standards of fire prevention and fire safety required under the rules it is recommended to grant Fire Safety Certificate under rule 35 of the Delhi Fire Service Rules 2010 is recommended.



Signature of the Inspecting Officer
Name: - Yashwant Singh Meena
Designation: - ADO (L.N)


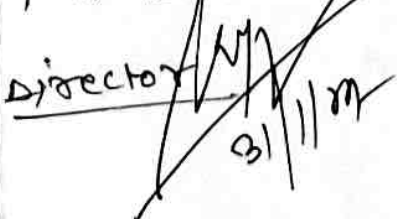
Dy.CFO (NDZ)


29/01/24

C.F.O.

29/01/2024

Director

31/1/24

F.T Letter is put up for sign. Please

Director

31/1/24


30/1/2024