



F6/DFS/MS/School/NDZ/2024/78

Dated: 31/01/2024

FIRE SAFETY CERTIFICATE

Certified that the **New Oxford Public School** running on ground and first floor only of the building comprised of ground plus two upper floors located at B-122 A, B-Block, Vivek Vihar, Delhi-110095 owned / occupied by **New Oxford Public School**, was issued FSC vide letter No. F6/DFS/MS/School/2021/NDZ/816 dated 06/10/2021. The School building was re-inspected by the officer concerned of this department on 23/01/2024 in presence of Mr. Anoop Minocha (Chairmen) and observed that all the fire prevention and fire safety arrangements provided in the premises found in good working condition. The premises have therefore deemed complied with rule 33 of Delhi Fire Service Rules, 2010 and that the building is fit for occupancy class "**Educational**" (**Group-B**) with effect from 31/01/2024 for a period of **three years** in accordance with rule 36 unless renewal under rule 37 or sooner cancelled under rule 40 and subject to compliance of the conditions under rule 38 of the DFS rule 2010.

Issued on 31/01/2024 at New Delhi by.


(ATUL GARG)
DIRECTOR
DELHI FIRE SERVICE
d/c (W)

Copy to:-

1. The Principal, New Oxford Public School located at B-122 A, B-Block, Vivek Vihar, Delhi-110095.
2. The Dy. Director of Education, D- Block, Anand Vihar, Delhi.

Conditions for the validity of Fire Safety Certificate

1. The owner /occupier shall apply for renewal of this fire safety certificate to the Director in form 'J' [sub rule(1) of rule 37] along with a copy of this certificate, six months prior to its expiry
2. All the means of escape shall be kept free of all the type of obstruction all the time.
3. All the employees shall be acquainted with the use and maintenance of all fire equipments and method of smooth and speedy safe evacuation of occupants in case of emergency.
4. All the fire fighting equipments shall be maintained in perfect working condition all the time and any lapse rendering non-functional of fire safety measures, management shall be responsible.
5. The clarification with regards electrical installation, ventilation, structure stability set back areas, occupancy and constructional deviation in building etc .may be got verified from the authorities concerned.
6. This Fire Safety Certificate cannot be treated in any case for regularizations of unauthorized construction unauthorized use of land if any.
7. The owner / occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rule 2010. The form is available on www.dfs.delhigovt.nic.in.

INSPECTION REPORT					
01.	Name & address of the building	New Oxford Public School located at B-122 A, B-Block, Vivek Vihar, Delhi-110095.			
02.	Building is comprised of	G + 02 upper floors (School is running on ground & first floor)			
03.	Type of occupancy	Group B - Educational Building			
04.	Type of case	Renewal			
05.	Details of previous FSC	F6/DFS/MS/School/2021/NDZ/816 dated 06/10/2021.			
06.	Fire safety directives letter no.	Circular no. 262-362 dated 17.01.2005.			
07.	Date of inspection	23/01/2024.			
08.	Name of the inspecting officers	Yashwant Singh Meena ADO (L.N)			
09.	Name of the designation of officer from the building side	Mr. Anoop Minocha (Chairmen)			
10.	Year of construction	2003			
11.	Applicant's letter no.	Email dated 26/10/2023			
S.No	Minimum standard of fire prevention and fire safety U/R 33	Requirement	Provided at site	Remarks MR/NMR	
01.	Access to Building:				
	A	Road width	6.0 mtrs.	10 mtrs.	MR
	B	Gate width	NA	NA	NA
	C	Width of internal road	NA	NA	NA
02.	Number, Width, Type and Arrangement of Exits:				
	A	Number of staircases			
	a	Upper floor	01 nos.	02 nos.	MR
	b	Basement	NA	NA	NA
	B	Width of staircases			
	a	Upper floor	1.50 mtrs	1.40 mtrs & 1.10 mtrs.	MR
	b	Basement	NA	NA	NA
	C	Protection of exits			
	a	Fire check door	NA	NA	NA
	b	Pressurization	NA	NA	NA
	D	No. of continuous staircases to terrace	01 no.	01 nos.	MR
	E	Width of corridor	1.50 mtrs.	1.50 mtrs.	MR
	F	Door size	01 mtrs	01 mtrs	MR
03.	Compartmentation:				
	A	Fire check door	NA	NA	NA
	B	Sealing of electrical shafts	NA	NA	NA
	C	Fire rating of shaft door	NA	NA	NA
	D	Water curtain	NA	NA	NA
	E	Fire dampers	NA	NA	NA
04.	Smoke Management System:				
	A	Basement	NA	NA	NA
	B	Upper floor	NA	NA	NA

05.	Fire Extinguisher:				
	A	Total numbers	04 nos.	06 nos.	MR
	B	Types	ABC/CO ₂	ABC/CO ₂	MR
	C	ISI marking	ISI Marked	ISI Marked	MR
06.	First-Aid-Hose Reel:				
	A	Total numbers of each floor	01 no.	01 no.	MR
	B	Length of hose reel hose	30 mtrs.	30 mtrs.	MR
	C	Nozzle diameter	05 mm	05 mm	MR
07.	Automatic Fire Detection and Alarming System:				
	A	Type of detectors	NA	NA	NA
	B	Location of main panel	NA	NA	NA
	C	Location of repeater panel	NA	NA	NA
	D	Alternate source of power	NA	NA	NA
	E	Hooters	NA	NA	NA
08.	MOEFA:				
			NA	NA	NA
09	Public Address System:				
			NA	NA	NA
10.	Automatic Sprinkler System:				
	A	Basement	NA	NA	NA
	B	Upper floor	NA	NA	NA
	C	Sprinkler above false ceiling	NA	NA	NA
11.	Internal Hydrants:				
	A	Size of riser/down-comer	NA	NA	NA
	B	Number of hydrants per floor	NA	NA	NA
	C	Hose box	NA	NA	NA
12.	Yard Hydrants:				
	A	Total number of hydrants	NA	NA	NA
	B	Hose box	NA	NA	NA
13.	Pumping Arrangements:				
1	Ground level				
	A	Discharge of main pump	NA	NA	NA
	B	Head of main pump	NA	NA	NA
	C	Number of main pumps	NA	NA	NA
	D	Jockey pump out put	NA	NA	NA
	E	Jockey pump head	NA	NA	NA
	F	Standby pump out put	NA	NA	NA
	G	Standby pump head	NA	NA	NA
	H	Auto starting /manual stopping	NA	NA	NA
	I	Pump house access	NA	NA	NA
2	Terrace Level				
	A	Discharge of pump	220 LPM	450 LPM	MR
	B	Head of the pump	40 mtrs.	40 mtrs.	MR
	C	Power supply	Required	Provided	MR
	D	Auto starting of pump	Required	Provided	MR


W

su

14. Captive Water Storage for Fire Fighting:				
A	Underground tank capacity	NA	NA	NA
B	Draw-off connection	NA	NA	NA
C	Fire service inlet	NA	NA	NA
D	Access to tank	NA	NA	NA
E	Overhead tank capacity	25,00 liters.	5,000 liters.	MR
15. Exit Signage:		Required	Provided	MR
16. Provision of Lifts:				
A	Pressurization of lift shaft	NA	NA	NA
B	Pressurization of lift lobby	NA	NA	NA
C	Communication in lift car	NA	NA	NA
D	Firemen's grounding switch	NA	NA	NA
E	Lift signage	NA	NA	NA
17. Standby Power Supply:		NA	NA	NA
18. Refuge Area:				
A	Total area	NA	NA	NA
B	Location	NA	NA	NA
19. Fire Control Room:				
A	Detector system panel	NA	NA	NA
B	Flow switch panel	NA	NA	NA
C	PA system panel	NA	NA	NA
D	Battery backup	NA	NA	NA
E	Building floor plans	NA	NA	NA
20. Special Fire Protection systems for protection of special Risks, if any:		NA	NA	NA

The fire protection systems provided in the building were tested, checked at random and found functional at the time of inspections.

Keeping in view of the deemed compliance of minimum standards of fire prevention and fire safety measures as required in Directorate of Education Circular no. 262-362 dated 17.01.2005, the ESC issued vide letter no. F6/DFS/MS/School/2021/NDZ/816 dated 06/10/2021 is recommended to be renewed.


24/7/2024

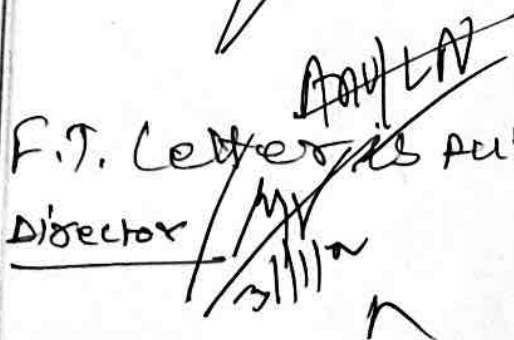
Signature of the Inspecting Officer
Name: - Yashwant Singh Meena
Designation: - ADO (L.N)

Dy. CFO (NDZ)


C.F.O. 
29/01/2024
Director 
30/1/24

F.T. Letter is setup for sign. Please

Director


31/1/24


30/1/2024