

C19

FORM 'H'
FORM FOR ISSUING FIRE SAFETY CERTIFICATE
[Refer sub - rule (1) of rule 35]
GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEAD QUARTERS: DELHI FIRE SERVICE, CONNAUGHT PLACE
NEW DELHI


No.F6/DFS/MS/SZ/2024/School/73

Dated: 30/01/2024

FIRE SAFETY CERTIFICATE

Certified that building of Paramount International School Located at Sector 23, Dwarka, New Delhi - 110075 comprised of Ground + 04 Upper Floors was issued FSC vide Letter No. F6/DFS/MS/School/2023/SZ/19, dated 06/01/2023 (Issued to G+3UF) owned / occupied by Paramount International School have complied with the fire prevention and fire safety requirements in accordance with Rule 33 of the Delhi Fire Service Rule, 2010 and verified by the team of officers concerned of this department on 08/01/2024 in the presence of Sh. Saket (Owner) and found that the said building is fit for occupancy class "Educational" Group B Sub Division B - 1 with effect from 30/01/2024 for a period of three years in accordance with Rule 36 unless renewed under Rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under Rule 38 of the Delhi Fire Service Rules, 2010.

Issued on 30/01/2024.... at New Delhi.


(Atul Garg)
Director
Delhi Fire Services
b/c


Copy to:

1. The Principal, Paramount International School Located at Sector 23, Dwarka, New Delhi - 110075.
2. Directorate of Education Old Secretariat Delhi - 110054.

Following fire safety directives must be adhered to:-

1. All the fire safety arrangements provided therein shall be maintained in good working condition at all times.
2. Any loss of life or property due to non-functional fire safety measures shall be at the risk and responsibility of the management.
3. The trained staff should be available round the clock.
4. Any deviations w.r.t. construction shall be verified by the concerned building sanctioning agency.
5. The certificate may not be treated in any case for the regularization of the unauthorized construction, if any.
6. Basement shall be used strictly as per building bye laws.
7. The owner/occupier shall submit a declaration every year in the form 'K' provided in the first schedule of Delhi Fire Service Rules 2010, form is available on www.dfs.delhigovt.nic.in.
8. The owner/ occupier shall apply for renewal of this Fire Safety Certificate to the Director in Form 'J' [sub rule (1) of rule 37] along with a copy of this certificate, six months prior to its expiry.

N/5

INSPECTION REPORT

1. Name & address of the building: Paramount International School Located at Sector 23, Dwarka, New Delhi - 110075.
2. Type of Occupancy : Educational (Ground+4 Upper Floor)
3. Type of Case : New Case / Addition/Alteration
4. Details of previous NOC: F6/DFS/MS/School/2023/SZ/19, dated 06/01/2023
(Issued to G+3 UFS)
5. Fire Safety directives L. No: F6/DFS/MS/BP/2004/2202, dated 24/09/2004 &
F6/DFS/MS/BP/2018/School/32 Dated 31/10/2018
6. Date of inspection : 08-01-2024
7. Name of the Inspecting Officer :DO/SW & ADO (DWK)
8. Name and designation of Officer
from the building side : Sh. Saket (Owner)
9. Year of Construction : 2007 & 2018
10. Applicant's letter No. : Email Dated 26/12/2023

Total Area = 8116 sqm. Covered Area = 1620 sqm Class rooms = 103 App. No. of students = 2507

S No	Minimum standards on fire prevention and fire safety U/R 33	As per NBC	Provided at site	Remarks MR/NMR
1.	Access of building			
	• Road width	06mtrs	Provided	MR
	• Gate width	6 mtrs	Provided	MR
	• Width of internal road	6m	Provided	MR
2.	Number, width, Type & Arrangements of exits			
	a. Number of staircases			
	• Upper floors	02 Nos.	5 Provided	MR
	• Basements	NA	NA	NA
	b. Width of staircases			
	• Upper floors	1.5m	Provided	MR
	• Basements	NA	NA	NA
	c. Protection of exits			
	• Fire check door	Required	Provided	MR
	• Pressurization	NA	NA	NA
	d. No of continuous staircase to terrace	Required	Provided	MR
	e. Width Of Corridor	1.5 m	Provided	MR
	f. Door Size	01 mtr	Provided	MR
3.	Compartmentation			
	• Fire check door	NA	NA	NA
	• Sealing of electrical shafts	NA	NA	NA
	• Fire Rating of shaft door	NA	NA	NA
	• Water Curtain	NA	NA	NA
	• Fire Dampers	NA	NA	NA


4.	Smoke managements System			
	• Basements	NA	NA	NA
	• Upper floors	12 a/c charge per hour	Natural ventilation	MR
5.	Fire Extinguishers			
	• Total numbers	17 nos.	43 Nos.	MR
	• Types	ABC & CO ₂	DCP, CO ₂ & Water	MR
	• IS marking	ISI marked	Provided	MR
6.	First - Aid Hose Reels			
	• Total numbers on each floor	03 Nos.	Provided	MR
	• Length of hose reel hose	30m	Provided	MR
	• Nozzle diameter	5mm	Provided	MR
7.	Automatic fire detection and alarming system			
	• Type of detectors	NA	NA	NA
	• Location of Main Panel	NA	NA	NA
	• Location of Repeater Panel	NA	NA	NA
	• Alternate source of power	NA	NA	NA
	• Hooters' Location	NA	NA	NA
8.	MOEFA	Required.	Provided	MR
9.	Public Address System	Required	Provided	MR
10.	Automatic Sprinkler System			
	• Basements	NA	NA	NA
	• Upper Floor	NA	NA	NA
	• Sprinkler above false ceiling	NA	NA	NA
11.	Internal Hydrants:			
	• Size of riser/down- comer	100 mm	Provided	MR
	• Number of hydrants per floor	3 Nos.	Provided	MR
	• Hose Box	3 Nos.	Provided	MR
12.	Yard Hydrants			
	• Total number of hydrants	Required	Provided	MR
	• Hose Box	Required	Provided	MR
13.	Pumping Arrangements:			
	• Ground Level	NA	NA	NA
	• Discharge of main pump	NA	NA	NA
	➤ Head of main pump	NA	NA	NA
	➤ Number of main pumps	NA	NA	NA
	➤ Jockey pump out put	NA	NA	NA
	➤ Jockey pump head	NA	NA	NA
	➤ Standby Pump out put	NA	NA	NA
	➤ Standby Pump Head	NA	NA	NA
	➤ Auto Staring/Manual stopping	NA	NA	NA
	➤ Pump House Access	NA	NA	NA
	• Terrace level	900 lpm	Provided	MR
	➤ Discharge of pump	40Mtr	Provided	MR
	➤ Head of the pump	Required	Provided	MR
	➤ Power supply	Required	Provided	MR
	➤ Auto starting of pump	Required	Provided	MR
14.	Captive water Storage for fire fighting:			
	• Underground tank capacity	50000 ltr	Provided	MR
	➤ Draw off connection	Required	Provided	MR
	➤ Fire service inlet	Required	Provided	MR
	➤ Access to tank	Required	Provided	MR
	• Overhead Tank capacity	25000 L	Provided	MR


N/7


15	Exit Signage	Required	Provided	MR
16.	Provision of Lifts			
	➤ Pressurization of Lift Shaft	Required	Provided	MR
	➤ Pressurization of lift lobby	NA	NA	NA
	➤ Communication in lift Car	Required	Provided	MR
	➤ Fireman's Grounding Switch	Required	Provided	MR
	➤ Lift Signage	Required	Provided	MR
17.	Standby power supply	Required	DG Set	MR
18.	Refuge Area			
	➤ Total area	NA	NA	NA
	➤ Location	NA	NA	NA
19.	Fire control room			
	1. Detector system panel	NA	NA	NA
	2. Flow Switch Panel	NA	NA	NA
	3. PA System Panel	Required	Provided	MR
	4. Battery backup	Required	Provided	MR
	5. Building Floor Plans	Required	Provided	MR
20.	Special Fire Protection Systems for Protection of special Risks, if any;	NA	NA	NA

The fire protection systems provided in the building were test checked and found functional at the time of inspection.

Keeping in view the substantial compliance of the minimum standards on fire prevention and fire safety required under the rules it is recommended to grant Fire Safety Certificate under Rule 35 of the Delhi Fire Service Rules 2010.


 17/1/24
 Signature of the Inspecting Officer
 Name: Sh. Vedpal
 Designation: DO/SW

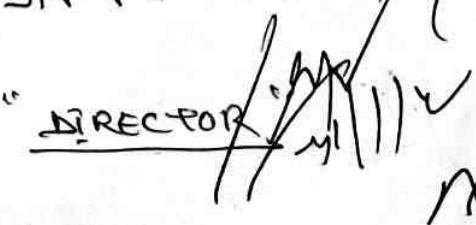

 16/1/24
 Signature of the Inspecting Officer
 Name: Udai Vir Singh
 Designation: ADO/DWK


 17/01/2024


 18/1/24



Sir FY letter is put up for sig pls


 DIRECTOR
 21/1/24


 25/1/24