

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE: NEW DELHI- 110001



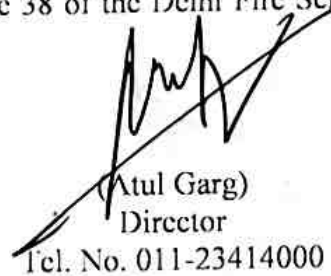
No. F6/DFS/MS/WZ/I/2024/35

Dated:- 02/02/2024

FIRE SAFETY CERTIFICATE

Certified that the M/s. Crème & Crisp (A Unit of KLV Enterprises) Located at Property No. 08, Block A-6, Paschim Vihar, Delhi-110063 is running at Ground Floor only in a building comprised of Ground + 03 Upper Floors owned/ occupied by M/s. KLV Enterprises have complied with the fire prevention and fire safety requirements in accordance with Rule 33 of the Delhi Fire Service Rule, 2010 and verified by the officer concerned of this department on 25/01/2024 in the presence of Sh. Manish Hooda (Manager) and that the premises is fit for occupancy class "Assembly" Group D (Restaurant) for Ground Floor only with effect from 02/02/2024 for a period of three years in accordance with Rule 36 unless renewed under Rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under Rule 38 of the Delhi Fire Service Rules, 2010, printed below.

Issued on 02/02/2024 at New Delhi by.


(Atul Garg)
Director
Tel. No. 011-23414000

Copy to:-

1. The Joint Commissioner of Police (Lic), 1st Floor, Licensing Unit, Police Station, Defence Colony, New Delhi
2. The Dy. Health Officer, Keshav Puram Zone, NDMC, Public Health Department, A-1 Block Keshav Puram Zone, Delhi.
3. Sh. Prankul Aggarwal, M/s. KLV Enterprises, Property No. 08, Block A-6, Paschim Vihar, Delhi-110063.

Following fire safety directives must be adhered to:-

1. This FSC is valid for Ground Floor only.
2. All the means of escape shall be kept free of all type of obstruction all the time.
3. All the employees shall be acquainted with the use and maintenance of all fire equipments and method of smooth and speedy safe evacuation of occupants in case of emergency.
4. All the fire fighting equipments shall be maintained in perfect working condition all the time and any lapse rendering non-functional if fire safety measures, management shall be responsible.
5. Any deviation, with regards to construction, ventilation, occupation, electric installation etc. may be got verified from the concerned authorities.
6. The Fire Safety Certificate may not be treated in any case for regularizations of unauthorized construction / unauthorized use of land if any.
7. All comments / directions of licensing Department shall always be permitted and followed.
8. The owner / occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rule 2010. The form is available on www.dfs.delhigovt.nic.in
9. The owner / occupier shall apply for renewal of this Fire Safety Certificate to the Director in 'Form J' (sub Rule (1) of Rule 37) along with copy of the certificate, six months prior to its expiry.

INSPECTION REPORT

1. Name & address of the building : M/s. Crème & Crisp (A Unit of KLV Enterprises),
located at Property No. 08, Block A-6, Paschim Vihar,
Delhi-110063.
2. Type of Occupancy : Assembly, (Restaurant at Ground Floor)
3. Type of Case : New
4. Details of previous NOC : Nil
5. Fire Safety directives letter No : As per UBBL/NBC (Part-IV)
6. Date of inspection : 25/01/2024
7. Name of the Inspecting Officers : Aman Kumar Lathar, ADO (JWP)
8. Name and designation of officers
from the building side : Sh. Manish Hooda (Manager)
9. Year of Construction : 2002 (as per details upload on MHA portal)
10. Applicant's Online ID- : 2024010800201 dated 22/01/2024

GF	: Restaurant
1 st & 2 nd	: Vacant
3 rd Floor	: Malik Hospital

The said restaurant is running at Ground Floor in a building comprised of Ground Plus Three Upper Floors only.

S. No	Minimum Standards on fire prevention and fire safety U/R 33	UBBL/NBC-IV requirements	Provided at site	Remarks MR/NMR
1	Access to building			
	• Road width	06 m	Provided	MR
	• Gate width	4.5 m	Direct accessible from road	MR
	• Width of internal road	N/A	N/A	N/A
2	Number, Width, Type & Arrangement of Exits			
	a. Number of staircases	-----	-----	-----
	• Upper Floors	N/A	N/A	N/A
	• Basements	N/A	N/A	N/A
	b. Width of staircases	-----	-----	-----
	• Upper Floors	N/A	N/A	N/A
	• Basements	N/A	N/A	N/A
	c. Protection of exits	-----	-----	-----
	• Fire check door	N/A	N/A	N/A
	• Pressurization	N/A	N/A	N/A
	e. No. of continuous staircases to terrace	N/A	N/A	N/A
	g. Width of Corridor	N/A	N/A	N/A
	h. Door Size	1.5 m x 2	Provided	MR
3	Compartmentation.			
	• Fire check door	N/A	N/A	N/A
	• Sealing of electrical shafts	N/A	N/A	N/A
	• Fire Rating of shaft door	N/A	N/A	N/A
	• Water Curtain	N/A	N/A	N/A
	• Fire Dampers	N/A	N/A	N/A
4	Smoke Management System.			
	• Basements	NA	N/A	N/A
	• Upper floors	Required	Natural ventilation	MR

14

5	Fire Extinguishers			
	• Total numbers	04 Nos.	Provided	MR
	• Types	ABC, CO ₂ type	Provided	MR
	• IS marking	ISI marked	Provided	MR
6	First-Aid Hose Reels.			
	• Total numbers on each floor	01	Provided	MR
	• Length of hose reel hose	30 m	Provided	MR
	• Nozzle diameter	5 mm	Provided	MR
7	Automatic fire detection and alarming system			
	• Type of detectors	N/A	N/A	N/A
	• Location of Main Panel	N/A	N/A	N/A
	• Location of Repeater Panel	N/A	N/A	N/A
	• Alternate source of power	N/A	N/A	N/A
	• Hooters' Location	N/A	N/A	N/A
8	MOEFA	Required	Provided	MR
9	Public Address System.	N/A	N/A	N/A
10	Automatic Sprinkler System			
	• Basement	N/A	N/A	N/A
	• Upper floors	N/A	N/A	N/A
	• Sprinkler above false ceiling	N/A	N/A	N/A
11	Internal Hydrants			
	• Size of riser/down-comer	100 mm	Provided	MR
	• Number of hydrants per floor	01	Provided	MR
	• Hose Box	Required	Provided	MR
12	Yard Hydrants.			
	• Total number of hydrants	N/A	N/A	N/A
	• Hose Box	N/A	N/A	N/A
13	Pumping Arrangements			
	• Ground Level	---	----	-----
	➤ Discharge of main Pump	N/A	N/A	N/A
	➤ Head of Main pump	N/A	N/A	N/A
	➤ Number of main pumps	N/A	N/A	N/A
	➤ Jockey Pump out put	N/A	N/A	N/A
	➤ Jockey pump head	N/A	N/A	N/A
	➤ Standby Pump out put	N/A	N/A	N/A
	➤ Standby Pump Head	N/A	N/A	N/A
	➤ Auto Starting/ Manual stopping	N/A	N/A	N/A
	➤ Pump House Access	N/A	N/A	N/A
	• Terrace level	----	-----	-----
	➤ Discharge of pump	450 L.PM	Provided	MR
	➤ Head of the pump	40 mts	Provided	MR
	➤ Power Supply	Required	Provided	MR
	➤ Auto Starting of pump	Required	Provided	MR

Captive Water Storage for fire fighting

	<ul style="list-style-type: none"> • Underground tank capacity 	N/A	N/A	N/A
	<ul style="list-style-type: none"> ➤ Draw-off connection 	N/A	N/A	N/A
	<ul style="list-style-type: none"> ➤ Fire service inlet 	N/A	N/A	N/A
	<ul style="list-style-type: none"> ➤ Access to tank 	N/A	N/A	N/A
	<ul style="list-style-type: none"> • Overhead Tank capacity 	20,000 ltrs.	Provided	MR
15	Exit Signage.	Required	Provided	MR
16	Provision of Lifts.			
	<ul style="list-style-type: none"> • Pressurization of Lift Shaft 	N/A	N/A	N/A
	<ul style="list-style-type: none"> • Pressurization of Lift lobby 	N/A	N/A	N/A
	<ul style="list-style-type: none"> • Communication In lift Car 	N/A	N/A	N/A
	<ul style="list-style-type: none"> • Fireman's Grounding Switch 	N/A	N/A	N/A
	<ul style="list-style-type: none"> • Lift Signage 	N/A	N/A	N/A
17	Standby power supply	Required	Provided	MR
18	Refuge Area.			
	<ul style="list-style-type: none"> ➤ Total Area 	N/A	N/A	N/A
	<ul style="list-style-type: none"> ➤ Location 	N/A	N/A	N/A
19	Fire Control Room			
	<ul style="list-style-type: none"> • Detector System Panel 	N/A	N/A	N/A
	<ul style="list-style-type: none"> • Flow Switch Panel 	N/A	N/A	N/A
	<ul style="list-style-type: none"> • PA System Panel 	N/A	N/A	N/A
	<ul style="list-style-type: none"> • Batter backup 	N/A	N/A	N/A
	<ul style="list-style-type: none"> • Building Floor Plans 	N/A	N/A	N/A
20	Special Fire Protection Systems for Protection of special Risks, if any:	N/A	N/A	N/A

The fire protection systems provided in the building were checked and found functional at the time of inspection.

Keeping in view of the substantial compliance of the minimum standards of fire prevention and fire safety requirement under the rules, grant of Fire Safety Certificate is recommended under rule 35 of the Delhi Fire Service Rules, 2010 under the DFS Act, 2009.

Accordingly, IT letter is prepared & put up for approval please.

DCFO(w2)

Apurva
25/01/24

Aman Kumar Lathar
Asst. Divisional Officer (Jwalapuri)

FOI...147
Deloc...29/1/2024

[Signature]
29/1/2024

pubson

[Signature]
30/01/2024

[Signature]
31/01/24

[Signature]

Utkarsh
02/02/24