

219



**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI**  
**HEADQUARTERS: DELHI FIRE SERVICE: NEW DELHI- 110001**



No. F6/DFS/MS/2024/School/ 185

Dated: 07/03/2024

**FIRE SAFETY CERTIFICATE**

Certified that the **CIE Experimental Basic School** located at **33, Chatra Marg, Departmental of Education, Delhi University, Delhi-110007** comprised of **Ground Floor & First Floor Only** owned/ occupied by **CIE Experimental Basic School** have complied with the fire prevention and safety requirements in accordance with requirements of circular issued by Director of Education letter no 262-362 dated 17.01.2005 and verified by the officer concerned of this department on **19.02.2024** in the presence of **Smt. Neelam Babbar (H.O.S)** and that the building/premises is fit for occupancy "**Group B Educational**" with effect from **...07/03/2024** for a period of three years, subject to compliance of the conditions mentioned below:

Issued on **...07/03/2024..** at New Delhi

  
 (Atul Garg)  
 Director  
 Ph:-011-23414000  
 SK

Copy to: -

1. The Director, Education, Government of N.C.T of Delhi. Old Sectt. Delhi – 110054.
2. The Principal, CIE Experimental Basic School at 33, Chatra Marg, Departmental of Education, Delhi University, Delhi-110007.

**Conditions for the validity of Fire Safety Certificate:**

1. All the means of escape/entry/exit shall be kept free from any obstruction.
2. All the fire safety arrangements provided therein shall be maintained in good working condition at all time as seen during inspection.
3. Any loss of life or property due to non-functional fire safety measures shall be at the responsibility of the management.
4. All the staff members must know the correct method of operation of firefighting system.
5. The owner / occupier shall submit a declaration **every year** in **Form "K"** provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on <http://delhi.gov.in/wps/wcm/connect/doi/fire/FIRE/Home/Forms>.
6. This fire safety certificate may not in any way be treated as regularization (Clause 2.8 of UBBL-2016) of unauthorized construction or Alteration (Clause 1.4.3 of UBBL-2016), if any.
7. "The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in **Form 'J'** [sub rule (1) of rule 37] along with a copy of this Certificate, **six months** prior to its expiry".

N19  
**INSPECTION REPORT**

1. Name & address of the building : CIE Experimental and Basic School at 33, Chatra Marg, Departmental of Education, Delhi University, Delhi-110007.
2. Composition of Building : Ground Floor & First Floor only
3. Type of Occupancy : Educational
4. Type of Case : New Case
5. Details of previous NOC : Nil
6. Fire Safety directives letter No : Director of Education Circular No. 262-362 dated 17.01.2005
7. Date of inspection : 13.02.2024
8. Name of the Inspecting Officers : ADO (RN)
9. Name and designation of officers from the building side : Smt. Neelam Babbar (H.O.S)
10. Year of Construction : --
11. Applicant's letter No. : Letter No. Nil & DFS Dairy No.12787 dated: 07.02.2024

Covered Area- not confirm      No. of class rooms -19 nos.      No of students---237 nos.

	Minimum Standards on fire prevention and fire safety U/R 33	Director of Education dated 17.01.2005 requirements	Provided at site	Remarks MR/NMR
1	<b>Access to building</b>			
	• Road width	Accessible	Accessible	MR
	• Gate width	Directly Accessible	Directly Accessible	MR
	• Width of internal road	NA	NA	NA
2	<b>Number, Width, Type &amp; Arrangement of Exits</b>			
	a. Number of staircases			
	• Upper Floors	02	02	MR
	• Basements	NA	NA	NA
	b. Width of staircases			
	• Upper Floors	1.5m	1.06m & 1.25m	MR
	• Basements	NA	NA	NA
	c. Protection of exits			
	• Fire check door	NA	NA	NA
	• Pressurization	NA	NA	NA
	d. No. of continuous staircases to terrace	NA	NA	NA
	e. Width of Corridor	NA	NA	NA
	f. Door Size	1m	90cm	MR <i>being old case</i>
3	<b>Compartmentation.</b>			
	• Fire check door	NA	NA	NA
	• Sealing of electrical shafts	NA	NA	NA
	• Fire Rating of shaft door	NA	NA	NA
	• Water Curtain	NA	NA	NA
	• Fire Dampers	NA	NA	NA
4	<b>Smoke Management System.</b>			
	• Basements	NA	NA	NA
	• Upper floors	NA	NA	NA
5	<b>Fire Extinguishers</b>			
	• Total numbers	04nos	06nos	MR
	• Types	ABC/CO2	ABC-06	MR
	• ISI marking	ISI Marked	Provided	MR


6	<b>First-Aid Hose Reels.</b>			NA	NA	NA
	<ul style="list-style-type: none"> <li>Total numbers on each floor</li> <li>Length of hose reel hose</li> <li>Nozzle diameter</li> </ul>	NA	NA	NA		
		NA	NA	NA		
		NA	NA	NA		
7	<b>Automatic fire detection and alarming system.</b>			NA	NA	NA
	<ul style="list-style-type: none"> <li>Type of detectors</li> <li>Location of Main Panel</li> <li>Location of Repeater Panel</li> <li>Alternate source of power</li> <li>Hooters' Location</li> </ul>	NA	NA	NA		
		NA	NA	NA		
		NA	NA	NA		
		NA	NA	NA		
		NA	NA	NA		
NA	NA	NA				
8	<b>MOEFA</b>					
9	<b>Public Address System.</b>					
10	<b>Automatic Sprinkler System.</b>			NA	NA	NA
	<ul style="list-style-type: none"> <li>Basement</li> <li>Upper Floor</li> <li>Sprinkler above false ceiling</li> </ul>	NA	NA	NA		
		NA	NA	NA		
		NA	NA	NA		
11	<b>Internal Hydrants</b>			NA	NA	NA
	<ul style="list-style-type: none"> <li>Size of riser/down-comer</li> <li>Number of hydrants per floor</li> <li>Hose Box</li> </ul>	NA	NA	NA		
		NA	NA	NA		
12	<b>Yard Hydrants.</b>			NA	NA	NA
	<ul style="list-style-type: none"> <li>Total number of hydrants</li> <li>Hose Box</li> </ul>	NA	NA	NA		
13	<b>Pumping Arrangements.</b>					
	<ul style="list-style-type: none"> <li>Ground Level <ul style="list-style-type: none"> <li>Discharge of main Pump</li> <li>Head of Main pump</li> <li>Number of main pumps</li> <li>Jockey Pump out put</li> <li>Jockey pump head</li> <li>Standby Pump out put</li> <li>Standby Pump Head</li> <li>Auto Starting/ Manual stopping</li> <li>Pump House Access</li> </ul> </li> </ul>	N/A	N/A	N/A		
		N/A	N/A	N/A		
		N/A	N/A	N/A		
		NA	NA	NA		
		NA	NA	NA		
		N/A	N/A	N/A		
		N/A	N/A	N/A		
		N/A	N/A	N/A		
		N/A	N/A	N/A		
		N/A	N/A	N/A		
	Terrace level <ul style="list-style-type: none"> <li>Discharge of pump</li> <li>Head of the pump</li> <li>Power Supply</li> <li>Auto Starting of pump</li> </ul>	NA	NA	NA		
		NA	NA	NA		
		NA	NA	NA		
NA		NA	NA			
14	<b>Captive Water Storage for fire fighting.</b>					
	<ul style="list-style-type: none"> <li>Underground tank capacity</li> <li>Draw-off connection</li> <li>Fire service inlet</li> <li>Access to tank</li> <li>Overhead Tank capacity</li> </ul>	NA	NA	NA		
		NA	NA	NA		
		NA	NA	NA		
		NA	NA	NA		
		NA	NA	NA		
NA	NA	NA				
15	<b>Exit Signage.</b>			Required	Provided	MR

16	<b>Provision of Lifts.</b>			
	• Pressurization of Lift Shaft	N/A	N/A	N/A
	• Pressurization of Lift lobby	N/A	N/A	N/A
	• Communication In lift Car	N/A	N/A	N/A
	• Fireman's Grounding Switch	N/A	N/A	N/A
	• Lift Signage	N/A	N/A	N/A
17	Standby power supply	N/A	N/A	N/A
18	<b>Refuge Area.</b>			
	➤ Total Area	N/A	N/A	N/A
	➤ Location	N/A	N/A	N/A
19	<b>Fire Control Room</b>			
	• Detector System Panel	N/A	N/A	N/A
	• Flow Switch Panel	N/A	N/A	N/A
	• PA System Panel	N/A	N/A	N/A
	• Batter backup	N/A	N/A	N/A
	• Building Floor Plans	N/A	N/A	N/A
20	Special Fire Protection Systems for Protection of special Risks, if any:	N/A	N/A	N/A

The fire protection systems provided in the building were tested/ checked randomly and found in working condition at the time of inspection. The management has complied all the shortcomings issued and communicated by this department vide letter of even no. F6/DFS/MS/School/2022/577 dated 15.09.2022.



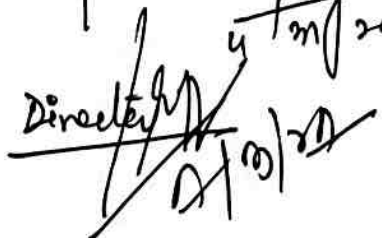
Keeping in view the satisfactory compliance of the minimum standard on fire prevention and fire safety requirements as stipulated under the circular issued by Director of Education dated 17.01.2005, it is recommended to grant Fire Safety Certificate.

Dy. Chief Fire Officer (WZ)

  
 Signature of the Inspecting Officer  
 Name:- C.L. Meena  
 Designation:- Asst. Div. Officer (RN)

FO/ 630  
 dated 1/13/2024

  
 01/03

  
  
  
 01/03/2024

  
 ADY KV