



No. F6/DFS/MS/School/NDZ/2024/181


Dated: 07/03/2024

C-45

### FIRE SAFETY CERTIFICATE

Certified that the New Oxford Public School located at B-122 A, B - Block, Vivek Vihar, Delhi-110095, comprised of Ground plus two upper floors only (Earlier FSC was issued for Ground plus one upper floor only by this department vide letter No. F6/DFS/MS/School/2024/NDZ/78 dated 31.01.2024), have complied with fire prevention & fire safety requirements in accordance with 33 of the Delhi Fire Service Rules, 2010/ NBC Part - IV and verified by the officer concerned of Fire Service on 29.02.2024 in presence of Mr. Anoop Minocha (Chairmen) and that the building /premises is fit for occupancy class "Educational Building" Group - B, ground plus two upper floors with effect from 07/03/2023 for a period of three years in accordance with rule 36 unless renewal under rule 37 or sooner cancelled under rule 40 and subject to compliance of the conditions under rule 38 of the DFS rule 2010.

Issued on 07/03/2023 at New Delhi by.

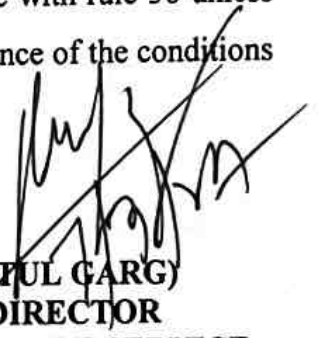  
(ATUL GARG)  
DIRECTOR  
DELHI FIRE SERVICE

#### Copy to:-

1. The Director of Education, B- Block, Anand Vihar, Delhi.
2. The Principal, New Oxford Public School located at B-122 A, B - Block, Vivek Vihar, Delhi-110095.

#### Conditions for the validity of Fire Safety Certificate

1. The owner /occupier shall apply for renewal of this fire safety certificate to the Director in form 'J' [sub rule(1) of rule 37] along with a copy of this certificate, six months prior to its expiry
2. All the means of escape shall be kept free of all the type of obstruction all the time.
3. All the employees shall be acquainted with the use and maintenance of all fire equipments and method of smooth and speedy safe evacuation of occupants in case of emergency.
4. All the fire fighting equipments shall be maintained in perfect working condition all the time and any lapse rendering non-functional of fire safety measures, management shall be responsible.
5. The clarification with regards electrical installation, ventilation, structure stability set back areas, occupancy and constructional deviation in building etc .may be got verified from the authorities concerned.
6. This Fire Safety Certificate cannot be treated in any case for regularizations of unauthorized construction unauthorized use of land if any.
7. The owner / occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rule 2010. The form is available on [www.dfs.delhigovt.nic.in](http://www.dfs.delhigovt.nic.in).

N/17

### INSPECTION REPORT

1	Name & address of the building	New Oxford Public School located at B-122 A, B - Block, Vivek Vihar, Delhi-110095.
2	Building is comprised of	Ground + 02 upper floors only.
3	Type of occupancy	Educational Building
4	Type of case	New (Alteration Of 02 floors on existing Ground + 01 upper floors)
5	Details of previous FSC	F6/DFS/MS/School/2024/NDZ/78 dated 31.01.2024 <b>Ground + 01 Upper floor.</b>
6	Fire safety directives letter no.	Circular No. 262 - 362 dated 17.01.2005.
7	Date of inspection	29.02.2024.
8	Name of the inspecting officers	Yashwant Singh Meena ADO (L.N)
9	Name of the designation of officer from the building side	Mr. Anoop Minocha (Chairmen)
10	Year of construction	2003 &
11	Applicant's letter no.	Email dated 21/02/2024

S.No	Minimum standard of fire prevention and fire safety U/R 33	As per Circular requirement	Provided at site	Remarks MR/NMR
------	--	-----------------------------	------------------	----------------

1	<b>Access to Building:</b>				
	A	Road width	6.0 mtrs.	6.0 mtrs.	MR
	B	Gate width	N/A	N/A	N/A
	C	Width of internal road	N/A	N/A	N/A

2	<b>Number, Width, Type and Arrangement of Exits:</b>				
	A	Number of staircases			
	a	Upper floor	02 no.	02 nos.	MR
	b	Basement	N/A	N/A	N/A
	B	Width of staircases			
	a	Upper floor	1.50 mtrs.	1.40 mtrs. & 1.10 mtrs	MR (Accepted old case)
	b	Basement	N/A	N/A	N/A
	C	Protection of exits			
	a	Fire check door	N/A	N/A	N/A
	b	Pressurization	N/A	N/A	N/A
	D	No. of continuous staircases to terrace	01 nos.	01 nos.	MR
	E	Width of corridor	1.50 mtrs.	1.50 mtrs.	MR
F	Door size	1.0 mtrs.	1.0 mtrs.	MR	

3	<b>Compartmentation:</b>				
	A	Fire check door	NA	NA	NA
	B	Sealing of electrical shafts	N/A	N/A	N/A
	C	Fire rating of shaft door	N/A	N/A	N/A
	D	Water curtain	N/A	N/A	N/A
	E	Fire dampers	N/A	N/A	N/A

4	<b>Smoke Management System:</b>				
	A	Basement	N/A	N/A	N/A
	B	Upper floor	N/A	N/A	N/A

(w)


<b>5.</b>	<b>Fire Extinguisher:</b>				
	<b>A</b>	Total numbers	06 nos.	08 nos. /	MR
	<b>B</b>	Types	CO <sub>2</sub> & ABC	CO <sub>2</sub> & ABC	MR
	<b>C</b>	ISI marking	ISI Marked	Provided	MR
<b>6</b>	<b>First-Aid-Hose Reel:</b>				
	<b>A</b>	Total numbers of each floor	01 no.	01 no. /	MR
	<b>B</b>	Length of hose reel hose	30 mtrs.	30 mtrs.	MR
	<b>C</b>	Nozzle diameter	05 mm	05 mm	MR
<b>7</b>	<b>Automatic Fire Detection and Alarming System:</b>				
	<b>A</b>	Type of detectors	N/A	N/A	N/A
	<b>B</b>	Location of main panel	N/A	N/A	N/A
	<b>C</b>	Location of repeater panel	N/A	N/A	N/A
	<b>D</b>	Alternate source of power	N/A	N/A	N/A
	<b>E</b>	Hooters	N/A	N/A	N/A
<b>8</b>	<b>MOEFA:</b>		N/A	N/A	N/A
<b>9</b>	<b>Public Address System:</b>		N/A	N/A	N/A
<b>10</b>	<b>Automatic Sprinkler System:</b>				
	<b>A</b>	Basement	N/A	N/A	N/A
	<b>B</b>	Upper floor	N/A	N/A	N/A
	<b>C</b>	Sprinkler above false ceiling	N/A	N/A	N/A
<b>11</b>	<b>Internal Hydrants:</b>				
	<b>A</b>	Size of riser/down-comer	N/A	N/A	N/A
	<b>B</b>	Number of hydrants per floor	N/A	N/A	N/A
	<b>C</b>	Hose box	N/A	N/A	N/A
<b>12</b>	<b>Yard Hydrants:</b>				
	<b>A</b>	Total number of hydrants	N/A	N/A	N/A
	<b>B</b>	Hose box	N/A	N/A	N/A
<b>13</b>	<b>Pumping Arrangements:</b>				
<b>1</b>	<b>Ground level</b>				
	<b>A</b>	Discharge of main pump	N/A	N/A	N/A
	<b>B</b>	Head of main pump	N/A	N/A	N/A
	<b>C</b>	Number of main pumps	N/A	N/A	N/A
	<b>D</b>	Jockey pump out put	N/A	N/A	N/A
	<b>E</b>	Jockey pump head	N/A	N/A	N/A
	<b>F</b>	Standby pump out put	N/A	N/A	N/A
	<b>G</b>	Standby pump head	N/A	N/A	N/A
	<b>H</b>	Auto starting /manual stopping	N/A	N/A	N/A
	<b>I</b>	Pump house access	N/A	N/A	N/A
<b>2</b>	<b>Terrace Level</b>				
	<b>A</b>	Discharge of pump	450 LPM	450 LPM	MR
	<b>B</b>	Head of the pump	40 mtrs.	40 mtrs.	MR
	<b>C</b>	Power supply	Required	Provided	MR
	<b>D</b>	Auto starting of pump	Required	Provided	MR

<b>14</b>	<b>Captive Water Storage for Fire Fighting:</b>			
<b>A</b>	Underground tank capacity	N/A	N/A	N/A
<b>B</b>	Draw-off connection	N/A	N/A	N/A
<b>C</b>	Fire service inlet	Required	Provided	MR
<b>D</b>	Access to tank	Required	Provided	MR
<b>E</b>	Overhead tank capacity	10,000 ltrs	10,000 ltrs	MR
<b>15</b>	<b>Exit Signage:</b>	Required	Provided	MR
<b>16</b>	<b>Provision of Lifts:</b>			
<b>A</b>	Pressurization of lift shaft	N/A	N/A	N/A
<b>B</b>	Pressurization of lift lobby	N/A	N/A	N/A
<b>C</b>	Communication in lift car	N/A	N/A	N/A
<b>D</b>	Firemen's grounding switch	N/A	N/A	N/A
<b>E</b>	Lift signage	N/A	N/A	N/A
<b>17</b>	<b>Standby Power Supply:</b>	N/A	N/A	N/A
<b>18</b>	<b>Refuge Area:</b>			
<b>A</b>	Total area	N/A	N/A	N/A
<b>B</b>	Location	N/A	N/A	N/A
<b>19</b>	<b>Fire Control Room:</b>			
<b>A</b>	Detector system panel	N/A	N/A	N/A
<b>B</b>	Flow switch panel	N/A	N/A	N/A
<b>C</b>	PA system panel	N/A	N/A	N/A
<b>D</b>	Battery backup	N/A	N/A	N/A
<b>E</b>	Building floor plans	N/A	N/A	N/A
<b>20</b>	<b>Special Fire Protection systems for protection of special Risks, if any:</b>	N/A	N/A	N/A

• Although, the school building was comprised of ground plus two upper floors but the FSC was issued for ground plus one upper floor only. Now the management has requested for ground plus two upper floors.

The fire protection systems provided in the building were tested, checked at random and found functional at the time of inspections.

Keeping in view of the substantial compliance of the minimum standards on fire prevention and fire safety measures as required under the Rules, it is recommended to grant Fire Safety Certificate under Rules 37 of Delhi Fire Service Rules 2010.



01/31/2024

Signature of the Inspecting Officer  
Name- Yashwant Singh Meena  
Designation- ADO (L.N)

DY.CFO/NBZ


line  
encl/3/24

C.F.O.  
5/3/2024

Director  
5/3/24

F.T letter is put up for sign. Please

Director  
5/3/24



6/3/2024