

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI  
HEADQUARTERS: DELHI FIRE SERVICE NEW DELHI-110001**

No. F6/DFS/MS/2024/School/WZ/ 170

Dated: 05/03/2024

**FIRE SAFETY CERTIFICATE**

Certified that the **School of Excellence, Sector-17, Rohini, Delhi-110086. (School ID-1413333)**, comprised of **Ground + Three upper floors** owned/occupied by **School of Excellence**, has already been issued FSC by this department vide letter No. **F.6/DFS/MS/2021/School/WZ/131 dated 17.02.2021**. The premises was re-inspected by the officer concerned of this department on **23.02.2024** in the presence of **Sh. Rakesh Kumar (HOS)** and observed that all the fire prevention and fire safety arrangements as provided in the premise found in good working condition. The premises have therefore deemed complied with the requirements under Rule 33 of the Delhi Fire Service Rules, 2010 and that the premises fit for occupancy under **Educational "Group B"** with effect from 05/03/2024 for a period of three years in accordance with Rule 36 unless renewed under Rule 37 or sooner cancelled under Rule 40 and subjected to compliance of the conditions under Rule 38 of the Delhi Fire Service Rules, 2010.

Issued on 05/03/2024 at New Delhi by

  
(Atul Garg)  
**DIRECTOR**  
Ph; 011-23414000

Copy to :-

1. The Principal, School of Excellence, Sector-17, Rohini, Delhi-110086. (School ID-1413333)
2. The Director of Education, Old Secretariat, Delhi

**Conditions for validity of Fire Safety Certificate;**

1. All the fire safety arrangement provided there-in shall be maintained in good working conditions at all times.
2. Loss of life or property due to non functional fire safety measure shall be at the responsibility of the management.
3. The trained fire fighting staff should be available round the clock.
4. Any deviation with regard to the construction etc shall be verified by the concerned building sanctioning agency.
5. This certificate cannot be treated in any case for regularizations of unauthorized construction.
6. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director along with a copy of this Certificate, six months prior to its expiry".
7. The owner / occupier shall submit a declaration every year in form "K" provided in the first schedule of Delhi Fire Service Rules 2010. The form "K" is available on

[http://www.delhi.gov.in/wps/wcm/connect/doit\\_fire/FIRE/Home/Fire+Safety+Acts+and+Rules/](http://www.delhi.gov.in/wps/wcm/connect/doit_fire/FIRE/Home/Fire+Safety+Acts+and+Rules/)  
[http://www.delhi.gov.in/wps/wcm/connect/doit\\_fire/FIRE/Home/Forms](http://www.delhi.gov.in/wps/wcm/connect/doit_fire/FIRE/Home/Forms)

### INSPECTION REPORT


1. Name & address of the building	School of Excellence, Sector-17, Rohini, Delhi-110086. (School ID-1413333).			
2. Type of Occupancy	Educational			
3. Type of Case	Renewal (Ground + 03 upper floors)			
4. Details of Previous NOC	F.6/DFS/MS/2021/School/WZ/131 dated 17.02.2021.			
5. Fire Safety directives letter No	NBC Part-IV.			
6. Date of inspection	23.02.2024.			
7. Name of Inspecting Officer	Sh. Ajay Kumar Sharma (ADO Rohini)			
8. Name and designation of officers From the building side	Mr. Rakesh Kumar (HOS)			
9. Year of Construction	2017.			
10. Applicant's letter No.	OD No.12952 dated 06.02.2024.			
S. No	Minimum Standards on fire prevention and fire safety U/R 33	NBC Requirement	Provided at site	Remarks MR/NMR
1.	<b>Access to building</b>			
	• Road width	Accessible	Accessible	MR
	• Gate width	Accessible	Accessible	MR
	• Width of internal road	-NA-	-NA-	-NA-
2.	<b>Number, Width, Type &amp; Arrangement of Exits</b>			
	<b>d. Number of staircases</b>			
	• Upper Floors	Required	03nos.	MR
	• Basements	-NA-	-NA-	-NA-
	<b>e. Width of staircases</b>			
	• Upper Floor	1.5m	2.0m	MR
	• Basements	-NA-	-NA-	-NA-
	<b>f. Protection of exits</b>			
	• Fire check door	-NA-	-NA-	-NA-
	• Pressurization	-NA-	-NA-	-NA-
	<b>d. No. of continuous staircases to terrace</b>	01nos.	02nos.	MR
	<b>e. Width of Corridor</b>	Required	Provided	MR
	<b>f. Door Size</b>	1.0m	1.10m	MR
3.	<b>Compartmentation</b>			
	• Fire check door	-NA-	-NA-	-NA-
	• Sealing of electrical shafts	-NA-	-NA-	-NA-
	• Fire Rating of shaft door	-NA-	-NA-	-NA-
	• Water Curtain	-NA-	-NA-	-NA-
	• Fire Dampers	-NA-	-NA-	-NA-
4.	<b>Smoke Management System</b>			
	a) Basements	-NA-	-NA-	-NA-
	b) Upper floors	12 a/c per hour	Natural ventilated	MR
5.	<b>Fire Extinguishers</b>			
	• Total numbers	50nos.	60nos.	MR
	• Types	ABC/CO2	ABC-30/CO2-30	MR
	• IS marking	ISI marked	Yes	MR
6.	<b>First-Aid Hose Reels</b>			
	• Total numbers on each floor	02nos.	03nos.	MR
	• Length of hose reel hose	30mm	Provided	MR
	• Nozzle diameter	5m	Provided	MR

7.	<b>Automatic fire detection and alarming system</b>			
	a) Type of detectors	-NA-	-NA-	-NA-
	b) Location of Main Panel	-NA-	-NA-	-NA-
	c) Location of Repeater Panel	-NA-	-NA-	-NA-
	d) Alternate source of power	-NA-	-NA-	-NA-
	e) Hooters' Location	-NA-	-NA-	-NA-
8.	<b>MOEFA</b>	-NA-	-NA-	-NA-
9.	<b>Public Address System</b>	-NA-	-NA-	-NA-
10.	<b>Automatic Sprinkler System</b>			
	• Basement	-NA-	-NA-	-NA-
	• Ground & Upper Floors	-NA-	-NA-	-NA-
	• Sprinkler above false ceiling	-NA-	-NA-	-NA-
11.	<b>Internal Hydrants</b>			
	• Size of riser/down-comer	-NA-	100mm	-NA-
	• Number of hydrants per floor	-NA-	03nos.	-NA-
	• Hose Box	-NA-	03nos.	-NA-
12.	<b>Yard Hydrants</b>			
	• Total number of hydrants	-NA-	03nos.	-NA-
	• Hose Box	-NA-	-NA-	-NA-
13.	<b>Pumping Arrangements</b>			
	• Ground Level	-NA-	-NA-	-NA-
	➤ Discharge of main Pump	-NA-	-NA-	-NA-
	➤ Head of Main pump	-NA-	-NA-	-NA-
	➤ Number of main pumps	-NA-	-NA-	-NA-
	➤ Jockey Pump out put	-NA-	-NA-	-NA-
	➤ Jockey pump head	-NA-	-NA-	-NA-
	➤ Standby Pump out put	-NA-	-NA-	-NA-
	➤ Standby Pump Head	-NA-	-NA-	-NA-
	➤ Auto Starting/Manual Stopping	-NA-	-NA-	-NA-
	➤ Pump House Access	-NA-	-NA-	-NA-
	<b>Terrace level</b>			
	➤ Discharge of pump	450lpm	2 x 450lpm	MR
	➤ Head of the pump	40m	40m	MR
	➤ Power Supply	Required	Provided	MR
	➤ Auto Starting of pump	Required	Provided	MR
14.	<b>Captive Water Storage for fire fighting</b>			
	• Underground tank capacity	-NA-	-NA-	-NA-
	➤ Draw-off connection	-NA-	-NA-	-NA-
	➤ Fire service inlet	-NA-	-NA-	-NA-
	➤ Access to tank	-NA-	-NA-	-NA-
	• Overhead Tank capacity	10,000ltr	10,000ltr	MR
15.	<b>Exit Signage.</b>	Required	Provided	MR
16.	<b>Provision of Lifts.</b>			
	• Pressurization of Lift Shaft	-NA-	-NA-	-NA-
	• Pressurization of Lift lobby	-NA-	-NA-	-NA-
	• Communication In lift Car	-NA-	-NA-	-NA-
	• Fireman's Grounding Switch	-NA-	-NA-	-NA-
	• Lift Signage	-NA-	-NA-	-NA-

17.	Standby power supply	-NA-	-NA-	-NA-
18.	Refuge Area.			
	➤ Total Area	-NA-	-NA-	-NA-
	➤ Location	-NA-	-NA-	-NA-
19.	Fire Control Room			
	• Detector System Panel	-NA-	-NA-	-NA-
	• Flow Switch Panel	-NA-	-NA-	-NA-
	• PA System Panel	-NA-	-NA-	-NA-
	• Battery backup	-NA-	-NA-	-NA-
	• Building Floor Plans	-NA-	-NA-	-NA-
20.	Special Fire Protection System for Protection of special Risks, if any:	-NA-	-NA-	-NA-

The fire protection systems provided in the building were test checked and found functional at the time of inspection.

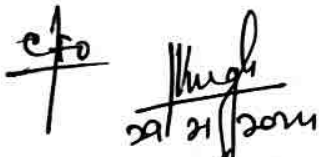
In view of the deemed compliance of the minimum standards of the fire prevention and fire safety measures as required under the rules the NOC issued vide letter no. F.6/DFS/MS/2021/School/WZ/131 dated 17.02.2021 is recommended for renewal under rule 37 of the Delhi Fire Service rules 2010.

  
 Signature of the Inspecting Officer  
 Name Ajay Kumar Sharma  
 Designation ADO(Rohini)

Dy. CFO(WZ)

FOI.649-NW.  
 dated 28/02/24

  
 28/2

  
 21/2/2024

  
 11/2/24

  
 11/2/24

Fi letter is put up for kind perusal and  
 Signature please.

  
 11/2/24

  
 11/2/24