

246

FORM 'H'  
FORM FOR ISSUING FIRE SAFETY CERTIFICATE  
[Refer sub - rule (1) of rule 35]  
GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI  
HEAD QUARTERS: DELHI FIRE SERVICE, CONNAUGHT PLACE  
NEW DELHI

No. F6/DFS/MS/SCHOOL/SZ/2024/198

Dated: 12/03/2024

**FIRE SAFETY CERTIFICATE**

Certified that the building of S.K.R. Public School Located at Bohrianwala Thalla, Inderpuri, New Delhi - 110012 comprised of Basement/ lower ground +ground + 3 upper floors was issued Fire Safety Certificate vide Letter No: F6/DFS/MS/School/2021/SZ/51, dated 20/01/2021. The premises was re inspected by the officer concerned of this department on 04/03/2024 in the presence of Mr. Hemant Arora (School Employee) and observed that all the fire prevention and fire safety arrangements provided in the premises found in good working condition. The premises have therefore deem complied with the fire prevention and fire safety requirements in accordance Delhi Fire Service Rules 2010 under Delhi Fire Service Act 2007 and that the premises is fit for occupancy class "Educational" Group B with effect from 12/03/2024 for a period of three years in accordance with Rule 36 unless renewed under Rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under Rule 38 of the Delhi Fire Service Rules, 2010.

Issued on 12/03/2024 at New Delhi by.

  
(Atul Garg)  
Director  
Delhi Fire Service  
o/c 

Copy to:

1. The Directorate of Education Old Secretariat Delhi - 110054.
2. The Principal, S.K.R. Public School Located at Bohrianwala Thalla, Inderpuri, New Delhi - 110012.

**Following fire safety directives must be adhered to:-**

1. All the fire safety arrangements provided therein shall be maintained in good working condition at all times.
2. Any loss of life or property due to non-functional fire safety measures shall be at the risk and responsibility of the management.
3. The trained staff should be available round the clock.
4. Any deviations w.r.t. construction shall be verified by the concerned building sanctioning agency.
5. The certificate may not be treated in any case for the regularization of the unauthorized construction, if any.
6. Basement shall be used strictly as per building bye laws.
7. The owner/occupier shall submit a declaration every year in the form 'K' provided in the first schedule of Delhi Fire Service Rules 2010, form is available on [www.dfs.delhigovt.nic.in](http://www.dfs.delhigovt.nic.in).
8. The owner/ occupier shall apply for renewal of this Fire Safety Certificate to the Director in Form 'J' [sub rule (1) of rule 37] along with a copy of this certificate, six months prior to its expiry.



INSPECTION REPORT

1. Name & address of the building: S.K.R. Public School Located at Bohrianwala Thalla, Inderpuri, New Delhi - 110012.
2. Type of Occupancy : Educational (Basement/lower ground + G + 3 UFs)
3. Type of Case : Renewal
4. Details of previous NOC : F6/DFS/MS/School/2021/SZ/51, dated 20/01/2021
5. Fire Safety directives Letter No. : Nil
6. Date of inspection : 04/03/2024
7. Name of the Inspecting Officer : ADO (DWK)
8. Name and designation of Officer  
from the building side: Mr. Hemant Arora (School Employee)
9. Year of Construction : 1990
10. Applicant's letter No. : Nil, dated 27/02/2024

No. of Students=955
No. of class rooms=32
Plot area=3050.44 sqard
Covered area=3050.44 sqard

S No	Minimum standards on fire prevention and fire safety U/R 33	As per N/25, N/26 & N/27	Provided at site	Remarks MR/NMR
1.	<b>Access of building</b>			
	• Road width	06 mtr	Provided	MR
	• Gate width	5 mtr	3.45 m	MR (Being old case)
	• Width of internal road	NA	NA	NA
2.	<b>Number, width, Type &amp; Arrangements of exits</b>			
	a. Number of staircases			
	• Upper floors	03 Nos.	Provided	MR
	• Basements	02 Nos.	Provided	MR
	b. Width of staircases			
	• Upper floors	1.5 mtr or less & 0.75m	1.64, 0.85m & 0.80to 1.20m	MR(Being old case)
	• Basements	1.5 mtr or less & 0.75m	190 cm & 80cm	MR(Being old case)
	c. Protection of exits			
	• Fire check door	NA	NA	NA
	• Pressurization	NA	NA	NA
	d. No of continuous staircase to terrace	01 No	Provided	MR
	e. Width Of Corridor	1.5 m	Provided	MR
	f. Door Size	01 mtr	80 cm to 110cm	MR(Being old case)
3.	<b>Compartmentation</b>			
	• Fire check door	NA	NA	NA
	• Sealing of electrical shafts	NA	NA	NA
	• Fire Rating of shaft door	NA	NA	NA
	• Water Curtain	NA	NA	NA
	• Fire Dampers	NA	NA	NA
4.	<b>Smoke managements System</b>			
	• Basements	Required	Exhaust fans provided	MR
	• Upper floors	Required	Natural ventilation	MR







16.	Provision of Lifts			
	➤ Pressurization of Lift Shaft	NA	NA	NA
	➤ Pressurization of lift lobby	NA	NA	NA
	➤ Communication in lift Car	NA	NA	NA
	➤ Fireman's Grounding Switch	NA	NA	NA
	➤ Lift Signage	NA	NA	NA
17.	Standby power supply	NA	NA	NA
18.	Refuge Area			
	➤ Total area	NA	NA	NA
	➤ Location	NA	NA	NA
19.	Fire control room			
	➤ Detector system panel	NA	NA	NA
	➤ Flow Switch Panel	NA	NA	NA
	➤ PA System Panel	NA	NA	NA
	➤ Battery backup	NA	NA	NA
	➤ Building Floor Plans	NA	NA	NA
20.	Special Fire Protection Systems for Protection of special Risks, if any;	Required	02 ABC type Fire extinguishers provided near electric panel	MR

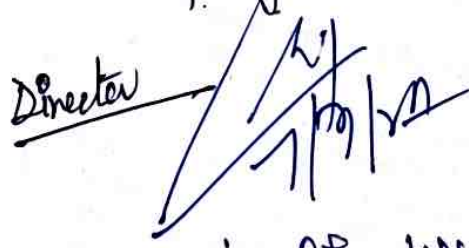
The fire protection systems provided in the building were test checked and found functional at the time of inspection.

In view of the deemed compliance of minimum standards on fire prevention and fire safety as required under the rules the NOC issued vide letter F6/DFS/MS/School/2021/SZ/51, dated 20/01/2021 renewal under Rule 37 of the Delhi Fire Service Rules 2010 is recommended. If approved FSC may be issued.

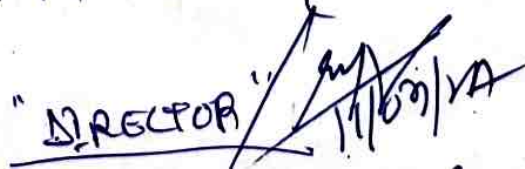
  
 Sign of Inspecting Officer  
 Name Uday Vir Singh  
 Designation ADDO/DWZ

  
6/3/24

  
7/3/2024

  
7/10/24

Sir PP letter is put up for sig plr

  
11/6/24

  
12/13/24