

c7

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI  
HEAD QUARTERS, DELHI FIRE SERVICE, NEW DELHI - 110001**

No.F6/DFS/MS/EH/NDZ/2024/ 65

Dated: 11/03/2024

**FIRE SAFETY CERTIFICATE**

Certified that the M/s TYCHE INN HOTEL located at 2285 1/2/2286/2287/2288, Plot no. 466, Block - A, Rajguru Road, Chuna Mandi, Pahar Ganj, New Delhi, comprised of basement, stilt, Gr. + 03 Upper floors, basement- vacate, stilt - parking, Ground floor (04 guest room), 1<sup>st</sup> floor to 3<sup>rd</sup> floor (06 guest rooms at each floor), total 22 guest rooms up to third floor. The premises was inspected by the officers concerned of this department on 28/02/2024 in the presence of Mr. Gourav and found that the said guest house building has complied with the fire prevention and fire safety requirements in accordance with rule 33 of the Delhi Fire Service Rules, 2010 and that the premises is fit for occupancy class Residential (Sub Division-A-1) basement - vacate, stilt - parking, Ground floor (04 guest room), 1<sup>st</sup> floor to 3<sup>rd</sup> floor (06 guest rooms at each floor), total 22 guest rooms up to third floor and valid up to 31.03.2027 from the date of issue in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules 2010, printed below.

Issued .....11/03/2024.....at New Delhi by.

  
(Atul Garg)  
**DIRECTOR**  
Delhi Fire Service

**Copy to:-**

1. The Commissioner, MCD, Civic Centre, New Delhi: kindly to ensure the occupancy as above & deviation w.r.t to construction if any.
2. The Joint Commissioner of Police (Lic), First Floor, P.S. Defence Colony New Delhi ID no. ID No. 2024021001482 dated 14.02.2024.
3. The Manager, TYCHE INN HOTEL located at 2285 1/2/2286/2287/2288, Plot no. 466, Block - A, Rajguru Road, Chuna Mandi, Pahar Ganj, New Delhi.

**Conditions for the validity of Fire Safety Certificate.**

1. All the fire safety arrangements provided therein shall be maintained in good working conditions at all times.
2. Any loss of life or property due to non functional fire safety measures shall be at the responsibility of the management.
3. The trained firefighting staff should be available round the clock.
4. The compliance with regards to electrical installation, structural stability, set back area, occupancy and any deviation in construction etc. shall be verified from authority concerned.
5. This fire safety certificate may not be treated in any case for regularization of unauthorized construction, if any.
6. The owner / occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on [www.dfs.delhigovt.nic.in](http://www.dfs.delhigovt.nic.in).
7. The means of escape shall be kept unobstructed / unlocked for unhindered evacuation in case of an emergency.
8. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in form 'J' [sub rule (I) of rule 37] along with a copy of this Certificate, six month prior to its expiry.
9. Any flammable material for interior decoration shall be strictly prohibited.
10. Basement found vacant at the time of inspection and applicant shall re-apply if it is used other than storage as specified in UBBL-2016.



# INSPECTION REPORT

1.	Name & address of the building	M/S TYCHE INN HOTEL located at 2285 1/2/2286/2287/2288, Plot no. 466, Block - A, Rajguru Road, Chuna Mandi, Pahar Ganj, New Delhi. Basement, stilt, ground and three upper floor.
2.	Type of occupancy: -	Residential Group A-1 , basement <del>vacate</del> stilt -parking , Ground floor ( 04 guest room), 1st floor to 3rd floor ( 06 guest rooms at each floor), <b>Total -22 guest room.</b>
3	Type of case: -	New
4	Details of previous FSC: -	NA.
5	Fire safety directives No.-	N/A
6	Date of inspection: -	28.02.2024
7	Name of the inspecting officer: -	Sh. Ravinder Singh (ADO/CC) Sh. Rajinder Atwal , DO/CD
8	Name & designation of officer From the building side: -	<u>Mr. Gourav</u>
9	Year of construction: -	2024
10	Applicant's letter No: -	ID No. 2024021001482 dated 14.02.2024.

## New Case

S.No.	Minimum Standards on fire Prevention and fire safety U/R 33	Requirement as per UBBL-2016/NBC part-4	Provided at site	Remarks MR/NMR
<b>1.</b>	<b>Access to Building</b>			
	1) Road width	06 mtr	Provided	MR
	2) Gate width	N/A	N/A	N/A
	3)Width of internal road	N/A	N/A	N/A
<b>2.</b>	<b>Number, Width Type &amp; Arrangement of Exits</b>			
	A. Number of staircases			
	1. Upper floors	02 Nos.	02 Nos. ✓	MR
	2. Basements	02 Nos.	02 Nos.	MR
	B. Width of staircase			
	1. Upper floors	1.50mtr	1.50 mtr. ✓	MR
	2. Basements	1.50mtr	1.50 mtr.	MR
	C. Protection of exits	N/A	N/A	N/A
	1. Fire check door	N/A	N/A	N/A
	2. Pressurization	N/A	N/A	N/A
	D. No. of continuous staircase to terrace	02 Nos	Provided ✓	MR
	E. Width of corridor	1.50m	1.50m	MR
	F. Door size( room )	01 mtr.	01 mtr.	MR
<b>3.</b>	<b>Compartmentation</b>			
	1) Fire check door( basement)	Required	Provided ✓	MR
	2) Sealing of electrical shafts	N/A	N/A	N/A
	3) Fire rating of shaft door	N/A	N/A	N/A

N/2

	4) Water curtain	N/A	N/A	N/A
	5) Fire Dampers	N/A	N/A	N/A
4.	<b>Smoke Management System</b>			
	1) Basements	Required	Provided	MR
	2) Upper floors	Required	Exhaust fan	MR
5.	<b>Fire Extinguishers</b>			
	1) Total numbers	08 Nos.	10Nos.	MR
	2) Types	ABC & CO2	ABC & CO2	MR
	3) ISI marking	Required	Provided	MR
6.	<b>First-Aid Hose Reel</b>			
	1) Total number at each floor	01	Provided	MR
	2) Length of hose reel hose	30 mtr.	30 mtr.	MR
	3) Nozzle diameter	05 mm	05 mm	MR
7.	<b>Automatic Fire Detection &amp; Alarming System</b>			
	1) Type of detectors CO type	Required	Provided	MR
	2) Location of main panel	Stilt floor	Provided	MR
	3) Location of repeater panel	N/A	N/A	N/A
	4) Alternate source of power	Required	Provided	MR
	5) Hooter's Location	At each floor	Provided	MR
8.	<b>MOEFA</b>	N/A	Provided	N/A
9.	<b>Public Address System</b>	N/A	N/A	N/A
10.	<b>Automatic Sprinkler System</b>			
	1) Basement	N/A	Provided	N/A
	2) Upper floors	N/A	Provided	N/A
	3) Sprinkler above false ceiling	N/A	N/A	N/A
11.	<b>Internal Hydrants</b>			
	1) Size of riser/down-comer	N/A	100mm	N/A
	2) Number of hydrants per floor	N/A	Provided	N/A
	3) Hose box	N/A	Provided	N/A
12.	<b>Yard Hydrants</b>			
	1) Total number of hydrants per floor	N/A	01 nos	N/A
	2) Hose box	N/A	01 nos	N/A
13.	<b>Pumping Arrangement</b>			
	1) Ground level	N/A	N/A	N/A
	a) Discharge of main pump	N/A	N/A	N/A
	b) Head of main pump	N/A	N/A	N/A
	c) Number of main pump	N/A	N/A	N/A
	d) Jockey pump out put	N/A	N/A	N/A
	e) Jockey pump head	N/A	N/A	N/A
	f) Stand by pump output	N/A	N/A	N/A
	g) Stand by pump head	N/A	N/A	N/A
	h) Auto starting/Manual stopping	N/A	N/A	N/A
	2) Terrace level			
	a) Discharge of pump	450 LPM	Provided /	MR
	b) Head of pump	30 mtr.	30 mtr.	MR
	c) Power supply	Required	Provided	MR
	d) Auto starting of pump	Required	Provided	MR
14.	<b>Captive Water Storage for Fire Fighting</b>			

Co



	1) Under ground tank capacity	N/A	N/A	N/A
	a) Draw-off connection	N/A	N/A	N/A
	b) Fire service inlet	N/A	N/A	N/A
	c) Access to tank	Required	Provided	MR
	d) Over head tank capacity	5000 liter	10,000 ltr.	MR
15.	Exit Signage.	Required	Provided	MR
16.	Provision of Lifts.			
	a) Pressurization of lift shaft	N/A	N/A	N/A
	b) Pressurization of lift lobby	N/A	N/A	N/A
	c) Communication in lift car	Required	Provided	MR
	d) Fireman's switch	Required	Provided	MR
	e) Lift signage	Required	Provided	MR
17.	Stand by Power Supply	Required	Provided	MR
18.	Refuge Area	N/A	N/A	N/A
	Total area location	N/A	N/A	N/A
19.	Fire Control Room	N/A	N/A	N/A
	a) Detector system panel	N/A	N/A	N/A
	b) Flow switch panel	N/A	N/A	N/A
	c) PA system panel	N/A	N/A	N/A
	d) Battery backup	N/A	N/A	N/A
	e) Building floor plan	N/A	N/A	N/A
20.	Special Fire Protection System for Protection of special Risk, if any: ABC & CO <sup>2</sup>			N/A

The fire protection arrangements provided in the building were randomly tested, checked and found functional at the time of inspection.


In view of the substantial compliance minimum standards of fire prevention and fire safety measures as required under the rules, if approved, we may issue FSC to said guest house. Accordingly, DFA is prepared and put up for kind perusal and signature. please.

Signature of the Inspecting Officer


  
1/3/24

Name: - Rajinder Atwal  
Designation: - DO (CD)

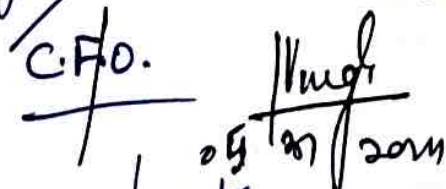
Signature of the Inspecting Officer

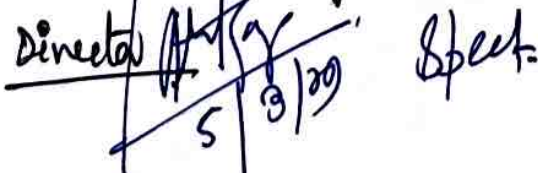
  
2/3/24


Name: - Ravinder Singh  
Designation: - ADO (CC)

  
C.F.O.

  
24/03/24

  
25/03/2024

  
5/3/20 Spect.

  
ADO/CC