



No. F6/DFS/MS/School/NDZ/2024/ 22)

Dated: 20/03/2024

**FIRE SAFETY CERTIFICATE**

Certified that the Govt. Co-Ed. Sr. Sec. School located at E- Block, West Vinod Nagar, Delhi -110092, comprised of ground plus one upper floor Only owned/occupied by Govt. Co-Ed. Sr. Sec. School was issued Fire Safety Certificate vide letter No. F6/DFS/MS/School/NDZ/2021/503 dated 16/07/2021. The School building was re-inspected by the officer concerned of this department on 12/03/2024 in presence of Mr. M.K.Varshney (Estate Manager) and observed that all the fire prevention and fire safety arrangements provided in the premises found in good working condition. The premises have therefore deemed complied with the Fire Prevention and Fire Safety requirements in accordance with Circular No. F16/Estate/CC/Fire Safety/2011/3298 to 3398 dated 01.03.2011 issued by Director of Education and that the building is fit for occupancy class "Educational" (Group-B) with effect from 20/03/2024 for a period of three years in accordance with rule 36 unless renewal under rule 37 or sooner cancelled under rule 40 and subject to compliance of the conditions under rule 38 of the DFS rule 2010. Subject to conditions printed below.

Issued on 20/03/2024 at New Delhi by.

  
(ATUL GARG)  
DIRECTOR

o/c DELHI FIRE SERVICE

**Copy to:-**

1. The Dy. Director of Education, D - Block Anand Vihar, Delhi-110091.
2. The Principal, Govt. Co-Ed. Sr. Sec. School located at E- Block, West Vinod Nagar, Delhi - 110092.

**Conditions for the validity of Fire Safety Certificate**

1. The owner /occupier shall apply for renewal of this fire safety certificate to the Director in form J' [sub rule(1) of rule 37] along with a copy of this certificate, six months prior to its expiry
2. All the means of escape shall be kept free of all the type of obstruction all the time.
3. All the employees shall be acquainted with the use and maintenance of all fire equipments and method of smooth and speedy safe evacuation of occupants in case of emergency.
4. All the fire fighting equipments shall be maintained in perfect working condition all the time and any lapse rendering non-functional of fire safety measures, management shall be responsible.
5. The clarification with regards electrical installation, ventilation, structure stability set back areas, occupancy and constructional deviation in building etc .may be got verified from the authorities concerned.
6. This Fire Safety Certificate cannot be treated in any case for regularizations of unauthorized construction unauthorized use of land if any.
7. The owner / occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rule 2010. The form is available on [www.dfs.delhigovt.nic.in](http://www.dfs.delhigovt.nic.in).

**INSPECTION REPORT**

1	Name & address of the building	Govt. Co-Ed. Sr. Sec. School located at E- Block, West Vinod Nagar, Delhi -110092.
2	Building is comprised of	Ground + 01 upper floors
3	Type of occupancy	Educational Building
4	Type of case	Renewal
5	Details of previous FSC	F6/DFS/MS/School/NDZ/2021/503 dated 16/07/2021
6	Fire safety directives letter no.	F16/Estate/CC/Fire Safety/2011/3298-3398 dated 01.03.2011.
7	Date of inspection	12.03.2024
8	Name of the inspecting officers	Yashwant Singh Meena ADO (L.N)
9	Name of the designation of officer from the building side	Mr. M.K. Varshney (Estate Manager)
10	Year of construction	2000
11	Applicant's letter no.	Outdoor Diary no. 13932 dated 06/03/2024


S.No	Minimum standard of fire prevention and fire safety U/R 33	01.03.2011 Circular requirement	Provided at site	Remarks MR/NMR
1	<b>Access to Building:</b>			
A	Road width	6.0 mtrs.	6.0 mtrs. ✓	MR
B	Gate width	4.50 mtrs.	4.50 mtrs.	MR
C	Width of internal road	N/A	N/A	N/A
2	<b>Number, Width, Type and Arrangement of Exits:</b>			
A	Number of staircases			
a	Upper floor	04 nos.	04 nos. ✓	MR
c	Basement	N/A	N/A	N/A
B	Width of staircases			
a	Upper floor	1.50 mtrs.	1.50 mtrs. each ✓	MR
b	Basement	N/A	N/A	N/A
C	Protection of exits			
a	Fire check door	N/A	N/A	N/A
b	Pressurization	N/A	N/A	N/A
D	No. of continuous staircases to terrace	02 nos.	02 nos. ✓	MR
E	Width of corridor	1.50 mtrs.	1.50 mtrs. ✓	MR
F	Door size	1.0 mtrs.	1.0 mtrs. ✓	MR
3	<b>Compartmentation:</b>			
A	Fire check door	NA	NA	NA
B	Sealing of electrical shafts	N/A	N/A	N/A
C	Fire rating of shaft door	N/A	N/A	N/A
D	Water curtain	N/A	N/A	N/A
E	Fire dampers	N/A	N/A	N/A
4	<b>Smoke Management System:</b>			
A	Basement	N/A	N/A	N/A
B	Upper floor	N/A	N/A	N/A



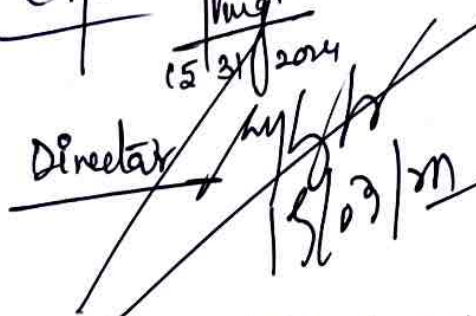
<b>5.</b>	<b>Fire Extinguisher:</b>				
	<b>A</b>	Total numbers	08 nos.	15 nos.	MR
	<b>B</b>	Types	CO <sub>2</sub> & ABC	CO <sub>2</sub> & ABC	MR
	<b>C</b>	ISI marking	ISI Marked	Provided	MR
<b>6</b>	<b>First-Aid-Hose Reel:</b>				
	<b>A</b>	Total numbers of each floor	N/A	N/A	N/A
	<b>B</b>	Length of hose reel hose	N/A	N/A	N/A
	<b>C</b>	Nozzle diameter	N/A	N/A	N/A
<b>7</b>	<b>Automatic Fire Detection and Alarming System:</b>				
	<b>A</b>	Type of detectors	N/A	N/A	N/A
	<b>B</b>	Location of main panel	N/A	N/A	N/A
	<b>C</b>	Location of repeater panel	N/A	N/A	N/A
	<b>D</b>	Alternate source of power	N/A	N/A	N/A
	<b>E</b>	Hooters	N/A	N/A	N/A
<b>8</b>	<b>MOEFA:</b>		N/A	Provided	MR
<b>9</b>	<b>Public Address System:</b>		N/A	N/A	N/A
<b>10</b>	<b>Automatic Sprinkler System:</b>				
	<b>A</b>	Basement	N/A	N/A	N/A
	<b>B</b>	Upper floor	N/A	N/A	N/A
	<b>C</b>	Sprinkler above false ceiling	N/A	N/A	N/A
<b>11</b>	<b>Internal Hydrants:</b>				
	<b>A</b>	Size of riser/down-comer	N/A	N/A	N/A
	<b>B</b>	Number of hydrants per floor	N/A	N/A	N/A
	<b>C</b>	Hose box	N/A	N/A	N/A
<b>12</b>	<b>Yard Hydrants:</b>				
	<b>A</b>	Total number of hydrants	N/A	N/A	N/A
	<b>B</b>	Hose box	N/A	N/A	N/A
<b>13</b>	<b>Pumping Arrangements:</b>				
<b>1</b>	<b>Ground level</b>				
	<b>A</b>	Discharge of main pump	N/A	N/A	N/A
	<b>B</b>	Head of main pump	N/A	N/A	N/A
	<b>C</b>	Number of main pumps	N/A	N/A	N/A
	<b>D</b>	Jockey pump out put	N/A	N/A	N/A
	<b>E</b>	Jockey pump head	N/A	N/A	N/A
	<b>F</b>	Standby pump out put	N/A	N/A	N/A
	<b>G</b>	Standby pump head	N/A	N/A	N/A
	<b>H</b>	Auto starting /manual stopping	N/A	N/A	N/A
	<b>I</b>	Pump house access	N/A	N/A	N/A
<b>2</b>	<b>Terrace Level</b>				
	<b>A</b>	Discharge of pump	N/A	N/A	N/A
	<b>B</b>	Head of the pump	N/A	N/A	N/A
	<b>C</b>	Power supply	N/A	N/A	N/A
	<b>D</b>	Auto starting of pump	N/A	N/A	N/A



<b>14</b>	<b>Captive Water Storage for Fire Fighting:</b>			
A	Underground tank capacity	N/A	N/A	N/A
B	Draw-off connection	N/A	N/A	N/A
C	Fire service inlet	N/A	N/A	N/A
D	Access to tank	N/A	N/A	N/A
E	Overhead tank capacity	N/A	N/A	N/A
<b>15</b>	<b>Exit Signage:</b>			
<b>16</b>	<b>Provision of Lifts:</b>			
A	Pressurization of lift shaft	N/A	N/A	N/A
B	Pressurization of lift lobby	N/A	N/A	N/A
C	Communication in lift car	N/A	N/A	N/A
D	Firemen's grounding switch	N/A	N/A	N/A
E	Lift signage	N/A	N/A	N/A
<b>17</b>	<b>Standby Power Supply:</b>			
<b>18</b>	<b>Refuge Area:</b>			
A	Total area	N/A	N/A	N/A
B	Location	N/A	N/A	N/A
<b>19</b>	<b>Fire Control Room:</b>			
A	Detector system panel	N/A	N/A	N/A
B	Flow switch panel	N/A	N/A	N/A
C	PA system panel	N/A	N/A	N/A
D	Battery backup	N/A	N/A	N/A
E	Building floor plans	N/A	N/A	N/A
<b>20</b>	<b>Special Fire Protection systems for protection of special Risks, if any:</b>			

The fire protection systems provided in the building were tested, checked at random and found functional at the time of inspections.

Keeping in view of the deemed compliance of minimum standards of fire prevention and fire safety measures as required in Directorate of Education Circular no F16/Estate/CC/Fire Safety/2011/3298-3398 dated 01.03.2011, the FSC issued vide letter no. F6/DFS/MS/School/NDZ/2021/503 dated 16/07/2021 is recommended to be renewed.

  
 13/3/2024  
 Signature of the Inspecting Officer  
 Name:- Yashwant Singh Meena  
 Designation:- ADO (L.N)

Dy.CFO (NDZ)   
 C.F.O.   
 Director   
 15/3/2024  
 15/03/24

F.T Letter is picked for sign. Pleas  
 Director   
 16/3/24  
  
 18/3/2024