

c/36

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE: CONNAUGHT PLACE

NEW DELHI-110 001.

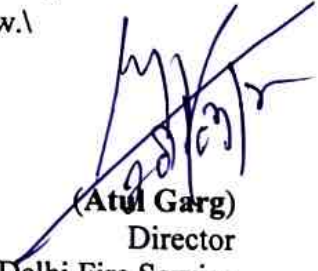
No.F.6/DFS/MS/School/2024/SZ/ 260

Dated: 01/04/2024

FIRE SAFETY CERTIFICATE

Certified that the **Rainbow Kids Valley School**, at RZ-2-D, Plot No-10-G, Block-B, Kailash Puri, New Delhi-110045, comprised of small basement ground floor plus four upper floors & one room at fifth floor (small basement & newly constructed 4th floor & 1 room at 5th floor are closed/sealed & not in use) owned/occupied by Rainbow Kids Valley School was issued Fire Safety Certificate by this department vide letter no. F6/DFS/MS/School/2021/SZ/308 dated 05.04.2021. The School building was re-inspected by the officer concerned of this department on 15.03.2024 in the presence of Sh. Parveen Mehta (Manager) and found that the School building have deemed complied the fire prevention and fire safety requirements in accordance with Rule 33 of the Delhi Fire Service Rules, 2010 and that the building/ premises is fit for occupancy class B "Educational Building" (for ground plus three upper floors only) with effect from 01/04/2024 for a period of three years in accordance with Rule 36 unless renewed under Rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under Rule-38 of the Delhi Fire Service Rules, 2010 printed as below.\

Issued on.....01/04/2024..... at New Delhi.


(Atul Garg)
Director
Delhi Fire Service

Copy to:-

1. The Principal, Rainbow Kids Valley School, RZ-2-D, Plot No-10-G, Block-B, Kailash-Puri, New Delhi-110045.
2. Director of Education, Govt. of NCT of Delhi, Old Secretariat, New Delhi-110054.

Following fire safety directives must be adhered to:-

1. All the fire safety arrangements provided therein shall be maintained in good working condition at all times.
2. The means of escape shall be kept unlocked and unobstructed for unhindered evacuation of occupants in case of emergency.
3. Any loss of life or property due to non-functional fire safety measures shall be at the risk and responsibility of the management.
4. The trained staff should be available round the clock.
5. Any deviations w.r.t. construction shall be verified by the concerned building sanctioning agency.
6. The certificate may not be treated in any case for the regularization of the unauthorized construction, if any.
7. The owner/occupier shall submit a declaration every year in the form 'K' provided in the first schedule of Delhi Fire Service Rules 2010, form is available on www.dfs.delhigovt.nic.in.
8. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in the Form 'J' [sub rule (1) of rule 37] along with a copy of this Certificate, six months prior to its expiry.

INSPECTION REPORT

1. Name & address of the building : Rainbow Kids Valley School,RZ-2-D,Plot No-10-G, Block-B, Kailash Puri, New Delhi-110045.
2. Building comprised of : Small Basement (sealed), Ground plus three upper floors & (4th floor & 01 room at 5th floor is permanently sealed. sealed)
3. Type of Occupancy : Educational
4. Type of Case : Renewal
5. Details of Previous NOC : F6/DFS/MS/School/2021/SZ/308 dated 05.04.2021
6. Fire Safety directives letter No : N/A
7. Date of inspection : 15.03.2024
8. Name of Inspecting Officer : A.D.O. R.K.Yadav
9. Name and designation of officers
From the building side : Parveen Mehta (Manager)
10. Year of Construction : 2005
11. Applicant's letter No. : RKV/23-24/114 dated 02.03.2024

S. No.	Minimum Standards on fire prevention and fire safety U/R 33	Requirement	Provided at site	Remarks MR/NMR
1.	Access to building			
	<ul style="list-style-type: none"> • Road width • Gate width • Width of internal road 	06 m 4.5 m N/A	06 m 4.5 m N/A	MR MR N/A
2.	Number, Width, Type & Arrangement of Exits			
	a. Number of staircases			
	<ul style="list-style-type: none"> • Upper Floors • Basements 	02 No's N/A	02 No's Not under consideration	MR Closed/not in use
	b. Width of staircases			
	<ul style="list-style-type: none"> • Upper Floor • Basements 	1.5 m & .75 m N/A	1.50 & 1.37 m Not under consideration	MR Closed/not in use
	c. Protection of exits			
	<ul style="list-style-type: none"> • Fire check door • Pressurization 	N/A N/A	N/A N/A	N/A N/A
	d. No. of continuous staircases to terrace	Required	Two	MR
	e. Width of Corridor	N/A	N/A	N/A
	f. Door Size	1.0 m	1.0 m	MR
3.	Compartmentation			
	<ul style="list-style-type: none"> • Fire check door • Sealing of electrical shafts • Fire Rating of shaft door • Water Curtain • Fire Dampers 	N/A N/A N/A N/A N/A	N/A N/A N/A N/A N/A	N/A N/A N/A N/A N/A
4.	Smoke Management System			
	<ul style="list-style-type: none"> • Basements 	N/A	N/A	Sealed
	<ul style="list-style-type: none"> • Upper floors 	Required	Natural ventilation	MR
5.	Fire Extinguishers			
	<ul style="list-style-type: none"> • Total numbers • Types • IS marking 	09 no.'s ABC & CO ₂ type ISI marked	09 no.'s provided Provided Provided	MR MR MR

6.	First-Aid Hose Reels			
	<ul style="list-style-type: none"> Total numbers on each floor 	01 no.	Provided	MR
	<ul style="list-style-type: none"> Length of hose reel hose 	30 m	Provided	MR
	<ul style="list-style-type: none"> Nozzle diameter 	5 mm	Provided	MR
7.	Automatic fire detection and alarming system			
	<ul style="list-style-type: none"> Type of detectors 	N/A	N/A	N/A
	<ul style="list-style-type: none"> Location of Main Panel 	N/A	N/A	N/A
	<ul style="list-style-type: none"> Location of Repeater Panel 	N/A	N/A	N/A
	<ul style="list-style-type: none"> Alternate source of power 	N/A	N/A	N/A
	<ul style="list-style-type: none"> Hooters' Location 	N/A	N/A	N/A
8.	MOEFA	N/A	N/A	N/A
9.	Public Address System			
10.	Automatic Sprinkler System			
	<ul style="list-style-type: none"> Basement 	N/A	N/A	N/A
	<ul style="list-style-type: none"> Ground Floor 	N/A	N/A	N/A
	<ul style="list-style-type: none"> Sprinkler above false ceiling 	N/A	N/A	N/A
11.	Internal Hydrants			
	<ul style="list-style-type: none"> Size of riser/down-comer 	N/A	N/A	N/A
	<ul style="list-style-type: none"> Number of hydrants per floor 	N/A	N/A	N/A
	<ul style="list-style-type: none"> Hose Box 	N/A	N/A	N/A
12.	Yard Hydrants			
	<ul style="list-style-type: none"> Total number of hydrants 	N/A	N/A	N/A
	<ul style="list-style-type: none"> Hose Box 	N/A	N/A	N/A
13.	Pumping Arrangements			
	<ul style="list-style-type: none"> Ground Level 	N/A	N/A	N/A
	<ul style="list-style-type: none"> Discharge of main Pump 	N/A	N/A	N/A
	<ul style="list-style-type: none"> Head of Main pump 	N/A	N/A	N/A
	<ul style="list-style-type: none"> Number of main pumps 	N/A	N/A	N/A
	<ul style="list-style-type: none"> Jockey Pump out put 	N/A	N/A	N/A
	<ul style="list-style-type: none"> Jockey pump head 	N/A	N/A	N/A
	<ul style="list-style-type: none"> Standby Pump out put 	N/A	N/A	N/A
	<ul style="list-style-type: none"> Standby Pump Head 	N/A	N/A	N/A
	<ul style="list-style-type: none"> Auto Starting/Manual Stopping 	N/A	N/A	N/A
	<ul style="list-style-type: none"> Pump House Access 			
	<ul style="list-style-type: none"> Terrace level 	450 LPM	450 LPM	MR
	<ul style="list-style-type: none"> Discharge of pump 	40 m	40 m	MR
	<ul style="list-style-type: none"> Head of the pump 	Required	Provided	MR
	<ul style="list-style-type: none"> Power Supply 	Required	Provided	MR
	<ul style="list-style-type: none"> Auto Starting of pump 			
14.	Captive Water Storage for fire fighting			
	<ul style="list-style-type: none"> Underground tank capacity 	N/A	N/A	N/A
	<ul style="list-style-type: none"> Draw-off connection 	N/A	N/A	N/A
	<ul style="list-style-type: none"> Fire service inlet 	N/A	N/A	N/A
	<ul style="list-style-type: none"> Access to tank 	N/A	N/A	N/A
	<ul style="list-style-type: none"> Overhead Tank capacity 	10,000 ltrs	Provided	MR
15.	Exit Signage.	Required	Provided	MR

		No Lift		
16.	Provision of Lifts.			
	• Pressurization of Lift Shaft	N/A	N/A	N/A
	• Pressurization of Lift lobby	N/A	N/A	N/A
	• Communication In lift Car	N/A	N/A	N/A
	• Fireman's Grounding Switch	N/A	N/A	N/A
	• Lift Signage	N/A	N/A	N/A
17.	Standby power supply	N/A	Provided	MR
18.	Refuge Area.			
	➤ Total Area	N/A	N/A	N/A
	➤ Location	N/A	N/A	N/A
19.	Fire Control Room			
	• Detector System Panel	N/A	N/A	N/A
	• Flow Switch Panel	N/A	N/A	N/A
	• PA System Panel	N/A	N/A	N/A
	• Battery backup	N/A	N/A	N/A
	• Building Floor Plans	N/A	N/A	N/A
20.	Special Fire Protection System for Protection of special Risks, if any:	N/A	N/A	N/A

The fire protection systems provided in the building were tested, checked and found functional at the time of inspection.

In view of the deemed compliance of the minimum standards of fire prevention and fire safety measures as required under the rules the NOC issued vide letter number F6/DFS/MS/School/2021/SZ/308 dated 05.04.2021, renewal under Rule 37 of the Delhi Fire Service Rules 2010 is recommended.

Note :- As per undertaking (placed at C-33) building height is less than 15 m and 4th floor & 5th floor (one room) which is newly constructed will not be used and it is permanently sealed with basement. School running in ground plus three upper floors & there are less than 45 students in each class room.

Signature of Inspecting Officer
Name:- R.K YADAV
Designation:- ADO (JKP)

D.O. (South West)

CFB (SZ)

Director

22/07/2024

22/07/24

22/07/24