



No. F6/DFS/MS/School/NDZ/2024/316

Dated: 18/04/2024

FIRE SAFETY CERTIFICATE

Certified that the **Brilliant Public school** running at ground & first floor of the building comprised of Ground plus two floors at **USB – 288 – B, Chander Vihar, Manadawli, Delhi - 110092**, owned/occupied by **Brilliant Public School**, was issued Fire Safety Certificate by this department vide letter No. F6/DFS/MS/School/2019/NDZ/1467 dated 17/07/2019. The School building was re-inspected by the officer concerned of this department on 26/03/2024 in presence of Mrs. Amita Sharma (Principal) and found that school have deemed complied with the fire prevention and fire safety requirements in accordance with F16/Estate/CC/Fire Safety/2011/ 3298 - 3398 dated 01/03/2011 issued by Director of Education and the ground & first floor building premises is fit for occupancy of class **Group B “Educational Building”** with effect from 18/04/2024 for a period of **three years**, in accordance with rule 36 unless renewed under Rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under Rule 38 of the Delhi Fire Service Rules 2010, printed below.

Issued on 18/04/2024 at New Delhi by.

(ATUL GARG)
DIRECTOR

DELHI FIRE SERVICE

Copy to:-

1. The Dy. Director of Education, EDMC, Udyog Sadan, Plot No. 419, FIE, Patparganj Industrial Area, Delhi – 110092.
2. The Principal, Brilliant Public School at USB - 288 - B, Chander Vihar, Manadawli, Delhi - 110092.

Conditions for the validity of Fire Safety Certificate

1. The owner /occupier shall apply for renewal of this fire safety certificate to the Director in form 'J' [sub rule(1) of rule 37] along with a copy of this certificate, six months prior to its expiry
2. All the means of escape shall be kept free of all the type of obstruction all the time.
3. All the employees shall be acquainted with the use and maintenance of all fire equipments and method of smooth and speedy safe evacuation of occupants in case of emergency.
4. All the fire fighting equipments shall be maintained in perfect working condition all the time and any lapse rendering non-functional of fire safety measures, management shall be responsible.
5. The clarification with regards electrical installation, ventilation, structure stability set back areas, occupancy and constructional deviation in building etc .may be got verified from the authorities concerned.
6. This Fire Safety Certificate cannot be treated in any case for regularizations of unauthorized construction unauthorized use of land if any.
7. The owner / occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rule 2010. The form is available on www.dfs.delhigovt.nic.in.

INSPECTION REPORT

| | | | | |
|------|---|--|----------------------|----------------|
| 1 | Name & address of the building | Brilliant Public School located at USB - 288 - B, Chander Vihar, Manadawali, Delhi - 110092. | | |
| 2 | Building is comprised of | Ground plus two floors only (But School running at Ground & first floor) | | |
| 3 | Type of occupancy | Educational Building | | |
| 4 | Type of case | Renewal | | |
| 5 | Details of previous FSC | F6/DFS/MS/School/2019/NDZ/1467 dated 17/07/2019 | | |
| 6 | Fire safety directives letter no. | F16/Estate/CC/Fire Safety/2011/3298-3398 dated 01/03/2011. | | |
| 7 | Date of inspection | 26/03/2024. | | |
| 8 | Name of the inspecting officers | Yashwant Singh Meena ADO (L.N) | | |
| 9 | Name of the designation of officer from the building side | Mrs. Amita Sharma (Principal) | | |
| 10 | Year of construction | 2005 | | |
| 11 | Applicant's letter no. | Outdoor dairy no.13718 dated 29/02/2024 | | |
| S.No | Minimum standard of fire prevention and fire safety U/R 33 | Requirement Circular | Provided at site | Remarks MR/NMR |
| 1 | Access to Building: | | | |
| A | Road width | 6.0 mtrs. | 6.0 mtrs. ✓ | MR |
| B | Gate width | N/A | N/A | N/A |
| C | Width of internal road | N/A | N/A | N/A |
| 2 | Number, Width, Type and Arrangement of Exits: | | | |
| A | Number of staircases | | | |
| a | Upper floor | 01 no. | 02 nos. ✓ | MR |
| c | Basement | N/A | N/A | N/A |
| B | Width of staircases | | | |
| a | Upper floor | 1.5 mtrs | 1.0 mtr & 0.95 mtr ✓ | MR |
| b | Basement | N/A | N/A | N/A |
| C | Protection of exits | | | |
| a | Fire check door | N/A | N/A | N/A |
| b | Pressurization | N/A | N/A | N/A |
| D | No. of continuous staircases to terrace | 01 no. | 02 nos. ✓ | MR |
| E | Width of corridor | 1.50 mtrs. | 1.50 mtrs ✓ | MR |
| F | Door size | 1.0 mtr. | 1.0 mtr ✓ | MR |
| 3 | Compartmentation: | | | |
| A | Fire check door | NA | NA | NA |
| B | Sealing of electrical shafts | N/A | N/A | N/A |
| C | Fire rating of shaft door | N/A | N/A | N/A |
| D | Water curtain | N/A | N/A | N/A |
| E | Fire dampers | N/A | N/A | N/A |
| 4 | Smoke Management System: | | | |
| A | Basement | N/A | N/A | N/A |
| B | Upper floor | N/A | N/A | N/A |

W

| 5. Fire Extinguisher: | | | | | |
|---|---------------|--------------------------------|-----------------------|-----------------------|-----|
| | A | Total numbers | 06 nos. | 08 nos. ✓ | MR |
| | B | Types | CO ₂ & ABC | CO ₂ & ABC | MR |
| | C | ISI marking | ISI marked | ISI marked | MR |
| 6 First-Aid-Hose Reel: | | | | | |
| | A | Total numbers of each floor | N/A | N/A | N/A |
| | B | Length of hose reel hose | N/A | N/A | N/A |
| | C | Nozzle diameter | N/A | N/A | N/A |
| 7 Automatic Fire Detection and Alarming System: | | | | | |
| | A | Type of detectors | N/A | N/A | N/A |
| | B | Location of main panel | N/A | N/A | N/A |
| | C | Location of repeater panel | N/A | N/A | N/A |
| | D | Alternate source of power | N/A | N/A | N/A |
| | E | Hooters | N/A | N/A | N/A |
| 8 MOEFA: | | | | | |
| | | | N/A | N/A | N/A |
| 9 Public Address System: | | | | | |
| | | | N/A | N/A | N/A |
| 10 Automatic Sprinkler System: | | | | | |
| | A | Basement | N/A | N/A | N/A |
| | B | Upper floor | N/A | N/A | N/A |
| | C | Sprinkler above false ceiling | N/A | N/A | N/A |
| 11 Internal Hydrants: | | | | | |
| | A | Size of riser/down-comer | N/A | N/A | N/A |
| | B | Number of hydrants per floor | N/A | N/A | N/A |
| | C | Hose box | N/A | N/A | N/A |
| 12 Yard Hydrants: | | | | | |
| | A | Total number of hydrants | N/A | N/A | N/A |
| | B | Hose box | N/A | N/A | N/A |
| 13 Pumping Arrangements: | | | | | |
| 1 | Ground level | | | | |
| | A | Discharge of main pump | N/A | N/A | N/A |
| | B | Head of main pump | N/A | N/A | N/A |
| | C | Number of main pumps | N/A | N/A | N/A |
| | D | Jockey pump out put | N/A | N/A | N/A |
| | E | Jockey pump head | N/A | N/A | N/A |
| | F | Standby pump out put | N/A | N/A | N/A |
| | G | Standby pump head | N/A | N/A | N/A |
| | H | Auto starting /manual stopping | N/A | N/A | N/A |
| | I | Pump house access | N/A | N/A | N/A |
| 2 | Terrace Level | | | | |
| | A | Discharge of pump | N/A | N/A | N/A |
| | B | Head of the pump | N/A | N/A | N/A |
| | C | Power supply | N/A | N/A | N/A |
| | D | Auto starting of pump | N/A | N/A | N/A |

W

CO

Brilliant Public School located at USB - 288 - B, Chander Vihar, Manadawall, Delhi - 110092.

| | | | | | | | |
|----|---|------------------------------|-----|-----|-----|-----|-----|
| 14 | Captive Water Storage for Fire Fighting: | | | | | | |
| | A | Underground tank capacity | N/A | N/A | N/A | | |
| | B | Draw-off connection | N/A | N/A | N/A | | |
| | C | Fire service inlet | N/A | N/A | N/A | | |
| | D | Access to tank | N/A | N/A | N/A | | |
| | E | Overhead tank capacity | N/A | N/A | N/A | | |
| 15 | Exit Signage: | | | | N/A | N/A | N/A |
| 16 | Provision of Lifts: | | | | | | |
| | A | Pressurization of lift shaft | N/A | N/A | N/A | | |
| | B | Pressurization of lift lobby | N/A | N/A | N/A | | |
| | C | Communication in lift car | N/A | N/A | N/A | | |
| | D | Firemen's grounding switch | N/A | N/A | N/A | | |
| | E | Lift signage | N/A | N/A | N/A | | |
| 17 | Standby Power Supply: | | | | N/A | N/A | N/A |
| 18 | Refuge Area: | | | | | | |
| | A | Total area | N/A | N/A | N/A | | |
| | B | Location | N/A | N/A | N/A | | |
| 19 | Fire Control Room: | | | | | | |
| | A | Detector system panel | N/A | N/A | N/A | | |
| | B | Flow switch panel | N/A | N/A | N/A | | |
| | C | PA system panel | N/A | N/A | N/A | | |
| | D | Battery backup | N/A | N/A | N/A | | |
| | E | Building floor plans | N/A | N/A | N/A | | |
| 20 | Special Fire Protection systems for protection of special Risks, if any: | | | | N/A | N/A | N/A |

The fire protection systems provided in the school building were tested, checked at random and found functional at the time of inspection.

Keeping in view of the compliance of minimum standards of fire prevention and fire safety measures required as per Circular No. F16/Estate/CC/Fire Safety/2011/3298 to 3398 dated 01/03/2011, under the rules the FSC issued vide letter no. F6/DFS/MS/School/2019/NDZ/1467 dated 17/07/2019, renewal under Rule 35 of the Delhi Fire Service Rules 2010, is recommended to be renewed.

No file is pending with me before disposal of this case,


5/3/2024


Signature of the Inspecting Officer

Name: - Yashwant Singh Meena

Designation: - ADO (L.N)

DY.CFO (NDZ)

C.F.O.

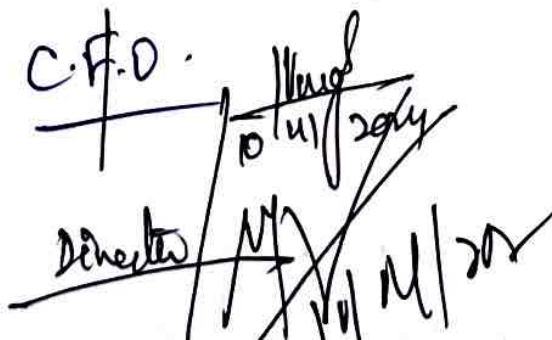

Director

