

C-67

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEAD QUARTERS: DELHI FIRE SERVICE: NEW DELHI – 110001**

No F 6/DFS/MS/2024/School/WZ/ 333

Dated: 19/04/2024

FIRE SAFETY CERTIFICATE

Certified that the **Rukmini Devi Public School, CD Block, Pitampura, Delhi-110034**, comprised of **Basement + Ground + 02 upper floors** owned/occupied by **Rukmini Devi Public School** was granted FSC by this department vide letter No. **F.6/DFS/MS/School/WZ/2021/94** dated **02.02.2021**. The premises was re-inspected by the officer concerned of this department on **06.03.2024** in the presence of **Mr. D. R. Goel (Admin officer)** and observed that all the fire prevention and fire safety arrangements as provided in the premises found in good working condition. The premises have deemed complied with requirements of circular issued by **Director of Education Cir. No. 262-362** dated **17.01.2005** and the building/ premise is fit for occupancy **Group B Educational** with effect from 19/04/2024 for a period of **three years**, subject to compliance of the conditions mentioned below:

Issued on 19/04/2024 at New Delhi


(Atul Garg)
DIRECTOR
Ph: 011-23414000

ole
04

Copy to: -

1. The Director, Education, Government of N.C.T of Delhi. Old Sect. Delhi - 54.
2. The Principal, Rukmini Devi Public School, CD Block, Pitampura, Delhi-110034.

Conditions for the validity of Fire Safety Certificate:

1. All the fire safety arrangement provided there-in shall be maintained in good working conditions at all times.
2. Loss of life or property due to non functional fire safety measure shall be at the responsibility of the management.
3. The trained fire fighting staff should be available round the clock.
4. Any deviation with regard to the construction etc shall be verified by the concerned building sanctioning agency.
5. This certificate cannot be treated in any case for regularizations of unauthorized construction.
6. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director of Form 'J' [sub rule (1) of rule 37] along with a copy of this Certificate, six months prior to its expiry".
7. The owner / occupier shall submit a declaration every year in form "K" provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on
8. All the means of escape shall be kept free of any obstruction all the time to evacuate the occupant, in a safe manner, in the event of emergency.

http://www.delhi.gov.in/wps/wcm/connect/doit_fire/FIRE/Home/Fire+Safety+Acts+and+Rules/ http://www.delhi.gov.in/wps/wcm/connect/doit_fire/FIRE/Home/Forms

INSPECTION REPORT

1. Name & address of the building	Rukmini Devi Public School, CD Block, Pitampura, Delhi-34			
2. Type of Occupancy	Educational			
3. Type of Case	Renewal (Basement + Ground + 02 upper floors)			
4. Details of Previous NOC	F.6/DFS/MS/School/WZ/2021/94 dated 02.02.2021.			
5. Fire Safety directives letter No	Director of Education Cir.262-362 dated 17.01.2005.			
6. Date of inspection	06.03.2024			
7. Name of Inspecting Officer	Sh. Ajay Kumar Sharma (ADO Rohini)			
8. Name and designation of officers From the building side	Mr. D. R. Goel (Admin officer)			
9. Year of Construction	1988			
10. Applicant's letter No.	Online e-mail dated 02.02.2024			
S. No	Minimum Standards on fire prevention and fire safety U/R 33	D.O.E Cir.262-362 dated 17.01.2005	Provided at site	Remarks MR/NMR
1.	Access to building			
	• Road width	Accessible	Accessible	MR
	• Gate width	Accessible	380cm provided	MR(Old case)
	• Width of internal road	-NA-	-NA-	-NA-
2.	Number, Width, Type & Arrangement of Exits			
	a. Number of staircases			
	• Upper Floors	02nos.	06nos.	MR
	• Basements	02nos.	03nos.	MR
	b. Width of staircases			
	• Upper Floor	1.5m	2 x 1.66m, 2 x 1.36m, 1 x 1.97m & 1 x 1.9m	MR
	• Basements	1.5m	1 x 1.37m, 1 x 1.44m & 1 x 1.22m	MR(Old case)
	c. Protection of exits			
	• Fire check door	-NA-	-NA-	-NA-
	• Pressurization	-NA-	-NA-	-NA-
	d. No. of continuous staircases to terrace	01nos.	Provided	MR
	e. Width of Corridor	1.5m	2.53 mtr	MR
	f. Door Size	1.0m	1.10m	MR
3.	Compartmentation			
	a) Fire check door	-NA-	-NA-	-NA-
	b) Sealing of electrical shafts	-NA-	-NA-	-NA-
	c) Fire Rating of shaft door	-NA-	-NA-	-NA-
	d) Water Curtain	-NA-	-NA-	-NA-
	e) Fire Dampers	-NA-	-NA-	-NA-
4.	Smoke Management System			
	a) Basements	30 /c per hour	Exhaust fan provided	MR
	b) Upper floors	-NA-	-NA-	-NA-
5.	Fire Extinguishers			
	a) Total numbers	38nos.	Provided	MR
	b) Types	ABC/CO2	ABC/CO2	MR
	c) IS marking	ISI marked	Yes	MR
6.	First-Aid Hose Reels			
	a) Total numbers on each floor	Required	Provided	MR
	b) Length of hose reel hose	30mm	Provided	MR

My


f

	c) Nozzle diameter	5m	Provided	MR
7.	Automatic fire detection and alarming system			
	a) Type of detectors	Required in Auditorium & Lecture room	Provided	MR
	b) Location of Main Panel	Required	Provided at Gr. floor	MR
	c) Location of Repeater Panel	-NA-	-NA-	-NA-
	d) Alternate source of power	Required	Provided	MR
	e) Hooters' Location	Required	Provided	MR
8.	MOEFA	Required	Provided at Strategic location	MR
9.	Public Address System	-NA-	Provided	MR
10.	Automatic Sprinkler System			
	a) Basement	Required	Provided	MR
	b) Ground & Upper Floors	-NA-	-NA-	-NA-
	c) Sprinkler above false ceiling	-NA-	-NA-	-NA-
11.	Internal Hydrants			
	a) Size of riser/down-comer	100mm	Provided	MR
	b) Number of hydrants per floor	Required	Provided	MR
	c) Hose Box	Required	Provided	MR
12.	Yard Hydrants			
	a) Total number of hydrants	-NA-	Provided	-NA-
	b) Hose Box	-NA-	Provided	-NA-
13.	Pumping Arrangements			
	• Ground Level	-NA-	-NA-	-NA-
	➤ Discharge of main Pump	-NA-	-NA-	-NA-
	➤ Head of Main pump	-NA-	-NA-	-NA-
	➤ Number of main pumps	-NA-	-NA-	-NA-
	➤ Jockey Pump out put	-NA-	-NA-	-NA-
	➤ Jockey pump head	-NA-	-NA-	-NA-
	➤ Standby Pump out put	-NA-	-NA-	-NA-
	➤ Standby Pump Head	-NA-	-NA-	-NA-
	➤ Auto Starting/Manual Stopping	-NA-	-NA-	-NA-
	➤ Pump House Access	-NA-	-NA-	-NA-
	Terrace level			
	➤ Discharge of pump	2 x 450lpm & 2 x 180lpm	Provided	MR
	➤ Head of the pump	40m	Provided	MR
	➤ Power Supply	Required	Provided	MR
	➤ Auto Starting of pump	Required	Provided	MR
14.	Captive Water Storage for fire fighting			
	• Underground tank capacity	-NA-	-NA-	-NA-
	➤ Draw-off connection	-NA-	-NA-	-NA-
	➤ Fire service inlet	-NA-	-NA-	-NA-
	➤ Access to tank	-NA-	-NA-	-NA-
	• Overhead Tank capacity	5,000ltr	15,000ltr	MR
15.	Exit Signage.	Required	Provided	MR
16.	Provision of Lifts.			
	a) Pressurization of Lift Shaft	-NA-	-NA-	-NA-
	b) Pressurization of Lift lobby	-NA-	-NA-	-NA-

	c) Communication In lift Car	-NA-	-NA-	-NA-
	d) Fireman's Grounding Switch	-NA-	-NA-	-NA-
	e) Lift Signage	-NA-	-NA-	-NA-
17.	Standby power supply	-NA-	-NA-	-NA-
18.	Refuge Area.			
	a) Total Area	-NA-	-NA-	-NA-
	b) Location	-NA-	-NA-	-NA-
19.	Fire Control Room			
	a) Detector System Panel	-NA-	-NA-	-NA-
	b) Flow Switch Panel	-NA-	-NA-	-NA-
	c) PA System Panel	-NA-	-NA-	-NA-
	d) Battery backup	-NA-	-NA-	-NA-
	e) Building Floor Plans	-NA-	-NA-	-NA-
20.	Special Fire Protection System for Protection of special Risks, if any:	-NA-	-NA-	-NA-

The fire protection systems provided in the building were test checked and found functional at the time of inspection.

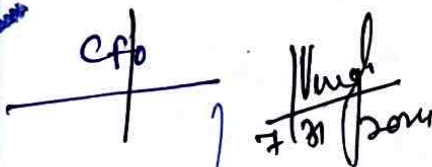
Keeping in view of the deemed compliance of the minimum standards of the fire prevention and fire safety measures required stipulated in **Director of Education Circular**, the FSC issued vide letter no. **F.6/DFS/MS/School/WZ/2021/94 dated 02.02.2021** is recommended for renewal under rule 37 of the Delhi Fire Service rules 2010.


 Signature of the Inspecting Officer
 Name Ajay Kumar Sharma
 Designation ADO(Rohini)

Dy. CFO(WZ)


 7/3/2024

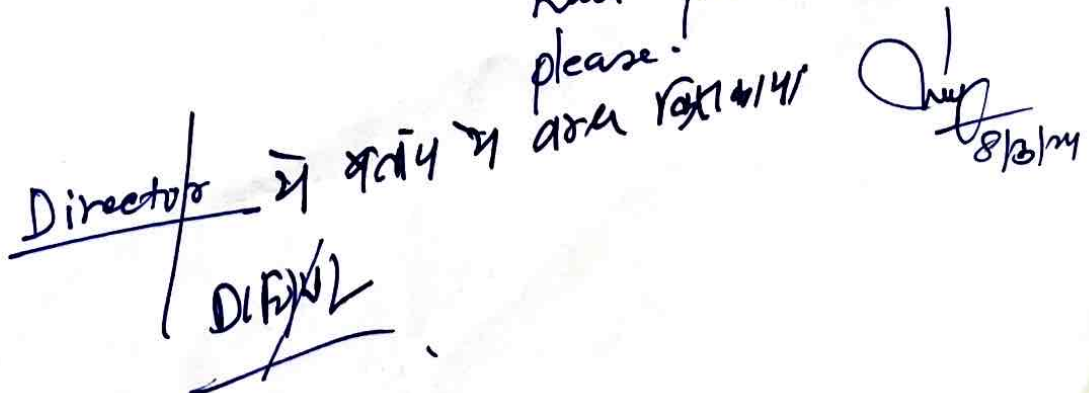
631
 7/3/2024


 CFO
 7/3/2024


 Director
 7/7/2024


 Anyker

FT letter to put up for
 kind perusal and signature
 please.
 7/17/24


 Director
 7/17/24
 D.F.S/WZ