

2/28

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI**  
**HEADQUARTERS: DELHI FIRE SERVICE: CANNAUGHT PLACE**

**NEW DELHI- 110001**

No.F.6/DFS/MS/School/2024/SZ/ 355

Dated: 26/04/2024

**FIRE SAFETY CERTIFICATE**

Certified that the **Triveni Bal Upvan** located at RZ-89, Gali No. 11, Madanpuri, West Sagarpur, New Delhi- 110046, Building comprised of ground floor plus three upper floors, owned/occupied by Triveni Bal Upvan, have complied with the fire prevention and fire safety requirements in accordance with the fire prevention and fire safety requirements in accordance with Rule 33 of the Delhi Fire Service Rules, 2010, verified by the officer concerned of this department on 10.04.2024 in the presence of Smt. Alpana Bhatnagar (Principal) and that the premises is fit for occupancy class B, 'Educational Building' (for basement, stilt, ground and 1<sup>st</sup> floor only) with effect from 26/04/2024.. for a period of three years in accordance with the Rule 36 unless renewed under Rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under Rule 38 of the Delhi Fire Service Rules, 2010, printed below.

Issued on... 26/04/2024 .....at New Delhi by.

  
(Atul Garg)

Director

Delhi Fire Service



Copy to:-

1. The Principal, Triveni Bal Upvan located at RZ-89, Gali No. 11, Madanpuri, West Sagarpur, New Delhi- 110046.
2. Director of Education, GNCT of NCT of Delhi, Old Secretariat, New Delhi.

**Following fire safety directives must be adhered to:-**

1. All the fire safety arrangements provided therein shall be maintained in good working condition at all times.
2. The means of escape shall be kept unlocked and unobstructed for unhindered evacuation of occupants in case of emergency.
3. Any loss of life or property due to non-functional fire safety measures shall be at the risk and responsibility of the management.
4. The trained staff should be available round the clock.
5. Any deviations w.r.t. construction shall be verified by the concerned building sanctioning agency.
6. The certificate may not be treated in any case for the regularization of the unauthorized construction, if any.
7. The owner/occupier shall submit a declaration every year in the form 'K' provided in the first schedule of Delhi Fire Service Rules 2010, form is available on [www.dfs.delhigovt.nic.in](http://www.dfs.delhigovt.nic.in).
8. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in the Form 'J' [sub rule (1) of rule 37] along with a copy of this Certificate, six months prior to its expiry.

N/14  
**INSPECTION REPORT**

1. Name & address of the building : Triveni Bal Upvan, RZ-89, Gali No-11, Madanpuri, West Sagarpur, New Delhi-110046
2. Building is comprised of : **Ground Floor plus three upper only**
3. Type of Occupancy : Educational
4. Type of Case : New
5. Details of Previous NOC : N/A
6. Fire Safety direction letter No : F.16/Estate/CC/Fire safety/2011/3298 to 3398 dated 01.03.2011
7. Date of Inspection : 10.04.2024
8. Name of the Inspecting Officers: : ADO R.K. YADAV
9. Name of the designation of Officer from the building side : Sh. Alpana Bhatnagar (Principal )
10. Year of Construction : Before 2010
11. Applicant's letter No : Nil, dated 13.03.2024

S.No	Minimum Standards on fire prevention and fire safety requirements U/R 33	Requirement	Provided at Site	Remarks MR/NMR
1	<b>Access to building</b>			
	Road width	6 mtrs.	06 mtrs.	MR
	Gate width	4.5 mtrs.	Directly accessible from road	MR
	Width of internal road	N.A.	N.A.	N.A.
2	<b>Number, Width, Type and Arrangement of Exits</b>			
	a. Number of Staircases			
	Upper Floor	02 No.	02 No.	MR
	Basement	N.A.	N.A.	N.A.
	B. Width of Staircases			
	Upper Floor	1.5 m & less than 0.75 m	1.5 & 1.0 m	MR ✓
	Basement	N.A.	N.A.	N.A.
	c. Protection of exits			
	Fire check door	N.A.	N.A.	N.A.
	Pressurization	N.A.	N.A.	N.A.
e. No. of continuous staircases to terrace	Required	Provided	MR	
g. Width of Corridor	1.5 m	1.5 m	MR	
h. Door Size	1 m	1 m (Double Door)	MR	
3	<b>Compartmentation.</b>			
	Fire check door	N.A.	N.A.	N.A.
	Sealing of electrical shafts	N.A.	N.A.	N.A.
	Fire rating of shaft door	N.A.	N.A.	N.A.
	Water curtain	N.A.	N.A.	N.A.
	Fire Dampers	N.A.	N.A.	N.A.
4	<b>Smoke Management System.</b>			
	Basement	N.A.	N.A.	N.A.
	Upper floor	Required	Natural Ventilation Provided	MR
5.	<b>Fire Extinguisher</b>			
	Total numbers	08 Nos.	08 Nos.	MR
	types	CO <sub>2</sub> & ABC	CO <sub>2</sub> & ABC	MR
IS marking	ISI marked	ISI marked	MR	



6	<b>First-aid-Hose Reels.</b>			MR
	Total numbers of each floor Length of hose reel hose Nozzle diameter	01 No.	01 No.	MR
		30 m	30 m	MR
		5 mm	5 mm	MR
7	<b>Automatic fire detection and alarming system.</b>			N.A.
Type of detectors Location of main panel Location of repeater panel Alternate source of power Hooters	N.A.	N.A.	N.A.	
	N.A.	N.A.	N.A.	
	N.A.	N.A.	N.A.	
	N.A.	N.A.	N.A.	
	N.A.	N.A.	N.A.	
8	MOEFA	N.A.	N.A.	
9	Public address System.	N.A.	N.A.	
10	<b>Automatic Sprinkler System.</b>			N.A.
basement upper floor sprinkler above false ceiling	N.A.	N.A.	N.A.	
	N.A.	N.A.	N.A.	
	N.A.	N.A.	N.A.	
11	<b>Internal Hydrants</b>			N.A.
size of riser/down-comer Number of hydrants per floor Hose Box	N.A.	N.A.	N.A.	
	N.A.	N.A.	N.A.	
	N.A.	N.A.	N.A.	
12	<b>Yard Hydrants.</b>			N.A.
Total number of hydrants Hose Box	N.A.	N.A.	N.A.	
	N.A.	N.A.	N.A.	
13	<b>Pumping Arrangements.</b>			N.A.
<ul style="list-style-type: none"> <li>• Ground Level</li> <li>➤ Discharge of main Pump</li> <li>➤ Head of Main Pump</li> <li>➤ Number of main pumps</li> <li>➤ Jockey pump out put</li> <li>➤ Jockey pump head</li> <li>➤ Standby pump out put</li> <li>➤ Standby pump Head</li> <li>➤ Auto Starting /Manual stopping</li> <li>➤ Pump House Access</li> <li>• Terrace Level</li> <li>➤ Discharge of pump</li> <li>➤ Head of the Pump</li> <li>➤ Power supply</li> <li>➤ Auto Starting of pump</li> </ul>	N.A.	N.A.	N.A.	
	N.A.	N.A.	N.A.	
	N.A.	N.A.	N.A.	
	N.A.	N.A.	N.A.	
	N.A.	N.A.	N.A.	
	N.A.	N.A.	N.A.	
	N.A.	N.A.	N.A.	
	N.A.	N.A.	N.A.	
	N.A.	N.A.	N.A.	
	N.A.	N.A.	N.A.	
	N.A.	N.A.	N.A.	
	450 LPM	450 LPM	MR	
	40 m	40 m	MR	
	Required	Provided	MR	
Required	Provided	MR		


14	<b>Captive Water Storage for Fire Fighting.</b>			N.A.
Underground tank capacity Draw-off connection Fire service inlet Access to tank Overhead Tank capacity	N.A.	N.A.	N.A.	
	N.A.	N.A.	N.A.	
	N.A.	N.A.	N.A.	
	N.A.	N.A.	N.A.	
	10,000 ltrs	10,000 ltrs	MR	
15	Exit Signage.	Required	Provided	MR
16	<b>Provision of Lifts.</b>			N.A.
Pressurization of Lift Shaft Pressurization of Lift lobby Communication in lift car Firemen's grounding switch Lift Signage	N.A.	N.A.	N.A.	
	N.A.	N.A.	N.A.	
	N.A.	N.A.	N.A.	
	N.A.	N.A.	N.A.	
	N.A.	N.A.	N.A.	


NILG

17	Standby power supply	N.A.	N.A.	N.A.
18	Refuge Area.			
	Total area	N.A.	N.A.	N.A.
	Location	N.A.	N.A.	N.A.
19	Fire Control Room			
	Detector system panel	N.A.	N.A.	N.A.
	Flow switch panel	N.A.	N.A.	N.A.
	PA system panel	N.A.	N.A.	N.A.
	Batter backup	N.A.	N.A.	N.A.
	Building Floor Plans	N.A.	N.A.	N.A.
20	Special Fire Protection systems for protection of special Risks, if any:	N.A.	N.A.	N.A.

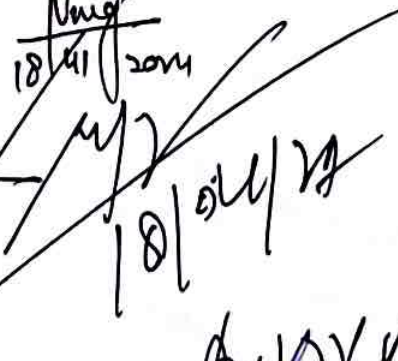
The fire protection systems provided in the building were test checked and found functional at the time of inspection. The shortcomings issued vide letter No. F6/DFS/MS/School/2020/SZ/601 dated 31.08.2020 has been rectify.

Keeping in view of the above compliance of the minimum standards of fire prevention and fire safety measures under Rule 35 of the Delhi Fire Service Rules 2010 it is recommended to grant Fire Safety Certificate.


  
 Signature of the Inspecting Officer  
 Name- R. K. Yadav  
 Designation- ADO (JKP)

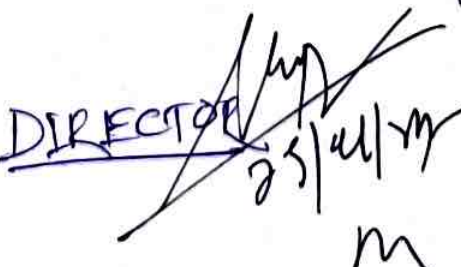
DO (South West)  
  
 16/4/24

CFO (SZ)  
  
 18/4/2024

~~Director~~  
  
 18/04/24

F-T letter a put up for signature please

  
 23/4/2024

~~DIRECTOR~~  
  
 25/4/24  
 m