

c/28

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI  
HEAD QUARTERS: DELHI FIRE SERVICE: CONNAUGHT PLACE  
NEW DELHI-110001**

No.F.6 DFS/MS/School/2024/SZ/ 395

Dated: 03 / 05 / 2024

**FIRE SAFETY CERTIFICATE**

Certified that the **Sarvodaya Kanya Vidyalaya (School ID 1923063)** located at Aya Nagar, New Delhi 110047 comprised of Ground plus Three upper floors owned/occupied by Directorate of Education, Govt. of NCT of Delhi was issued Fire Safety Certificate by this department vide letter No. F6/DFS/MS/School/2021/SZ/332 Dt. 16/04/2021. The said premises was re-inspected by officer concerned of this department on 24/04/2024 in presence of Ms. Geeta Yadav (Principal) of the school and found said school building have deemed complied with the fire prevention and fire safety requirements in accordance with rule 33 of the Delhi Fire Service Rules, 2010 and that the building is fit for occupancy class **"Educational Building Group - B"** with effect from 03 / 05 / 2024 for a period of **Three years** in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under rule 38 of Delhi Fire Service Rules 2010.

Issued on 03 / 05 / 2024 at New Delhi by

(ATUL GARG)  
DIRECTOR  
DELHI FIRE SERVICE

Copy to: -

1. The Principal, Sarvodaya Kanya Vidyalaya at Aya Nagar, New Delhi 110047
2. The Directorate of Education, Govt. of NCT of Delhi, Old Secretariat, New Delhi-54

**Conditions for the validity of Fire Safety Certificate:-**

1. All the means of escape/entry/exit shall be kept free from any obstruction.
2. All the fire safety arrangements provided therein shall be maintained in good working condition at all time as seen during inspection. Any loss of life or property due to non-functional fire safety measures shall be at the responsibility of the management.
3. All the staff members must know the correct method of operation of firefighting system.
4. The owner/ occupier shall submit a declaration every year in Form 'K' provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on [www.dfs.delhigovt.nic.in](http://www.dfs.delhigovt.nic.in)
5. This fire safety certificate may not in any way be treated as regularization (Clause 2.8 of UBBL-2016) of unauthorized construction or Alteration (Clause 1.4.3 of UBBL-2016), if any.
6. "The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in Form 'J' [sub rule (1) of rule 37] along with a copy of this Certificate, six months prior to its expiry."

R N/15  
**INSPECTION REPORT**

1	Name & Address of the Building	Sarvodaya kanya Vidyalaya, at Aya Nagar New Delhi 110047 (ID-1923063)		
2	Type of Occupancy	Educational		
3	Building Comprised of	Ground plus Three upper floor		
4	Type of Case	Renewal		
5	Details of Previous NOC	F6/DFS/MS/School/2021/SZ/332 Dt. 16/04/2021		
6	Fire Safety Directives Letter No	F.16/Estate/CC/Fire Safety/2011/3298 to 3398 dated 01.03.2011		
7	Date of Inspection	24/04/2024		
8	Name of the Inspecting Officers	Sh. Rajesh Kumar ADO (BCP)		
9	Name & Designation of Officers from the building side	Ms. Geeta Yadav (Principal)		
10	Year of construction	2016		
11	Applicant letter No.	Email Dated 08/04/2024		
S. No	Minimum standards on Fire Prevention and Fire Safety U/R 33	Old NOC requirements	Provided at Site	Remarks MR/NMR
1	<b>Access to Building.</b>			
	• Road width	Required	7 mtr	MR
	• Gate width	Required	5 x 2 mtr	MR
	• Width of internal road	-NA-	-NA-	-NA-
2	<b>Number, width, type &amp; arrangement of exits.</b>			
	<b>a) Number of Staircase</b>			
	➤ Upper floors.	02 Nos	04 Nos	MR
	➤ Basement floor.	-NA-	-NA-	-NA-
	<b>b) Width of Staircase</b>			
	➤ Upper floors	1.50 mtr	1.80 mtr each	MR
	➤ Basement floor	-NA-	-NA-	-NA-
	<b>c) Protection of exits</b>			
	➤ Fire check door	-NA-	-NA-	-NA-
	➤ Pressurization	-NA-	-NA-	-NA-
	<b>d) No. of continuous staircase to terrace</b>	One	02Nos provided	MR
	<b>e) Width of corridor</b>	-NA-	-NA-	-NA-
	<b>f) Door size</b>	1 mtr	1 mtr	MR
3	<b>Compartmentation.</b>			
	• Fire check door.	-NA-	-NA-	-NA-
	• Sealing of electrical shafts.	-NA-	-NA-	-NA-
	• Fire rating of shaft door.	-NA-	-NA-	-NA-
	• Water curtain	-NA-	-NA-	-NA-
	• Fire dampers.	-NA-	-NA-	-NA-
4.	<b>Smoke Management system.</b>			
	• Basement	30a/c per hour	-NA-	-NA-
	• Upper floors	12a/c per hour	-NA-	-NA-
5.	<b>Fire Extinguishers.</b>			
	• Total numbers	Required	35 Nos	MR
	• Types	CO <sup>2</sup> &ABC	CO <sup>2</sup> & ABC	MR
	• ISI Marking	ISI mark	Provided	MR
6.	<b>First Aid Hose Reels.</b>			
	• Total numbers on each floor.	04 Nos	Provided	MR
	• Length of hose-reel hose.	30 m	Provided	MR
	• Nozzle Diameter	5 mm	Provided	MR
7	<b>Automatic fire detection &amp; alarming system.</b>			
	• Type of detectors	-NA-	-NA-	-NA-

2116

	<ul style="list-style-type: none"> <li>Location of Main Panel</li> <li>Location of Repeater Panel</li> <li>Alternate source of power</li> <li>Hooter's location</li> </ul>	-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
8.	<b>MOEFA</b>	-NA-	-NA-	-NA-
9.	<b>Public Address System</b>	-NA-	-NA-	-NA-
10.	<b>Automatic Sprinkler System</b>			
	<ul style="list-style-type: none"> <li>Basement</li> </ul>	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> <li>Upper floors</li> </ul>	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> <li>Sprinkler above false ceiling</li> </ul>	-NA-	-NA-	-NA-
11.	<b>Internal Hydrants.</b>			
	<ul style="list-style-type: none"> <li>Size of Riser/Down-comer</li> </ul>	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> <li>Number of Hydrant per floor</li> </ul>	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> <li>Hose box.</li> </ul>	-NA-	-NA-	-NA-
12.	<b>Yard Hydrants.</b>			
	<ul style="list-style-type: none"> <li>Total number of hydrants.</li> </ul>	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> <li>Hose box.</li> </ul>	-NA-	-NA-	-NA-
13.	<b>Pumping arrangements.</b>			
	<ul style="list-style-type: none"> <li><b>Ground Level</b></li> </ul>			
	<ul style="list-style-type: none"> <li>Discharge of main pump.</li> </ul>	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> <li>Head of main pump.</li> </ul>	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> <li>Number of main pumps.</li> </ul>	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> <li>Jockey Pump output.</li> </ul>	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> <li>Jockey Pump head.</li> </ul>	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> <li>Standby Pump output.</li> </ul>	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> <li>Standby Pump head.</li> </ul>	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> <li>Auto Starting / Manual Stopping.</li> </ul>	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> <li>Pump house access.</li> </ul>	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> <li><b>Terrace Level</b></li> </ul>			
	<ul style="list-style-type: none"> <li>Discharge of pump.</li> </ul>	450 LPM x 2	Provided	MR
	<ul style="list-style-type: none"> <li>Head of pump.</li> </ul>	40 mtr	Provided	MR
	<ul style="list-style-type: none"> <li>Power supply.</li> </ul>	Required	Provided	MR
	<ul style="list-style-type: none"> <li>Auto starting of pump.</li> </ul>	Required	Provided	MR
14.	<b>Captive water storage for fire fighting.</b>			
	<ul style="list-style-type: none"> <li>Underground tank capacity.</li> </ul>	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> <li>Draw-off connection.</li> </ul>	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> <li>Fire Service Inlet.</li> </ul>	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> <li>Access to tank.</li> </ul>	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> <li>Overhead tank capacity.</li> </ul>	10,000 ltr	Provided	MR
15.	<b>Exit Signage.</b>	Required	Provided	MR
16.	<b>Provision of Lifts.</b>			
	<ul style="list-style-type: none"> <li>Pressurization of lift shaft.</li> </ul>	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> <li>Pressurization of lift lobby.</li> </ul>	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> <li>Communication in lift car.</li> </ul>	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> <li>Fireman's switch.</li> </ul>	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> <li>Lift signage.</li> </ul>	-NA-	-NA-	-NA-
17.	<b>Standby Power Supply</b>	-NA-	-NA-	-NA-
18.	<b>Refuge Area</b>			
	<ul style="list-style-type: none"> <li>Total area</li> </ul>	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> <li>Location</li> </ul>	-NA-	-NA-	-NA-
19.	<b>Fire Control Room.</b>			
	<ul style="list-style-type: none"> <li>Detector system panel.</li> </ul>	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> <li>Flow switch panel.</li> </ul>	-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-

2/17

	<ul style="list-style-type: none"> <li>PA system panel.</li> <li>Battery backup.</li> <li>Building floor plan.</li> </ul>	-NA-	-NA-	-NA-
20.	<b>Special Fire Protection System for the Protection of special Risk, if any.</b>	-NA-	-NA-	-NA-


The fire protection system provided in the building were randomly checked and found functional at the time of inspection.




Keeping in view of the deemed compliance of the minimum standard on fire prevention and fire safety measures as required under the rules, the FSC issued vide letter no F6/DFS/MS/School/2021/SZ/332 Dt. 16/04/2021, renewal under rule 37 of the Delhi Fire Service rules, 2010 is recommended.

Accordingly, DFA is put up for approval and signature please.





Signature of the Inspecting Officer  
Name: Sh. Rajesh Kumar  
Design: ADO (BCP)

DO (SD) 

efo   
26/11/2021  
Director   
26/11/21  
Approved 

As approved, f.e. letter is put up for your signature pl

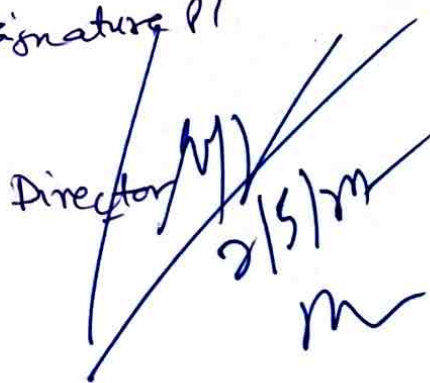Director   
2/5/21  


1/11  
21/10/2021  
