

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE: CONNAUGHT PLACE
NEW DELHI-110001**

No.F.6/DFS/MS/EH/2024/SZ/145

Dated.13..05./2024

FIRE SAFETY CERTIFICATE

Certified that the Eating House in the Name & Style of **M/s The Clay Oven** located at Ground floor, D-1, Green Park, Ashirwad Building, New Delhi 110016 in the building comprised of Basement, Ground plus three upper floor owned/occupied by Alliance Enterprises was issued Fire Safety Certificate by this department vide letter no. F6/DFS/MS/EH/SZ/2021/243 dated 22/09/2021. The restaurant premise was re-inspected by the officer concerned of this department on 08/05/2024 in the presence of Mr. Sree Kumar (Manager) and found that the said premise have deemed complied with the fire prevention and fire safety requirements in accordance with rule 33 of the Delhi Fire Service Rules, 2010 and that the premises is fit for occupancy **Class D "Assembly Building"** (Restaurant) and **validity upto 31/03/2027** in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010.

Issued on 13/05/2024 at New Delhi by


**(ATUL GARG)
DIRECTOR
DELHI FIRE SERVICE**

Copy to: -

1. The Addl. C.P (Lic/Branch) First Floor, PS Defence Colony, New Delhi - 110049. (Ref. MHA Portal ID 2024041204888 dated 12-04-2024)

Conditions for the validity of Fire Safety Certificate: -

1. All the means of escape/entry/exit shall be kept free from any obstruction.
2. All the fire safety arrangement provided therein shall be maintained in good working condition at all time as seen during inspection. Any loss of life property due to non-functional fire safety measures shall be at the responsibility of the management.
3. All the staff members must know the correct method of operation of fire fighting system.
4. The owner/occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on www.dfs.delhigovt.nic.in
5. This fire safety certificate may not in any way be treated as regularization (Clause 2.8 of UBBL-2016) of unauthorized construction or alteration (Clause 1.4.3 of UBBL-2016), if any.
6. "The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in form 'J' [sub rule (I) of rule 37] along with a copy of this Certificate, six month prior to its expiry."

INSPECTION REPORT

1	Name & Address of the Building	M/s The Clay Oven Restaurant at D-1, Green Park, Ashirwad Building, New Delhi 110016		
2	Type of Occupancy	Assembly 'Group-D' (Restaurant running at Ground floor only)		
3	Building comprised of	Basement, Ground plus three upper floors		
4	Type of Case	Renewal		
5	Details of Previous NOC	F6/DFS/MS/EH/SZ/2021/243 dated 22/09/2021		
6	Fire Safety Directives Letter No	Nil		
7	Date of Inspection	08.05.2024		
8	Name of the Inspecting Officers	DO (South) & ADO (BCP)		
9	Name & Designation of Officers from the building side	Mr. Sree Kumar (Manager)		
10	Year of construction/ date of conversion	2006		
11	Applicant letter No.	MHA Portal ID 2024041204888 dated 12-04-2024		
S. No.	Minimum standards on Fire Prevention and Fire Safety U/R 33	As per old NOC	Provided at Site	Remarks
1	Access to Building.			
	• Road width	Required	09 mtr	MR
	• Gate width	NA	NA	-NA-
	• Width of internal road	NA	NA	-NA-
2	Number, width, type & arrangement of exits			
	a. Number of Staircase			
	• Upper floors	NA	NA	-NA-
	• Basement floor	02	Provided	MR
	b. Width of Staircase			
	• Upper floors	NA	NA	-NA-
	• Basement floor	1.25 m	1.25 m & 0.93 m	MR (old case)
	c. Protection of exits			
	• Fire check door	-NA-	NA	-NA-
	• Pressurization	-NA-	NA	-NA-
	d. No. of continuous staircase to terrace	01	01	MR
	e. Width of corridor	N/A	N/A	N/A
	f. Door size	02 exits	1.10 m & 1.25 m	MR (old case)
3	Compartmentation.			
	• Fire check door.	N/A	N/A	N/A
	• Sealing of electrical shafts.	N/A	N/A	N/A
	• Fire rating of shaft door.	N/A	N/A	N/A
	• Water curtain	N/A	N/A	N/A
	• Fire dampers.	N/A	N/A	N/A
4	Smoke Management system.			
	• Basement	30 ACPH	Exhaust fan provided	MR
	• Upper floors	12 ACPH	Exhaust fan provided	MR
5	Fire Extinguishers.			
	• Total numbers	08 Nos	08 Provided	MR
	• Types	ABC / CO2	ABC & Co2	MR
	• ISI Marking	ISI marked	Provided	MR
6	First Aid Hose Reels.			
	• Total numbers on each floor.	One	Provided	MR
	• Length of hose-reel hose.	30m	Provided	MR
	• Nozzle Diameter	5mm	Provided	MR
7	Automatic fire detection & alarming system.			
	• Type of detectors	N/A	N/A	N/A

	<ul style="list-style-type: none"> Location of Main Panel Location of Repeater Panel Alternate source of power Hoover's location 	N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
8	MOEFA	Required	Provided	MR
9	Public Address System	-NA-	NA	-NA-
10	Automatic Sprinkler System			
	<ul style="list-style-type: none"> Basement 	Required	Provided	M/R
	<ul style="list-style-type: none"> Upper floors 	Required	Provided	M/R
	<ul style="list-style-type: none"> Sprinkler above false ceiling 	N/A	N/A	N/A
11	Internal Hydrants.			
	<ul style="list-style-type: none"> Size of Riser/Down-comer 	100mm	Provided	MR
	<ul style="list-style-type: none"> Number of Hydrant per floor 	-NA-	01 provided	-NA-
	<ul style="list-style-type: none"> Hose box. 	-NA-	01 provided	-NA-
12	Yard Hydrants.			
	<ul style="list-style-type: none"> Total number of hydrants. 	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> Hose box. 	-NA-	-NA-	-NA-
13	Pumping arrangements.			
	<ul style="list-style-type: none"> Ground Level 			
	<ul style="list-style-type: none"> Discharge of main pump. 	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> Head of main pump. 	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> Number of main pumps. 	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> Jockey Pump output. 	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> Jockey Pump head. 	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> Standby Pump output. 	N/A	-NA-	-NA-
	<ul style="list-style-type: none"> Standby Pump head. 	N/A	-NA-	-NA-
	<ul style="list-style-type: none"> Auto Starting / Manual Stopping. 	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> Pump House Access 	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> Terrace Level 			
	<ul style="list-style-type: none"> Discharge of pump. 	900 LPM	900 & 180 LPM	MR
	<ul style="list-style-type: none"> Head of pump. 	40m	35mtr	MR
	<ul style="list-style-type: none"> Power supply. 	Required	Provided	M/R
	<ul style="list-style-type: none"> Auto starting of pump. 	Required	Provided	M/R
14	Captive water storage for Fire Fighting.			
	<ul style="list-style-type: none"> Underground tank capacity. 	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> Draw-off connection. 	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> Fire Service Inlet. 	Required	Provided	M/R
	<ul style="list-style-type: none"> Access to tank. 	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> Overhead tank capacity. 	5,000 ltrs	5,000 ltrs	MR
15	Exit Signage.	Required	Provided	MR
16	Provision of Lifts.			
	<ul style="list-style-type: none"> Pressurization of lift shaft. 	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> Pressurization of lift lobby. 	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> Communication in lift car. 	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> Fireman's switch. 	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> Lift signage. 	-NA-	-NA-	-NA-
17	Standby Power Supply	Required	Provided	MR
18	Refuge Area			

2/19


	• Total area	-NA-	-NA-	-NA-
	• Location	-NA-	-NA-	-NA-
19	Fire Control Room.			
	• Detector System Panel.	-NA-	-NA-	-NA-
	• Flow Switch Panel.	-NA-	-NA-	-NA-
	• PA system Panel.	-NA-	-NA-	-NA-
	• Battery backup	-NA-	-NA-	-NA-
	• Building floor plan	-NA-	-NA-	-NA-
20	Special Fire Protection System for the Protection of special Risk, if any :	-NA-	-NA-	-NA-

The Fire protection systems provided in the premises were test checked at random and found functional at the time of inspection.

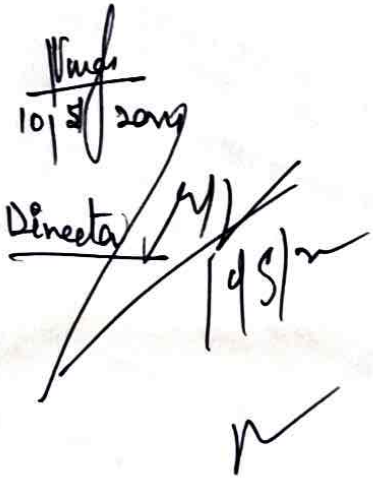
Keeping in view of the deemed compliance of the minimum standard on fire prevention and fire safety measures as required under the rules, the FSC issued vide letter no F6/DFS/MS/EH/SZ/2021/243 dated 22/09/2021, renewal under rule 37 of the Delhi Fire Service rules, 2010 is recommended.

Accordingly, DFA is put up for approval and signature please.

Signature of the Inspection Officer
Name: Sh. Manoj Kumar Sharma
Design: DC (South)


Signature of the Inspecting Officer
Name: Sh. Rajesh Kumar
Design: ADO (BCP)

CFO (HQ)


10/5/2024
Director
19/5/24

Uploaded
13/5/24
