

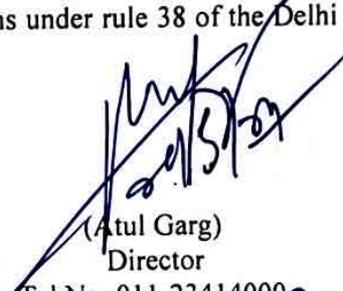
No. F6/DFS/MS/School/WZ/2024/ 447

Dated:- 21/05/2024

FIRE SAFETY CERTIFICATE

Certified that the Pioneer Convent Senior Secondary School Located at Loknayakpuram, Bakkarwala Road, Bakkarwala, New Delhi-110041, comprised of Ground + 03 Upper Floors & earlier the School building comprised of Ground and First floor was issued Fire Safety Certificate by this department Vide Letter No. F6/DFS/MS/School/WZ/2021/1008 dated 14/12/2021, owned/occupied by Pioneer Convent Senior Secondary School have complied with the fire prevention and fire safety requirements in accordance with Delhi Fire Service Act- 2007 & Rules- 2010 and verified by the officer concerned of Fire Service on 06/05/2024 in the presence of Dr. Parmod Kumar (Administrative Officer) and that the premises/building is fit for occupancy class "Educational Building" Group B with effect from 21/05/2024 for a period of **three years** in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010, printed below.

Issued on 21/05/2024 at New Delhi by.


(Atul Garg)
Director
Tel No. 011-23414000

Copy to: -

1. The Director, Directorate of Education, GNCT of Delhi, Old Secretariat Delhi – 110054.
2. The Principal, Pioneer Convent Senior Secondary School, Loknayakpuram, Bakkarwala Road, Bakkarwala, New Delhi-110041.

Following fire safety directives must be adhered to:-

1. All the means of escape shall be kept free of all type of obstruction all the time.
2. All the employees shall be acquainted with the use and maintenance of all fire equipments and method of smooth and speedy safe evacuation of occupants in case of emergency.
3. All the fire fighting equipments shall be maintained in perfect working condition all the time and any lapse rendering non-functional if fire safety measures, management shall be responsible.
4. Any deviation, with regards to construction, ventilation, occupation, electric installation etc. may be got verified from the concerned authorities.
5. The Fire Safety Certificate may not be treated in any case for regularizations of unauthorized construction / unauthorized use of land if any.
6. All comments / directions of licensing Department shall always be permitted and followed.
7. The owner /occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rule 2010. The form is available on www.dfs.delhigovt.nic.in
8. The owner / occupier shall apply for renewal of this Fire Safety Certificate to the Director in 'Form J' (sub Rule (1) of Rule 37) along with copy of the certificate, six months prior to its expiry.

Dr. J.C.
18/05/24

INSPECTION REPORT

1. Name & address of the building : Pioneer Convent Senior Secondary School located at Loknayakpuram, Bakkarwala Road, Bakkarwala, New Delhi-110041
2. Type of Occupancy : Educational
3. Type of Case : New Case/Addition of 2nd floor & 3rd floor
4. Details of previous NOC : F6/DFS/MS/School/WZ/2021/1008 dated 14/12/2021 (for **Ground & First Floor**)
5. Fire Safety directives letter No : N/A
6. Date of inspection : 04/05/2024
7. Name of the Inspecting Officers : Aman Kumar Lathar, ADO (JWP)
8. Name and designation of officers from the building side : Dr. Parmod Kumar (Administrative Officer)
9. Year of Construction : 2006 & 2021-22
10. Applicant's letter No. : PC/2024/03/533 dated 21/03/2024

The school building is comprised of Ground + 03 Upper Floors only.

S. No	Minimum Standards on fire prevention and fire safety U/R 33	Requirements as per NBC-IV & UBBL- 2016	Provided at site	Remarks MR/NMR
1	Access to building			
	• Road width	06 m	Provided	MR
	• Gate width	Accessible	Provided	MR
	• Width of internal road	N/A	N/A	N/A
2	Number, Width, Type & Arrangement of Exits			
	a. Number of staircases	-----	-----	-----
	• Upper Floors	02	Provided	MR
	• Basements	N/A	N/A	N/A
	b. Width of staircases	-----	-----	-----
	• Upper Floors	1.5 m each	1.5 m x 2	MR
	• Basements	N/A	N/A	N/A
	c. Protection of exits	-----	-----	-----
	• Fire check door	N/A	N/A	N/A
	• Pressurization	N/A	N/A	N/A
	e. No. of continuous staircases to terrace	02	02	MR
	g. Width of Corridor	1.5 m	Provided	MR
	h. Door Size	1.20 m	Provided	MR
3	Compartmentation.			
	• Fire check door	N/A	N/A	N/A
	• Sealing of electrical shafts	N/A	N/A	N/A
	• Fire Rating of shaft door	N/A	N/A	N/A
	• Water Curtain	N/A	N/A	N/A
	• Fire Dampers	N/A	N/A	N/A

4	Smoke Management System.			
	• Basements	NA	N/A	N/A
	• Upper floors	Required	Natural Ventilation	MR
5	Fire Extinguishers			
	• Total numbers	15 nos.	Provided	MR
	• Types	ABC, CO ₂ type	Provided	MR
	• IS marking	ISI marked	Provided	MR
6	First-Aid Hose Reels.			
	• Total numbers on each floor	02	Provided	MR
	• Length of hose reel hose	30 m	Provided	MR
	• Nozzle diameter	5 mm	Provided	MR
7	Automatic fire detection and alarming system			
	• Type of detectors	N/A	N/A	N/A
	• Location of Main Panel	N/A	N/A	N/A
	• Location of Repeater Panel	N/A	N/A	N/A
	• Alternate source of power	N/A	N/A	N/A
	• Hooters' Location	N/A	N/A	N/A
8	MOEFA	N/A	N/A	N/A
9	Public Address System.	N/A	N/A	N/A
10	Automatic Sprinkler System			
	• Basement	N/A	N/A	N/A
	• Upper floors	N/A	N/A	N/A
	• Sprinkler above false ceiling	N/A	N/A	N/A
11	Internal Hydrants			
	• Size of riser/down-comer	100 mm	Provided	MR
	• Number of hydrants per floor	02	Provided	MR
	• Hose Box	Required	Provided	MR
12	Yard Hydrants.			
	• Total number of hydrants	N/A	N/A	N/A
	• Hose Box	N/A	N/A	N/A
13	Pumping Arrangements			
	• Ground Level	---	----	-----
	➤ Discharge of main Pump	N/A	N/A	N/A
	➤ Head of Main pump	N/A	N/A	N/A
	➤ Number of main pumps	N/A	N/A	N/A
	➤ Jockey Pump out put	N/A	N/A	N/A
	➤ Jockey pump head	N/A	N/A	N/A
	➤ Standby Pump out put	N/A	N/A	N/A
	➤ Standby Pump Head	N/A	N/A	N/A
	➤ Auto Starting/ Manual stopping	N/A	N/A	N/A
	➤ Pump House Access	N/A	N/A	N/A
	• Terrace level	----	-----	-----
	➤ Discharge of pump	450 LPM	Provided	MR
	➤ Head of the pump	40 mts	Provided	MR
	➤ Power Supply	Required	Provided	MR
	➤ Auto Starting of pump	Required	Provided	MR

Captive Water Storage for fire fighting

	• Underground tank capacity	N/A	N/A	N/A
	➤ Draw-off connection	N/A	N/A	N/A
	➤ Fire service inlet	N/A	N/A	N/A
	➤ Access to tank	N/A	N/A	N/A
	• Overhead Tank capacity	10,000 ltrs.	Provided	MR
15	Exit Signage.	Required	Provided	MR
16	Provision of Lifts.			
	• Pressurization of Lift Shaft	N/A	N/A	N/A
	• Pressurization of Lift lobby	N/A	N/A	N/A
	• Communication In lift Car	N/A	N/A	N/A
	• Fireman's Grounding Switch	N/A	N/A	N/A
	• Lift Signage	N/A	N/A	N/A
17	Standby power supply	N/A	N/A	N/A
18	Refuge Area.			
	➤ Total Area	N/A	N/A	N/A
	➤ Location	N/A	N/A	N/A
19	Fire Control Room			
	• Detector System Panel	N/A	N/A	N/A
	• Flow Switch Panel	N/A	N/A	N/A
	• PA System Panel	N/A	N/A	N/A
	• Batter backup	N/A	N/A	N/A
	• Building Floor Plans	N/A	N/A	N/A
20	Special Fire Protection Systems for Protection of special Risks, if any:	N/A	N/A	N/A

Note:- Provision of lift is provided but still lift is not installed and lift shaft is closed at all floors by erecting brick wall.

Fire protection systems provided in the building were randomly test checked and found functional at the time of inspection.

In view the substantial compliance of the minimum standards on fire prevention and fire safety required under the rules, it is recommended to grant fire safety certificate under Delhi Fire Service Act- 2007 & Rules- 2010. DFA is put up for approval & signature please.

Accordingly, DFA is put up for approval please.

Signature
13/05/24
Aman Kumar Lathar
ADO (JWP)

DCFO (W2)

XFO/224-1112
Dated 15/05/24

Signature
15/5/2024

CFD
Signature
16/5/2024

Director
Signature
17/5/24

Signature
R.S.O