

c/21

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE: CONNAUGHT PLACE

NEW DELHI-110 001.

No.F.6/DFS/MS/School/2024/SZ/ 503

Dated: 05/06/2024

FIRE SAFETY CERTIFICATE

Certified that the **Garima Public School** at Near Holi Chowk, Village Ghumanhera, New Delhi-110073, comprised of ground plus two upper floors but school running at ground and 1st floor only, 2nd floor used for residence purpose only, owned/occupied by Garima Public School was issued Fire Safety Certificate by this department vide letter No F.6/DFS/MS/School/2020/SZ/227 dated 16.07.2020. The school building was re-inspected by the officer concerned of this department on 29.05.2024 in the presence of Sh. Sunil Kumar (Manager) and found that the Garima Public School have deemed complied with the fire prevention and fire safety requirements in accordance with the Circular No. F.16/Estate/CC/Fire Safety/2011/3298 to 3398 dated 01.03.2011 issued by the Director of Education and that the building/ premises (**Ground plus one upper floor**) is fit for occupancy class "Educational" w.e.f. the date of issue of this certificate for a period of **three years**, subject to compliance of the conditions printed as below.

Issued on 05/06/2024 at New Delhi.


(Atul Garg)
Director
Delhi Fire Service

Copy to:-

1. The Manager, Garima Public School, Near Holi Chowk, Village Ghumanhera New Delhi-110073
2. Director of Education, Govt. of NCT of Delhi, Old Secretariat, New Delhi - 110054.

Following fire safety directives must be adhered to:-

1. All the fire safety arrangements provided therein shall be maintained in good working condition at all times.
2. The means of escape shall be kept unlocked and unobstructed for unhindered evacuation of occupants in case of emergency.
3. Any loss of life or property due to non-functional fire safety measures shall be at the risk and responsibility of the management.
4. The trained staff should be available round the clock.
5. Any deviations w.r.t. construction shall be verified by the concerned building sanctioning agency.
6. The certificate may not be treated in any case for the regularization of the unauthorized construction, if any.
7. The owner/occupier shall submit a declaration every year in the form 'K' provided in the first schedule of Delhi Fire Service Rules 2010, form is available on www.dfs.delhigovt.nic.in.
8. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in the Form 'J' [sub rule (1) of rule 37] along with a copy of this Certificate, six months prior to its expiry.

INSPECTION REPORT

1. Name & address of the building : Garima Public School, Near Holi Chowk, Village Ghumanhera, New Delhi-110073
2. Type of Occupancy : Educational
3. Building comprised of : Ground plus two upper floors but school running at ground and 1st floor only. Second floor use for residence purpose only.
4. Type of Case : Renewal
5. Details of Previous NOC : F.6/DFS/MS/School/2020/SZ/227 dated 16.07.2020
6. Fire Safety directives letter No : Circular No. F.16/Estate/CC/Fire Safety/2011/3298 to 3398 dated 01.03.2011
7. Date of inspection : 29.05.2024
8. Name of Inspecting Officer : A.D.O. R.K. Yadav
9. Name and designation of officers
From the building side : Sh. Sunil Kumar (Manager)
10. Year of Construction : 2004-2005
11. Applicant's letter No. : Outdoor Diary No. 1837 dated 17.05.2024

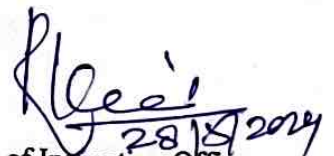
S. No.	Minimum Standards on fire prevention and fire safety U/R 33	Dir. of Edu. Circular Dt. 01.03.2011	Provided at site	Remarks MR/NMR
1.	Access to building			
	<ul style="list-style-type: none"> Road width Gate width Width of internal road 	Accessible 4.5 mtrs N/A	4.5 mtrs Directly accessible from road N/A	MR, being old case M/R N/A
2.	Number, Width, Type & Arrangement of Exits			
	a. Number of staircases			
	<ul style="list-style-type: none"> Upper Floors Basements 	01 no.	02 no.'s	MR
	b. Width of staircases	N/A	N/A	N/A
	<ul style="list-style-type: none"> Upper Floor Basements 	150 cms/additional staircase of 75 cms if less than 150 cms	150 & 135 cms	MR
	c. Protection of exits	N/A	N/A	N/A
	<ul style="list-style-type: none"> Fire check door Pressurization 	N/A	N/A	N/A
	d. No. of continuous staircases to terrace	N/A	One	N/A
	e. Width of Corridor	150 cms	155 cms	MR
	f. Door Size	100 cms	90 cms (double door)	MR, being old case & students are less than 45 in each class
3.	Compartmentation			
	<ul style="list-style-type: none"> Fire check door Sealing of electrical shafts Fire Rating of shaft door Water Curtain Fire Dampers 	N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
4.	Smoke Management System			
	<ul style="list-style-type: none"> Basements 	N/A	N/A	N/A
	<ul style="list-style-type: none"> Upper floors 	Required	Natural Ventilation provided	MR
5.	Fire Extinguishers			
	<ul style="list-style-type: none"> Total numbers Types IS marking 	07 No's ABC/CO ₂ type ISI marked	Provided Provided ISI marked	MR MR MR

N/19


17.	Standby power supply	N/A	N/A	N/A
18.	Refuge Area.			
	➤ Total Area	N/A	N/A	N/A
	➤ Location	N/A	N/A	N/A
19.	Fire Control Room			
	• Detector System Panel	N/A	N/A	N/A
	• Flow Switch Panel	N/A	N/A	N/A
	• PA System Panel	N/A	N/A	N/A
	• Battery backup	N/A	N/A	N/A
	• Building Floor Plan	N/A	N/A	N/A
20.	Special Fire Protection System for Protection of special Risks, if any:	N/A	N/A	N/A


The fire protection systems provided in the building were tested, checked and found functional at the time of inspection.

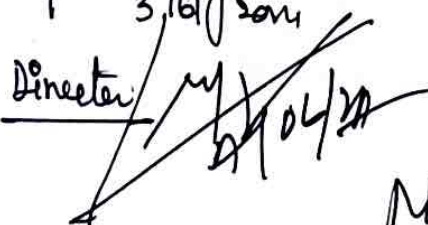
In view of the deemed compliance of the minimum standards of fire prevention and fire safety measures as required under the rules the FSC issued vide letter number F.6/DFS/MS/School/2020/SZ/227 dated 16.07.2020, renewal in accordance with the Circular No. F.16/Estate/CC/Fire Safety/2011/3298 to 3398 dated 01.03.2011 issued by the Director of Education is recommended.


 Signature of Inspecting Officer
 Name: - R.K Yadav
 Designation: - A.D.O. (JKP)

D.O. (South West)


 3/6/24

CFO(S2) 
 3.6.2024

Director 
 29/04/24

N/21