

024

FORM 'H'
FORM FOR ISSUING FIRE SAFETY CERTIFICATE
[Refer sub - rule (1) of rule 35]
GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEAD QUARTERS: DELHI FIRE SERVICE, CONNAUGHT PLACE
NEW DELHI

No. F6/DFS/MS/2024/GH/150

Dated: 16/05/2024

FIRE SAFETY CERTIFICATE

Certified that the building of M/s Hotel Bricks Located at T-2404, Faiz Road, Subhash Nagar, New Delhi - 110005, in a building comprised of basement, stilt, ground plus three upper floors using basement as (storage hall), stilt (parking), ground, first, second & third floor (5 rooms each floor), (Total=15 guest rooms) was issued FSC vide Letter No F6/DFS/MS/EH/SZ/2021/431, dated 28/09/21. The premises was re inspected by the officer concerned of this department on 08/05/2024 in the presence of Sh. Umesh Singh and observed that all the fire prevention and fire safety arrangements provided in the premises found in good working condition. The premises have therefore deemed complied with the fire prevention and fire safety requirements in accordance with Rule 33 of the Delhi Fire Service Rules, 2010 and that the premises is fit for occupancy class "Residential" (guest house) at **ground, first, second & third floor (5 rooms each floor)**, (Total=15 guest rooms), with effect from 16/05/2024 for a period of three years in accordance with Rule 36 unless renewed under Rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under Rule 38 of the Delhi Fire Service Rules, 2010.

Issued on 16/05/2024... at New Delhi by.


(Atul Gang)
Director
Delhi Fire Service
OK

Copy to:

1. The Joint. Commissioner of Police (Lic), 1st Floor, Licensing Unit, Police Station, Defence Colony, New Delhi.
2. The Manager, M/s Hotel Bricks Located at T-2404, Faiz Road, Subhash Nagar, New Delhi - 110005.

Following fire safety directives must be adhered to:-

1. **4th floor shall not be used for any purpose as undertaking given by owner.**
2. All the fire safety arrangements provided therein shall be maintained in good working condition at all times.
3. Any loss of life or property due to non-functional fire safety measures shall be at the risk and responsibility of the management.
4. The trained staff should be available round the clock.
5. Any deviations w.r.t. construction shall be verified by the concerned building sanctioning agency.
6. The certificate may not be treated in any case for the regularization of the unauthorized construction, if any.
7. Basement strictly shall be kept vacant as seen during inspection.
8. The owner/ occupier shall apply for renewal of this Fire Safety Certificate to the Director in Form 'J' [sub rule (1) of rule 37] along with a copy of this certificate, six months prior to its expiry.
9. The owner/occupier shall submit a declaration every year in the form 'K' provided in the first schedule of Delhi Fire Service Rules 2010, form is available on www.dfs.delhigovt.nic.in

c/26

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEAD QUARTERS: DELHI FIRE SERVICE, CONNAUGHT PLACE
NEW DELHI-110001

No. F6/DFS/MS/SZ/2024 | 41 | 272

Dated: 27/05/2024

CORRIGENDUM

This department has issued Fire Safety Certificate vide letter no. F6/DFS/MS/2024/GH/150, dated 16/05/2024 to M/s Hotel Bricks Located at T-2404, Faiz Road, Subhash Nagar, New Delhi – 110005. In the letter total rooms may be read as 20 rooms in place of 15 rooms, rest all the contents remain unchanged.


(Atul Garg)
Director
Delhi Fire Officer
o/c
27/5/24

Copy to:-

1. The Joint. Commissioner of Police (Lic), 1st Floor, Licensing Unit, Police Station, Defence Colony, New Delhi.
2. The Manager, M/s Hotel Bricks Located at T-2404, Faiz Road, Subhash Nagar, New Delhi – 110005.

INSPECTION REPORT

1. Name & address of the building: M/s Hotel Bricks Located at T-2404, Faiz Road, Subhash Nagar, New Delhi - 110005.
2. Type of Occupancy : Lodging or rooming "A-1"
3. Type of Case : Renewal (Running at Ground+3 UFs in a building comprised of Basement + Stilt + Ground + 3 Upper Floor)
4. Details of previous NOC : F6/DFS/MS/EH/SZ/2021/431, dated 28/09/21
5. Fire Safety directives Letter No. : NA
6. Date of inspection : 08/05/2024
7. Name of the Inspecting Officer : ADO (DWK)
8. Name and designation of Officer
from the building side : Sh. Umesh Singh
9. Year of Construction : Before 2010-11
10. Applicant's letter No. : 2024041805447, dated 18/04/2024

S No	Minimum standards on fire prevention and fire safety U/R 33	As per N/01, N/02 & N/03	Provided at site	Remarks MR/NMR
1.	Access of building	06 mtr	Provided	MR
	• Road width	Required	Direct Accessible From Road	NA
	• Gate width	NA	NA	NA
	• Width of internal road			
2.	Number, width, Type & Arrangements of exits			
	a. Number of staircases	02 Nos.	02 Nos.	MR
	• Upper floors	02 Nos.	02 Nos.	MR
	• Basements			
	b. Width of staircases	1.5m	Provided	MR
	• Upper floors	1.5m	Provided	MR
	• Basements			
	c. Protection of exits			
	• Fire check door	NA	NA	NA
	• Pressurization	NA	NA	NA
	d. No of continuous staircase to terrace	02 Nos	02	MR
	e. Width Of Corridor	1.40m	Provided	MR
	f. Door Size	1 m	Provided	MR
3.	Compartmentation			
	• Fire check door	NA	NA	NA
	• Sealing of electrical shafts	NA	NA	NA
	• Fire Rating of shaft door	NA	NA	NA
	• Water Curtain	NA	NA	NA
	• Fire Dampers	NA	NA	NA




4.	Smoke managements System			
	• Basements	30 a/c per hour	Exhaust Fan	MR
	• Upper floors	12 a/c per hour	Natural ventilation	MR
5.	Fire Extinguishers			
	• Total numbers	14 Nos.	Provided	MR
	• Types	ABC & CO ₂	CO ₂ & ABC	MR
	• IS marking	Required	Provided	MR
6.	First – Aid Hose Reels			
	• Total numbers on each floor	01	Provided	MR
	• Length of hose reel hose	30 mtr	30 mtr	MR
	• Nozzle diameter	5 mm	Provided	MR
7.	Automatic fire detection and alarming system			
	• Type of detectors	CO detectors	Provided	MR
	• Location of Main Panel	Required	Provided	MR
	• Location of Repeater Panel	NA	NA	NA
	• Alternate source of power	Required	Provided	MR
	• Hooters' Location	NA	NA	NA
8.	MOEFA	Required	Provided	MR
9.	Public Address System	Required	Provided	MR
10.	Automatic Sprinkler System			
	• Basements	NA	Provided	Area less than 200 sq.mtr
	• Upper Floor	NA	NA	NA
	• Sprinkler above false ceiling	NA	NA	NA
11.	Internal Hydrants:			
	• Size of riser/down- comer	NA	NA	NA
	• Number of hydrants per floor	NA	NA	NA
	• Hose Box	NA	NA	NA
12.	Yard Hydrants			
	• Total number of hydrants	NA	NA	NA
	• Hose Box	NA	NA	NA
13.	Pumping Arrangements:			
	• Ground Level			NA
	• Discharge of main pump	NA	NA	NA
	➤ Head of main pump	NA	NA	NA
	➤ Number of main pumps	NA	NA	NA
	➤ Jockey pump out put	NA	NA	NA
	➤ Jockey pump head	NA	NA	NA
	➤ Standby Pump out put	NA	NA	NA
	➤ Standby Pump Head	NA	NA	NA
	➤ Auto Staring/Manual stopping	NA	NA	NA
	➤ Pump House Access	NA	NA	NA
	• Terrace level			
	➤ Discharge of pump	450 lpm	Provided	MR
	➤ Head of the pump	40 mtrs	Provided	MR
	➤ Power supply	Required	Provided	MR
	➤ Auto starting of pump	Required	Provided	MR


Handwritten signature and initials.

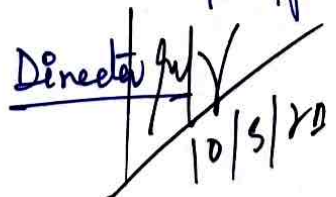
14.	Captive water Storage for fire fighting:			
	• Under ground tank capacity	NA	NA	NA
	➤ Draw off connection	NA	NA	NA
	➤ Fire service inlet	NA	NA	NA
	➤ Access to tank	NA	NA	NA
	• Overhead Tank capacity	10000 ltr	Provided	MR
15	Exit Signage	Required	Provided	MR
16.	Provision of Lifts			
	➤ Pressurization of Lift Shaft	NA	NA	NA
	➤ Pressurization of lift lobby	NA	NA	NA
	➤ Communication in lift Car	Required	Provided	MR
	➤ Fireman's Grounding Switch	Required	Provided	MR
	➤ Lift Signage	Required	Provided	MR
17.	Standby power supply	Required	Provided	MR
18.	Refuge Area			
	➤ Total area	NA	NA	NA
	➤ Location	NA	NA	NA
19.	Fire control room			
	➤ Detector system panel	NA	NA	NA
	➤ Flow Switch Panel	NA	NA	NA
	➤ PA System Panel	NA	NA	NA
	➤ Battery backup	NA	NA	NA
	➤ Building Floor Plans	NA	NA	NA
20.	Special Fire Protection Systems for Protection of special Risks, if any;	Required	02 ABC type fire extinguisher found provided near elect. Panel	MR

The fire protection systems provided in the building were test checked and found functional at the time of inspection.

In view of the deemed compliance of minimum standards on fire prevention and fire safety as required under the rules the FSC issued vide letter No. F6/DFS/MS/GH/SZ/2022/431, dated 28/09/21 renewal under Rule 37 of the Delhi Fire Service Rules 2010 is recommended.


Signature of the Inspecting Officer
Name: Sh. Udaivir Singh
Designation : ADO (DWK)


CFO (SZ)
10/5/2024


Director
10/5/20

