

FORM 'H'  
FORM FOR ISSUING FIRE SAFETY CERTIFICATE  
[Refer sub - rule (1) of rule 35]  
GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI  
HEAD QUARTERS: DELHI FIRE SERVICE, CONNAUGHT PLACE  
NEW DELHI

No.F6/DFS/MS/2024/SZ/ 340

Dated: 05/06/2024

**FIRE SAFETY CERTIFICATE**

Certified that the M/s Reliance ambit trade pvt. Ltd. Located at Commercial plot no. 1, City Centre, Sector-13, Dwarka, New Delhi – 110045, comprised of 3 basement, Ground + 03 Upper Floors was issued FSC vide Letter No. F6/DFS/MS/2021/SZ/302 dated 07/07/2021. The premises was re inspected by the officers concerned of this department on 29/05/2024 in the presence of Sh. Sunil Kumar Sharma (EGM) and found that the said building have deemed complied with the fire prevention and fire safety requirements in accordance with Rule 33 of the Delhi Fire Service Rule, 2010 and that the premises is fit for occupancy class "Mercantile Building" with effect from 05/06/2024 for a period of three years in accordance with Rule 36 unless renewed under Rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under Rule 38 of the Delhi Fire Service Rules, 2010.

Issued on 05/06/2024 at New Delhi by.

  
(Atul Garg)  
Director  
Delhi Fire Service  
o/c

Copy to:

1. Sh. Sunil Sharma, Reliance ambit trade pvt. Ltd. Located at Commercial plot no. 1, City Centre, sector-13, Dwarka, New Delhi – 110045.
2. The Vice Chairman (Bldg.), DDA, INA Vikas Sadan New Delhi-110023.

**Following fire safety directives must be adhered to:-**

- 1 All the fire safety arrangements provided therein shall be maintained in good working condition at all times.
- 2 Any loss of life or property due to non-functional fire safety measures shall be at the risk and responsibility of the management.
- 3 The trained staff should be available round the clock.
- 4 Any deviations w.r.t. construction shall be verified by the concerned building sanctioning agency.
- 5 The certificate may not be treated in any case for the regularization of the unauthorized construction, if any.
- 6 The owner/ occupier shall apply for renewal of this Fire Safety Certificate to the Director in Form 'J' [sub rule (1) of rule 37] along with a copy of this certificate, six months prior to its expiry.
- 7 Basement shall be used strictly as per building bye laws.
- 8 The owner/occupier shall submit a declaration every year in the form 'K' provided in the first schedule of Delhi Fire Service Rules 2010, form is available on [www.dfs.delhigovt.nic.in](http://www.dfs.delhigovt.nic.in).

N/22

**INSPECTION REPORT**

1. Name & address of the building: M/s Reliance ambit trade pvt. Ltd. Located at Commercial plot no. 1, city centre, sector-13, Dwarka, new deli – 110045.
2. Type of Occupancy : Mercantile
3. Type of Case : Renewal (3 Basement + Ground + 03 Upper Floors)
4. Details of previous NOC: F6/DFS/MS/2021/SZ/302 dated 07/07/2021
5. Fire Safety directives L. No: F6/DFS/MS /BP/2008/613 Dated 29/02/2008  
& F6/DFS/MS/BP/2012/2955 Dated 13/08/2012
6. Date of inspection : 29/05/2024
7. Name of the Inspecting Officer : DO (SW) & ADO (DWK)
8. Name and designation of Officer  
from the building side : Sh. Sunil Kumar Sharma (EGM)
9. Year of Construction : 2014
10. Applicant's letter No. : Nil dated 21/05/2024

S No	Minimum standards on fire prevention and fire safety U/R 33	As per N/13	Provided at site	Remarks MR/NMR
1.	Access of building			
	• Road width	06 m	20 m	MR
	• Gate width	06 m	06 m	MR
	• Width of internal road	06 m	As per controlled Drawing	MR
2.	Number, width, Type & Arrangements of exits			
	a. Number of staircases			
	• Upper floors	03 Nos.	03 Nos.	MR
	• Basements	09 Nos.	9 Nos. + 01 Ramp	MR
	b. Width of staircases			
	• Upper floors	1.5 mtr	02 mtr	MR
	• Basements	1.5 mtr - 02 mtr	2.00/1.8/1.50 mtr + 1 ramp 7.5 mtr (Two way)	MR
	c. Protection of exits			
	• Fire check door	Required	Provided	MR
	• Pressurization	Required	Provided	MR
	d. No of continuous staircase to terrace	03 Nos	Provided	MR
	e. Width Of Corridor	2.40 mtr	02 to 5 mtr	MR
	f. Door Size	1.5 mtr	1.5 mtr	MR
3.	Compartmentation			
	• Fire check door	Required	Provided	MR
	• Sealing of electrical shafts	Required	Provided	MR
	• Fire Rating of shaft door	Required	Provided	MR
	• Water Curtain	Required	Provided	MR
	• Fire Dampers	Required	Provided	MR




4.	Smoke managements System				MR
	• Basements	Required	Provided		MR
	• Upper floors	Required	Provided		
5.	Fire Extinguishers			121 Nos.	MR
	• Total numbers	120 nos ABC & CO2	ABC, CO2, DCP & WCO2		MR
	• Types	ISI marked	Provided		MR
	• IS marking				
6.	First – Aid Hose Reels			Provided	MR
	• Total numbers on each floor	Basement 2 & 1 (7 Nos.) GF 06 Nos. & 1 <sup>st</sup> to 3 <sup>rd</sup> floor 04 Nos.			MR
	• Length of hose reel hose	30 m	Provided		MR
	• Nozzle diameter	5 mm	Provided		MR
7.	Automatic fire detection and alarming system				MR
	• Type of detectors	Heat & Smoke	Provided		MR
	• Location of Main Panel	Ground floor	Ground floor		MR
	• Location of Repeater Panel	Required	Provided at ground floor		MR
	• Alternate source of power	Required	Battery backup		MR
	• Hooters' Location	Appropriate place	Provided		MR
8.	MOEFA	Required	Provided		MR
9.	Public Address System	Required	Provided		MR
10.	Automatic Sprinkler System				MR
	• Basements	Required	Provided		MR
	• Upper Floor	Required	Provided		MR
	• Sprinkler above false ceiling	Required	Provided		MR
11.	Internal Hydrants:				MR
	• Size of riser/down- comer	150 mm	Provided		MR
	• Number of hydrants per floor	04no's each floor	Provided		MR
	• Hose Box	Required	Provided		MR
12.	Yard Hydrants				MR
	• Total number of hydrants	12 Nos.	12 Nos.		MR
	• Hose Box	Required	Provided		MR
13.	Pumping Arrangements:				
	• Ground Level	2850 lpm	Provided		MR
	• Discharge of main pump	70 m	Provided		MR
	➤ Head of main pump	2 Nos.	Provided		MR
	➤ Number of main pumps	2 X 180 lpm	Provided		MR
	➤ Jockey pump out put	70 m	Provided		MR
	➤ Jockey pump head	1X2850 lpm	Provided		MR
	➤ Standby Pump out put	70 m	Provided		MR
	➤ Standby Pump Head	Required	Provided		MR
	➤ Auto Staring/Manual stopping	Required	Provided		MR
	➤ Pump House Access	Required	Provided		MR
	• Terrace level				NA
	➤ Discharge of pump	NA	NA		NA
	➤ Head of the pump	NA	NA		NA
	➤ Power supply	NA	NA		NA
	➤ Auto starting of pump	NA	NA		NA

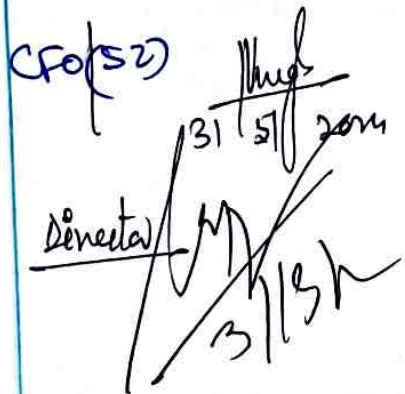
14.	Captive water Storage for fire fighting:			
	• Under ground tank capacity	At ground level	1,00,000 ltr	MR
	➤ Draw off connection	Required	Provided	MR
	➤ Fire service inlet	Required	Provided	MR
	➤ Access to tank	Required	Provided	MR
	• Overhead Tank capacity	10 KL	20 KL	MR
15.	Exit Signage	Required	Provided	MR
16.	Provision of Lifts			
	➤ Pressurization of Lift Shaft	Required	Provided	MR
	➤ Pressurization of lift lobby	Required	Provided	MR
	➤ Communication in lift Car	Required	Provided	MR
	➤ Fireman's Grounding Switch	Required	Provided	MR
	➤ Lift Signage	Required	Provided	MR
17.	Standby power supply	Required	D.G Set	MR
18.	Refuge Area			
	➤ Total area	NA	NA	NA
	➤ Location	NA	NA	NA
19.	Fire control room			
	➤ Detector system panel	Required	Provided	MR
	➤ Flow Switch Panel	Required	Provided	MR
	➤ PA System Panel	Required	Provided	MR
	➤ Battery backup	Required	Provided	MR
	➤ Building Floor Plans	Required	Provided	MR
20.	Special Fire Protection Systems for Protection of special Risks, if any;	CO2 trolley near HT, LT panels	Provided	MR

The fire protection systems provided in the building were test checked and found functional at the time of inspection.

In view of the deemed compliance of minimum standards on fire and fire safety as required under the rules the FSC issued vide letter No. F6/DFS/MS/2021/SZ/302 dated 07/07/2021 renewal under Rule 37 of the Delhi Fire Service Rules 2010 is recommended. If approved, the FSC may be issued.

  
 Sign of Inspecting Officer  
 Name: Sh. Vedpal  
 Designation: DO/SW

  
 Sign of Inspecting Officer  
 Name: Udai vir Singh  
 Designation: ADO/DWK

  
 Director  
 31/5/2024

