

C/37

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE: CANNAUGHT PLACE

NEW DELHI- 110001


No. F6/DFS/MS/School/SZ/2024/ 518

Dated: 10/06/2024

FIRE SAFETY CERTIFICATE

Certified that the **Shivam Bharti Modern School** at F-65 Vishwas Park, Shani Bazar Road, Uttam Nagar New Delhi-110059, comprised of ground plus Three upper floor owned/occupied Shivam Bharti Modern School was issued FSC vide letter no. F.6/DFS/MS/school/SZ/2021/71 dated 01.02.2021. The school building was re- inspected by the officer concerned of this department on dated 31.05.2024 in the presence of Ms. Sunita Kumari (Manager) and found that the school building have deemed complied with the fire prevention and fire safety requirements in accordance with Rule 33 of the Delhi Fire Service Rules, 2010 and that the building/premises is fit for occupancy class "Educational" w.e.f 10/06/2024 for a period of **three years** in accordance with Rule 36 unless renewed under Rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under Rule-38 of the Delhi Fire Service Rules, 2010 printed as below.

Issued on.....10/06/2024..... at New Delhi.


(Atul Garg)
Director
Delhi Fire Service
2/9-

Copy to:-

- 1 The Manager, Shivam Bharti Modern School at F-65 Vishwas Park, Shani Bazar Road, Uttam Nagar New Delhi-110059.
2. Director of Education, Govt. of NCT of Delhi, Old Secretariat, New Delhi-110054.

Following fire safety directives must be adhered to:-

1. All the fire safety arrangements provided therein shall be maintained in good working condition at all times.
2. The means of escape shall be kept unlocked and unobstructed for unhindered evacuation of occupants in case of emergency.
3. Any loss of life or property due to non-functional fire safety measures shall be at the risk and responsibility of the management.
4. The trained staff should be available round the clock.
5. Any deviations w.r.t. construction shall be verified by the concerned building sanctioning agency.
6. The certificate may not be treated in any case for the regularization of the unauthorized construction, if any.
7. The owner/occupier shall submit a declaration every year in the form 'K' provided in the first schedule of Delhi Fire Service Rules 2010, form is available on www.dfs.delhigovt.nic.in.
8. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in the Form 'J' [sub rule (1) of rule 37] along with a copy of this Certificate, six months prior to its expiry.

INSPECTION REPORT

1. Name & address of the building : Shivam Bharti Modern School, F-65, Vishwas Park, Shani Bazaar Road, Uttam Nagar, New Delhi-110059.
2. Building is comprised of : **Ground plus Three upper floor**
3. Type of Occupancy : Educational
4. Type of Case : Renewal
5. Details of Previous NOC : F.6/DFS/MS/school/SZ/2021/71 dated 01.02.2021
6. Fire Safety direction letter No : N/A
7. Date of Inspection : 31.05.2024
8. Name of the Inspecting Officers: : ADO R.K. YADAV
9. Name of the designation of Officer from the building side : Ms. Sunita Kumari (Manager)
10. Year of Construction : Before 2008 (GF & FF) & After 2019 (SF & TF)
11. Applicant's letter No : Online email Id sbms9918@gmail.com dated 17.05.2024

S.No	Minimum Standards on fire prevention and fire safety requirements U/R 33	Requirments as par FSC dt. 01.02.2024	Provided at Site	Remarks MR/NMR
1	Access to building			
	Road width	6 mtrs.	06 mtrs.	MR
	Gate width	4.5 m	Direct accessible from road	MR
	Width of internal road	N.A.	N.A.	N.A.
2	Number, Width, Type and Arrangement of Exits			
	a. Number of Staircases			
	Upper Floor	2 nos.	3 nos.	MR
	Basement	N.A.	N.A.	N.A.
	B. Width of Staircases			
	Upper Floor	1.5 m each	2 no. of 1.5 m & 1 no. of 1.30 m	MR ✓
	Basement	N.A.	N.A.	N.A.
	c. Protection of exits			
	Fire check door	N.A.	N.A.	N.A.
	Pressurization	N.A.	N.A.	N.A.
	e. No. of continuous staircases to terrace	2 nos.	2 nos.	MR
g. Width of Corridor	1.5 m	1.5 m	MR	
h. Door Size	1.20 m & 1.0 m	1.20 m & 1.0	MR	
3	Compartmentation.			
	Fire check door	N.A.	N.A.	N.A.
	Sealing of electrical shafts	N.A.	N.A.	N.A.
	Fire rating of shaft door	N.A.	N.A.	N.A.
	Water curtain	N.A.	N.A.	N.A.
	Fire Dampers	N.A.	N.A.	N.A.
4	Smoke Management System.			
	Basement	N.A.	N.A.	N.A.
	Upper floor	Required	Natural ventilation	MR

N/17


5.	Fire Extinguisher			
	Total numbers	09 Nos.	09 Nos.	MR
	types	CO ₂ & ABC	CO ₂ & ABC	MR
	IS marking	ISI marked	ISI marked	MR
6	First-aid-Hose Reels.			
	Total numbers of each floor	One	Provided	MR
	Length of hose reel hose	30 m	Provided	MR
	Nozzle diameter	5 mm	Provided	MR
7	Automatic fire detection and alarming system.			
	Type of detectors	N.A.	N.A.	N.A.
	Location of main panel	N.A.	N.A.	N.A.
	Location of repeater panel	N.A.	N.A.	N.A.
	Alternate source of power	N.A.	N.A.	N.A.
	Hooters	N.A.	N.A.	N.A.
8	MOEFA	Required	Provided	MR
9	Public address System.	N.A.	N.A.	N.A.
10	Automatic Sprinkler System.			
	Basement	N.A.	N.A.	N.A.
	upper floor	N.A.	N.A.	N.A.
	sprinkler above false ceiling	N.A.	N.A.	N.A.
11	Internal Hydrants			
	size of riser/down-comer	N.A.	N.A.	N.A.
	Number of hydrants per floor	N.A.	N.A.	N.A.
	Hose Box	N.A.	N.A.	N.A.
12	Yard Hydrants.			
	Total number of hydrants	N.A.	N.A.	N.A.
	Hose Box	N.A.	N.A.	N.A.
13	Pumping Arrangements.			
	• Ground Level	N.A.	N.A.	N.A.
	➤ Discharge of main Pump	N.A.	N.A.	N.A.
	➤ Head of Main Pump	N.A.	N.A.	N.A.
	➤ Number of main pumps	N.A.	N.A.	N.A.
	➤ Jockey pump out put	N.A.	N.A.	N.A.
	➤ Jockey pump head	N.A.	N.A.	N.A.
	➤ Standby pump out put	N.A.	N.A.	N.A.
	➤ Standby pump Head	N.A.	N.A.	N.A.
	➤ Auto Starting /Manual stopping	N.A.	N.A.	N.A.
	➤ Pump House Access	N.A.	N.A.	N.A.
	• Terrace Level	N.A.	N.A.	N.A.
	➤ Discharge of pump			
	➤ Head of the Pump	450 LPM	Provided	MR
	➤ Power supply	30 m	Provided	MR
	➤ Auto Starting of pump	Required	Provided	MR
		Required	Provided	MR
14	Captive Water Storage for Fire Fighting.			
	Underground tank capacity	N.A.	N.A.	N.A.
	Draw-off connection	N.A.	N.A.	N.A.
	Fire service inlet	N.A.	N.A.	N.A.
	Access to tank	N.A.	N.A.	N.A.
	Overhead Tank capacity	10,000 ltrs	10,000 ltrs	MR
15	Exit Signage.	Required	Provided	MR

17/18



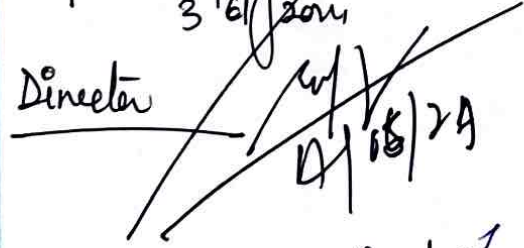
16	Provision of Lifts.			
	Pressurization of Lift Shaft	N.A.	N.A.	N.A.
	Pressurization of Lift lobby	N.A.	N.A.	N.A.
	Communication in lift car	N.A.	N.A.	N.A.
	Firemen's grounding switch	N.A.	N.A.	N.A.
	Lift Signage	N.A.	N.A.	N.A.
17	Standby power supply	N.A.	N.A.	N.A.
18	Refuge Area.	N.A.	N.A.	N.A.
	Total area			
	Location	N.A.	N.A.	N.A.
		N.A.	N.A.	N.A.
19	Fire Control Room			
	Detector system panel	N.A.	N.A.	N.A.
	Flow switch panel	N.A.	N.A.	N.A.
	PA system panel	N.A.	N.A.	N.A.
	Batter backup	N.A.	N.A.	N.A.
	Building Floor Plans	N.A.	N.A.	N.A.
20	Special Fire Protection systems for protection of special Risks, if any:	N.A.	N.A.	N.A.

The fire protection systems provided in the building were test checked and found functional at the time of inspection.

Keeping in view the substantial compliance of the minimum standards on fire prevention and fire safety required under the rules the FSC was issued vide letter no. F.6/DFS/MS/school/SZ/2021/71 dated 01.02.2021, renewal under the Rule 37 of the Delhi Fire Service Rules 2010 is recommended.


 Signature of the Inspecting Officer
 Name: - R.K. YADAV
 Designation: - ADO (JKP)

DO (South West)


 3/6/24
 CFO (SZ) 
 3/6/2024
 Director 
 4/18/24
 Anuj K R