

d61 DPA

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI**  
**HEAD QUARTERS, DELHI FIRE SERVICE, NEW DELHI - 110001**


No.F6/DFS/MS/GH/NDZ/2024/ 218

Dated:-07/06.../2024

**FIRE SAFETY CERTIFICATE**

Certified that the YWCA of Delhi (YWCA of Delhi Blue Triangle Family Hostel) located at Ashoka Road, New Delhi is comprised of Ground + 02 Upper floors, Ground floor (Reception + 01 hall + 01 staff room + 09 guest rooms), 1<sup>st</sup> floor (15 guest rooms + 03 stores + 01 office) and 2<sup>nd</sup> floor 15 guest rooms + 03 stores + 02 offices + 01 staff room), total 39 guest rooms up to second floor only, was earlier granted FSC by this department vide letter No.F6/DFS/MS/GH/NDZ/2021/205 dated 07/07/2021 for 39 guest rooms up to third floor. Now, the premises was re-inspected by the officers concerned of this department on 29/05/24 in the presence of Sh. Charanjit Singh and found that the said building has deemed complied with the fire prevention and fire safety requirements in accordance with rule 33 of the Delhi Fire Service Rules, 2010 and that the premises is fit for occupancy class Residential Group A-1 Ground floor (09 guest rooms) 1st floor to 2<sup>nd</sup> floor (15 guest rooms at each floor), total 39 guest rooms up to third floor only, and valid up to 31.03.2027 from the date of issue in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules 2010, printed below.

Issued ...07/06/2024.....New Delhi by.

  
(Atul Garg)  
DIRECTOR  
Delhi Fire Service

Copy to:-

1. The Chief Architect, NDMC, Palika Kendra, New Delhi: to ensure the occupancy as detailed above.
2. The Addl. Commissioner of Police (Lic), First Floor, P.S. Defence Colony New Delhi.  
Online id no. 2024051007279 dated 10/05/2024.
3. The Manager, YWCA of Delhi (YWCA of Delhi Blue Triangle Family Hostel). at Ashok Road, New Delhi.

**Conditions for the validity of Fire Safety Certificate**

1. This FSC is only for Guest house excluding Auditorium.
2. All the fire safety arrangements provided therein shall be maintained in good working conditions at all times.
3. Any loss of life or property due to non functional fire safety measures shall be at the responsibility of the management.
4. The trained fire fighting staff should be available round the clock.
5. The compliance with regards to electrical installation, structural stability, set back area, occupancy and any deviation in construction etc. shall be verified from authority concerned.
6. This fire safety certificate may not be treated in any case for regularization of unauthorized construction, if any.
7. The owner / occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on [www.dfs.delhigovt.nic.in](http://www.dfs.delhigovt.nic.in)
8. The means of escape shall be kept unobstructed / unlocked for unhindered evacuation in case of an emergency.
9. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in form 'J' [sub rule (I) of rule 37] along with a copy of this Certificate, six month prior to its expiry".
10. Any flammable material for interior decoration is prohibited.

## INSPECTION REPORT 11/23

1. Name & address of the building : YWCA of Delhi (YWCA of Delhi Blue Triangle Family Hostel) at Ashok Road, New Delhi.
2. Type of occupancy : Residential Building- lower ground ( auditorium )  
Ground floor (Reception + 01 hall + 01 staff room + 09 guest rooms), 1<sup>st</sup> floor to 2<sup>nd</sup> floor ( 15 guest rooms at each floor) total 39 guest rooms up to second floor.
3. Type of case:- : Renewal
4. Details of previous FSC : F6/DFS/MS/GH/NDZ/2021/205 dated 07/07/2021
5. Fire safety directives No. : N/A
6. Date of inspection:- 29/05/24
7. Name of the inspecting officer Sh. Ravinder Singh (ADO/CC)  
Sh. Rajinder Atwal ( DO/CD )
8. Name & designation of officer
9. From the building side : Sh. Charanjeet Singh
10. Year of construction :- 2007
11. Applicant's letter No. id no. 2024051007279 dated 10/05/2024.

Old Case

S.No.	Minimum Standards on fire Prevention and fire safety U/R 33	Requirement existing fire safety arrangements	Provided at site	Remarks MR/NMR
1.	Access to Building			
	1) Road width	06 mtr.	18.5 mtr. ✓	MR
	2) Gate width	N/A	N/A	N/A
	3) Width of internal road	N/A	N/A	N/A
2.	Number, Width Type & Arrangement of Exits			
	A. Number of staircases			
	1. Upper floors	02 No.	02 No. ✓	MR
	2. Basements	N/A	N/A	N/A
	B. Width of staircase			
	1. Upper floors	1.20 mtr. Existing	1.20 mtr. each ✓	MR
	2. Basements	N/A	N/A	N/A
	C. Protection of exits			
	1. Fire check door	N/A	N/A	N/A
	2. Pressurization	NA	NA	NA
	D. No. of continuous staircase to terrace			
		01	01	MR
	E. Width of corridor			
		1.5 mtr.	1.70 mtr. ✓	MR
	F. Door size			
		1 Mtr.	1 Mtr. ✓	MR
3.	Compartmentation			
	1) Fire check door	N/A	N/A	N/A
	2) Sealing of electrical shafts	N/A	N/A	N/A
	3) Fire rating of shaft door	N/A	N/A	N/A
	4) Water curtain	N/A	N/A	N/A
	5) Fire Dampers	N/A	N/A	N/A
4.	Smoke Management System			
	1) Basements	30 ACPH	N/A	N/A
	2) Upper floors	12 ACPH	Natural	MR
5.	Fire Extinguishers			
	1) Total numbers	16 Nos.	16 Nos. ✓	MR
	2) Types	ABC & CO2	ABC, CO2 & W.CO2	MR

A 6

M/24


	3) ISI marking	Required	Provided	MR
6.	First-Aid Hose Reel			
	1) Total number of each floor	02 No.	02 No. ✓	MR
	2) Length of hose reel hose	30 m	30 m ✓	MR
	3) Nozzle diameter	5 mm	5 mm	MR
7.	Automatic Fire Detection & Alarming System ✓			
	1) Type of detectors	N/A	N/A	N/A
	2) Location of main panel	N/A	N/A	N/A
	3) Location of repeater panel	N/A	N/A	N/A
	4) Alternate source of power	N/A	N/A	N/A
	5) Hooter's Location	N/A	N/A	N/A
8.	MOEFA	Required	Provided	MR
9.	Public Address System	Required	Provided	MR
10.	Automatic Sprinkler System			
	1) Basement	NA	NA	NA
	2) Upper floors	NA	NA	NA
	3) Sprinkler above false ceiling	NA	NA	NA
11.	Internal Hydrants			
	1) Size of riser/down-comer	NA	NA	NA
	2) Number of hydrants per floor	NA	NA	NA
	3) Hose box each floor	NA	NA	NA
12.	Yard Hydrants			
	1) Total number of hydrants	N/A	N/A	N/A
	2) Hose box	N/A	N/A	N/A
13.	Pumping Arrangement			
	1) Ground level			
	a) Discharge of main pump	N/A	N/A	N/A
	b) Head of main pump	N/A	N/A	N/A
	c) Number of main pump	N/A	N/A	N/A
	d) Jockey pump out put	N/A	N/A	N/A
	e) Jockey pump head	N/A	N/A	N/A
	f) Stand by pump output	N/A	N/A	N/A
	g) Stand by pump head	N/A	N/A	N/A
	h) Auto starting/Manual stopping	N/A	N/A	N/A
	2) Terrace level			
	a) Discharge of pump	450 LPM	450 LPM ✓	MR
	b) Head of pump	40 mtr.	40 mtr. ✓	MR
	c) Power supply	Required	Provided	MR
	d) Auto starting of pump	Required	Provided	MR
14.	Captive Water Storage for Fire Fighting			
	1) Under ground tank capacity	NA	NA	NA
	a) Draw-off connection	NA	NA	NA
	b) Fire service inlet	NA	NA	NA
	c) Access to tank	NA	NA	NA
	d) Over head tank capacity	3000 Ltrs.	3000 Ltrs. ✓	MR

15.	Exit Signage.	Required	Provided	MR
16.	Provision of Lifts.			
	a) Pressurization of lift shaft	N/A	N/A	N/A
	b) Pressurization of lift lobby	N/A	N/A	N/A
	c) Communication in lift car	NA	NA	NA
	d) Fireman's switch	NA	NA	NA
	e) Lift signage	NA	NA	NA
17.	Stand by Power Supply	Required	Provided	MR
18.	Refuge Area	NA	NA	NA
	Total area location	N/A	N/A	N/A
19.	Fire Control Room			
	a) Detector system panel	N/A	N/A	N/A
	b) Flow switch panel	N/A	N/A	N/A
	c) PA system panel	NA	NA	NA
	d) Battery backup	NA	NA	NA
	e) Building floor plan	NA	NA	NA
20.	Special Fire Protection System for Protection of special Risk, if any:			N/A


The fire protection systems provided in the building were randomly tested, checked and found functional at the time of inspection.


In view of the deemed compliance of the minimum standards of fire prevention and fire safety measures as required under the rules, if agreed, we may renew the FSC issued vide letter no. F6/DFS/MS/GH/NDZ/2021/205 dated 07/07/2021, renewal under rule 35 of the Delhi Fire Service rules 2010, is recommended for approval.

Signature of the Inspecting Officer

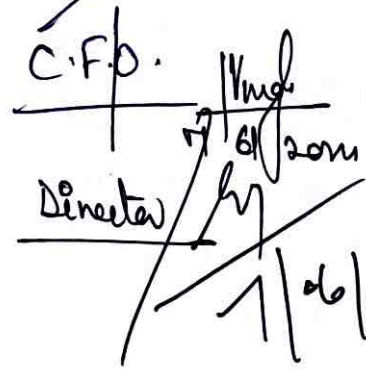
  
 3/6/24  
 Name: - Sh. Rajinder Atwal  
 Designation: - DO (CD)

Signature of the Inspecting Officer

  
 3/6/24  
 Name :- Sh. Ravinder Singh  
 Designation : ADO (CC)

  
 Dy. Ch. Insp.

  
 06/06/24

C.F.O.  
  
 Director  
 1/06/24



All enclosed this copy as last sheet.

