

C 23

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE: NEW DELHI- 110 001

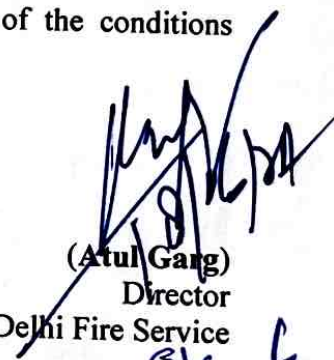
No. F6/DFS/MS/SZ/2024/cc/28

Dated: 20.06.2024

FIRE SAFETY CERTIFICATE

Certified that the Made Easy Learning Private Limited (Coaching Centre) located at Plot No. 27B, Pusa Road, Near Metro Pillar No. 118, Karol Bagh, New Delhi-110060, comprises of basement, Stilt, ground plus two upper floors, owned/occupied by Made Easy Learning Private Limited have complied with the fire prevention and fire safety requirements in accordance with Rule 33 of Delhi Fire Service Rules 2010 and verified by the officer concerned of this department on 07-06-2024 in the presence of Sh. B. Singh, Chairman & Managing Director and found that the building have complied with the fire prevention and fire safety requirements in accordance with Rule 33 of the Delhi Fire Service Rules, 2010 and that the premises is fit for occupancy class B 'Educational Building' with effect from .20.06.2024 for a period of three years in accordance with Rule 36 unless renewed under Rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions mentioned below.

Issued on 20.06.2024 at New Delhi by


(Atul Gang)
Director
Delhi Fire Service
B/C

Copy to:-

1. The Chairman & Managing Director of M/s Made Easy Learning Private Limited (Coaching Centre) located at Plot No. 27B, Pusa Road, Near Metro Pillar No. 118, Karol Bagh, New Delhi-110060.
2. The Executive Engineer, Bldg, Civic Centre, Mintto Road, New Delhi-110002.

Conditions for the validity of fire safety certificate

1. All the means of escape shall be kept free of all type of obstruction all the time.
2. All the employees shall be acquainted with the use and maintenance of all fire equipments and method of smooth and speedy safe evacuation of occupants in case of emergency.
3. All the fire fighting equipments shall be maintained in perfect working condition all the time and any lapse rendering non-functional of fire safety measures, management shall be responsible.
4. Any deviation, with regards to construction, ventilation, occupancy, electric installation etc. may be got verified from the concerned authorities.
5. This Fire Safety Certificate may not be treated in any case for regularizations of unauthorized construction unauthorized use of land if any.
6. The owner / occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rule 2010. The form is available on www.dfs.delhigovt.nic.in
7. The owner/occupier shall apply for renewal of this FSC to Director in Form 'J' [Sub Rule (1) of Rule 37] alongwith a copy of this certificate, six month prior to its expiry.

N/7

INSPECTION REPORT

1. Name & address of the building : Made Easy Learning Private Limited located at Plot No. 27B, Pusa Road, Near Metro Pillar No. 118, Karol Bagh, New Delhi-110060.
2. Building is comprised of : Basement, Stilt, Ground plus two upper floors.
3. Type of Occupancy : Education/ Coaching Centre
4. Type of Case : New
5. Details of Previous NOC : Nil.
6. Fire Safety direction letter No : N/A
7. Date of Inspection : 07.06.2024.
8. Name of the Inspecting Officers: : Vedpal Chhikara(DO-SW)
9. Name and designation of Officer from the building side : Sh. B Singh, Chairman & Managing Director.
10. Year of Construction : 2018
11. Applicant's letter No : No. Nil, dated 2.05.2024

S.No	Minimum Standards on fire prevention and fire safety U/R 33	Requirement as per UBBL 2016/NBC 2016	Provided at Site	Remarks MR/NMR
1	Access to building			
	Road width	6 m	Provided	MR
	Gate width	6m	On Road	MR
	Width of internal road	N.A.	N.A.	N.A.
2	Number, Width, Type and Arrangement of Exits.			
	a. Number of Staircases			
	Upper Floor	2nos.	2nos.	MR
	Basement	2nos.	2nos.	MR
	B. Width of Staircases			
	Upper Floor	1.50m each	1.6m & 1.5m	MR
	Basement	1.50m each	1.6m & 1.5m	MR
	c. Protection of exits	Required	Provided	MR
	Fire check door	Required in Basement	Provided	MR
	Pressurization	N.A.	N.A.	N.A.
	e. No. of continuous staircases to terrace	2nos.	2nos.	MR
g. Width of Corridor	1.5m	1.5m	MR	
h. Door Size	1 m	1m	MR	
3	Compartmentation			
	Fire check door	Required in Basement	Provided	MR
	Sealing of electrical shafts	Required	Provided	MR
	Fire rating of shaft door	N.A.	N.A.	N.A.
	Water curtain	N.A.	N.A.	N.A.
	Fire Dampers	N.A.	N.A.	N.A.
4	Smoke Management System.			
	Basement	Required	Exhaust Fans Provided	MR
	Upper floor	Required	Natural Vent.	MR
5.	Fire Extinguisher			
	Total numbers	12nos.	10 nos.	MR
	types	CO ₂ & ABC	ABC Type	MR
	ISI marking	ISI marked	ISI marked	MR

6	First-aid-Hose Reels.			
	Total numbers of each floor	01no.	01no.	MR.
	Length of hose reel hose	30m	30m	MR.
	Nozzle diameter	5mm	5mm	MR.
7	Automatic fire detection and alarming system.			
	Type of detectors	N.A.	N.A.	N.A.
	Location of main panel	N.A.	N.A.	N.A.
	Location of repeater panel	N.A.	N.A.	N.A.
	Alternate source of power	N.A.	N.A.	N.A.
	Hooters	N.A.	N.A.	N.A.
8	MOEFA	N.A.	N.A.	N.A.
9	Public address System.	N.A.	N.A.	N.A.
10	Automatic Sprinkler System.			
	Basement	Required	Provided	MR
	upper floor	N.A.	N.A.	N.A.
	sprinkler above false ceiling.	N.A.	N.A.	N.A.
11	Internal Hydrants			
	size of riser/down-comer	N.A.	100mm	N.A.
	Number of hydrants per floor	N.A.	01No.	N.A.
	Hose Box	N.A.	01No.	N.A.
12	Yard Hydrants.			
	Total number of hydrants	N.A.	N.A.	N.A.
	Hose Box	N.A.	N.A.	N.A.
13	Pumping Arrangements.			
	➤ Ground Level	N.A.	N.A.	N.A.
	➤ Discharge of main Pump	N.A.	N.A.	N.A.
	➤ Head of Main Pump	N.A.	N.A.	N.A.
	➤ Number of main pumps	N.A.	N.A.	N.A.
	➤ Jockey pump out put	N.A.	N.A.	N.A.
	➤ Jockey pump head	N.A.	N.A.	N.A.
	➤ Standby pump out put	N.A.	N.A.	N.A.
	➤ Standby pump Head	N.A.	N.A.	N.A.
	➤ Auto Starting /Manual stopping	N.A.	N.A.	N.A.
	➤ Pump House Access	N.A.	N.A.	N.A.
	➤ Terrace Level	Required	Provided	MR
	➤ Discharge of pump	2X450LPM	Provided	MR
	➤ Head of the Pump	40m each	40m each	MR
	➤ Power supply	Required	Provided	MR
	➤ Auto Starting of pump	Required	Provided	MR
14	Captive Water Storage for Fire Fighting.			
	Underground tank capacity	N.A.	N.A.	N.A.
	Draw-off connection	N.A.	N.A.	N.A.
	Fire service inlet	N.A.	N.A.	N.A.
	Access to tank	N.A.	N.A.	N.A.
	Overhead Tank capacity	10000 liters	10000 liters	MR
15	Exit Signage.	Required	Provided	MR

W

16	Provision of Lifts.			
	Pressurization of Lift Shaft	N.A.	N.A.	N.A.
	Pressurization of Lift lobby	N.A.	N.A.	N.A.
	Communication in lift car	Required	Provided	MR
	Firemen's grounding switch	Required	Provided	MR
	Lift Signage	Required	Provided	MR
17	Standby power supply	Required	Provided	MR
18	Refuge Area.			
	Total area	N.A.	N.A.	N.A.
	Location	N.A.	N.A.	N.A.
19	Fire Control Room			
	Detector system panel	N.A.	N.A.	N.A.
	Flow switch panel	N.A.	N.A.	N.A.
	PA system panel	N.A.	N.A.	N.A.
	Batter backup	N.A.	N.A.	N.A.
	Building Floor Plans	N.A.	N.A.	N.A.
20	Special Fire Protection systems for protection of special Risks, if any:	Required	02 ABC type fire extinguishers provided near elect. panel	MR

Note: The owner/occupier has completely closed one portion of the basement with brick wall and now the area of the basement is 299.053m².

The fire protection systems provided in the building were tested/ checked randomly and found functional at the time of inspection. Keeping in view the substantial compliance of the minimum standards on fire prevention and fire safety systems required under the rule, it is recommended to grant Fire Safety Certificate under Rule 35 of the Delhi Fire Service Rule 2010 if approved.

Accordingly, DFA is put up for kind approval please.


12/6/24


Signature of the Inspecting Officer

Name Vedpal Chhikara

Designation DO(SW)

CFO(SZ)


14/6/2024


Director

12/6/24

DFA

FT letter is added for sign


DIRECTOR/DPS

12/6/24

18/8/24

D.O(SW)

mm