

C-32

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE, NEW DELHI-110001**

No. F6/DFS/MS/2024/WZ/School/589

Dated: 27/06/2024

FIRE SAFETY CERTIFICATE

Certified that the Sarvodaya Kanya Vidhyalaya, Karala, Delhi- 81. (School Id-1413078), comprised of 04 blocks, new block, Ground + Three upper floors & Old 02 Blocks Ground + 01 upper floors & 01 block ground floor only has already been issued FSC by this department vide letter No. F.6/DFS/MS/2021/WZ/School/856 dated 13.10.2021 & F.6/DFS/MS/School/2018/1323 dated 05.06.2018. The premises was re-inspected by the officer concerned of this department on 11.06.2024 in the presence of Mr. Naveen Dabas (TGT Teacher) and found that the said building have deemed complied with the fire prevention and fire safety requirements in accordance with Rule 33 of the Delhi Fire Service Rules, 2010 and that the premises fit for occupancy "Group B Educational" with effect from 27/06/2024 for a period of three years in accordance with Rule 36 unless renewed under Rule 37 or sooner cancelled under Rule 40 and subjected to compliance of the conditions under Rule 38 of the Delhi Fire Service Rules, 2010.

Issued on 27/06/2024 at New Delhi by


(Atul Garg)
DIRECTOR
Ph; 011-23414000

Copy to:

1. The Principal, Sarvodaya Kanya Vidhyalaya, Karala, Delhi- 81. (School Id-1413078)
2. The Director of Education, GNCT of Delhi Old Secretariat, Delhi-110054

Conditions for validity of Fire Safety Certificate;

1. All the fire safety arrangement provided there-in shall be maintained in good working conditions at all times.
2. Loss of life or property due to non functional fire safety measure shall be at the responsibility of the management.
3. The trained fire fighting staff should be available round the clock.
4. Any deviation with regard to the construction etc shall be verified by the concerned building sanctioning agency.
5. This certificate cannot be treated in any case for regularizations of unauthorized construction.
6. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director along with a copy of this Certificate, six months prior to its expiry".
7. The owner / occupier shall submit a declaration every year in form "K" provided in the first schedule of Delhi Fire Service Rules 2010. The form "K" is available on http://www.delhi.gov.in/wps/wcm/connect/doit_fire/FIRE/Home/Fire+Safety+Acts+and+Rules/
http://www.delhi.gov.in/wps/wcm/connect/doit_fire/FIRE/Home/Forms/

INSPECTION REPORT

1. Name & address of the building	Sarvodaya Kanya Vidhyalaya, Karala, Delhi- 81. (School Id- 1413078).			
2. Type of Occupancy	Educational			
3. Type of Case	Renewal (New Blk-Ground + 03 upper floors & Old total 03 blocks, 02 blocks- Ground + 01 upper floor & 01 Blk-Ground floor only)			
4. Details of Previous NOC	F.6/DFS/MS/2021/WZ/School/856 dated 13.10.2021 (Gr. + 03) F.6/DFS/MS/School/2018/1323 dated 05.06.2018. (Old Total 04 blocks, 03 Blk-Gr. + 01 upper floor & 01 blocks, Ground floor only)			
5. Fire Safety directives letter No	NBC Part-IV / Director of Educational			
6. Date of inspection	11.06.2024			
7. Name of Inspecting Officer	Sh. Ajay Kumar Sharma (ADO Rohini)			
8. Name and designation of officers From the building side	Mr. Naveen Dabas (TGT Teacher)			
9. Year of Construction	2017 ,2002-03 & 2018			
10. Applicant's letter No.	Online mail dated 04.06.2024			
S. No	Minimum Standards on fire prevention and fire safety U/R 33	Dir. of Education /NBC requirement	Provided at site	Remarks MR/NMR
1.	Access to building			
	• Road width	Accessible	Accessible	MR
	• Gate width	Accessible	4.5m	MR
	• Width of internal road	-NA-	-NA-	-NA-
2.	Number, Width, Type & Arrangement of Exits			
	a. Number of staircases			
	• Upper Floors	05nos. New Blk-02nos A Blk-02 B-blk-01	06nos. 03nos. 02nos. 01nos.	MR
	• Basements	-NA-	-NA-	-NA-
	b. Width of staircases			
	• Upper Floor	1.50m	3 X 1.80m A Blk-2 x 1.5m B-blk-1.9m	MR
	• Basements	-NA-	-NA-	-NA-
	c. Protection of exits			
	• Fire check door	-NA-	-NA-	-NA-
	• Pressurization	-NA-	-NA-	-NA-
	d. No. of continuous staircases to terrace	01nos.	03nos.	MR
	e. Width of Corridor	Required	Provided	MR
	f. Door Size	New blk-1m Old blk-1.0	1.10m & 1m double door	MR
3.	Compartmentation			
	• Fire check door	-NA-	-NA-	-NA-
	• Sealing of electrical shafts	-NA-	-NA-	-NA-
	• Fire Rating of shaft door	-NA-	-NA-	-NA-
	• Water Curtain	-NA-	-NA-	-NA-
	• Fire Dampers	-NA-	-NA-	-NA-
4.	Smoke Management System			
	a) Basements	-NA-	-NA-	-NA-
	b) Upper floors	12 a/c per hour	Natural ventilated	MR


5.	Fire Extinguishers			MR
	• Total numbers	New Blk-50nos Old Blk-17nos.	New Blk-70nos Old Blk-24nos.	MR
	• Types	ABC/CO2	ABC-52nos.Co2-42	MR
	• IS marking	ISI Marked	Provided	
6.	First-Aid Hose Reels			MR
	• Total numbers on each floor	New blk-02nos.	03nos.	MR
	• Length of hose reel hose	30mm	Provided	MR
	• Nozzle diameter	5m	Provided	
7.	Automatic fire detection and alarming system			-NA-
	a) Type of detectors	-NA-	-NA-	-NA-
	b) Location of Main Panel	-NA-	-NA-	-NA-
	c) Location of Repeater Panel	-NA-	-NA-	-NA-
	d) Alternate source of power	-NA-	-NA-	-NA-
	e) Hooters' Location	-NA-	-NA-	-NA-
8.	MOEFA	-NA-	-NA-	-NA-
9.	Public Address System	-NA-	-NA-	
10.	Automatic Sprinkler System			-NA-
	• Basement	-NA-	-NA-	-NA-
	• Ground & Upper Floors	-NA-	-NA-	-NA-
	• Sprinkler above false ceiling	-NA-	-NA-	-NA-
11.	Internal Hydrants			-NA-
	• Size of riser/down-comer	-NA-	Provided	-NA-
	• Number of hydrants per floor	-NA-	Provided	-NA-
	• Hose Box	-NA-	01nos.	-NA-
12.	Yard Hydrants			-NA-
	• Total number of hydrants	-NA-	-NA-	-NA-
	• Hose Box	-NA-	-NA-	-NA-
13.	Pumping Arrangements			-NA-
	• Ground Level	-NA-	-NA-	-NA-
	➤ Discharge of main Pump	-NA-	-NA-	-NA-
	➤ Head of Main pump	-NA-	-NA-	-NA-
	➤ Number of main pumps	-NA-	-NA-	-NA-
	➤ Jockey Pump out put	-NA-	-NA-	-NA-
	➤ Jockey pump head	-NA-	-NA-	-NA-
	➤ Standby Pump out put	-NA-	-NA-	-NA-
	➤ Standby Pump Head	-NA-	-NA-	-NA-
	➤ Auto Starting/Manual Stopping	-NA-	-NA-	-NA-
	➤ Pump House Access	-NA-	-NA-	-NA-
	Terrace level			
	➤ Discharge of pump	New blk-450lpm	450lpm	MR
	➤ Head of the pump	40m	40m	MR
	➤ Power Supply	Required	Provided	MR
	➤ Auto Starting of pump	Required	Provided	MR
14.	Captive Water Storage for fire fighting			-NA-
	• Underground tank capacity	-NA-	-NA-	-NA-
	➤ Draw-off connection	-NA-	-NA-	-NA-
	➤ Fire service inlet	-NA-	-NA-	-NA-
	➤ Access to tank	-NA-	-NA-	-NA-

MR

	• Overhead Tank capacity	New blk-10,000ltr	10,000ltr	MR
15.	Exit Signage.	Required	Provided	MR
16.	Provision of Lifts.			
	• Pressurization of Lift Shaft	-NA-	-NA-	-NA-
	• Pressurization of Lift lobby	-NA-	-NA-	-NA-
	• Communication In lift Car	-NA-	-NA-	-NA-
	• Fireman's Grounding Switch	-NA-	-NA-	-NA-
	• Lift Signage	-NA-	-NA-	-NA-
17.	Standby power supply	-NA-	-NA-	-NA-
18.	Refuge Area.			
	➤ Total Area	-NA-	-NA-	-NA-
	➤ Location	-NA-	-NA-	-NA-
19.	Fire Control Room			
	• Detector System Panel	-NA-	-NA-	-NA-
	• Flow Switch Panel	-NA-	-NA-	-NA-
	• PA System Panel	-NA-	-NA-	-NA-
	• Battery backup	-NA-	-NA-	-NA-
	• Building Floor Plans	-NA-	-NA-	-NA-
20.	Special Fire Protection System for Protection of special Risks, if any:	-NA-	-NA-	-NA-

The fire protection systems provided in the building were test checked and found functional at the time of inspection.

In view of the deemed compliance of the minimum standards of the fire prevention and fire safety measures as required under the rules the NOC issued vide letter no. F.6/DFS/MS/2021/WZ/School/856 dated 13.10.2021 & F.6/DFS/MS/School/2018/1323 dated 05.06.2018 is recommended for renewal under rule 37 of the Delhi Fire Service rules 2010.

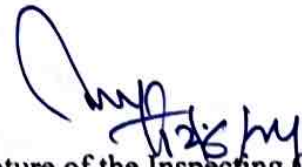


Signature of the Inspecting Officer
 Name Ajay Kumar Sharma
 Designation ADO (Rohini)

Dy. CFO (WZ) on m/Rest

DcFo/FPW


14/01/24

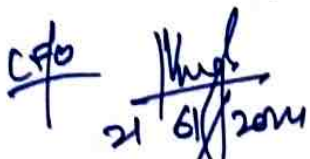CFO 
21/01/2024

Director 
21/01/24

