

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE: CANNAUGHT PLACE
NEW DELHI- 110001

No. F.6/DFS/MS/School/SZ/2024/ 640

Dated: 08/07/2024

FIRE SAFETY CERTIFICATE

Certified that the M.C.D. Pry. Co-ed School at Dariya Pur Khurd, New Delhi- 110073 Comprised of ground plus one upper floor owned/occupied by M.C.D. Pry. Co-ed School was issued FSC vide letter no. F.6/DFS/MS/school/SZ/2021/186 dated 05.03.2021. The school building was re- inspected by the officer concerned of this department on dated 28.06.2024 in the presence of Smt. Sushma (Principal) and found that the school building have deemed complied with the fire prevention and fire safety requirements in accordance with the Circular No. F.16/Estate/CC/Fire Safety/2011/3298 dated 01.03.2011 issued by Directorate of Education, Govt. of NCT of Delhi, and found that the building is fit for occupancy class B 'Educational Building' with effect from 08/07/2024 for a period of three years, subject to conditions printed below.

Issued on 08/07/2024 at New Delhi by.


 (Atul Garg)
 Director
 Delhi Fire Service

Copy to:-

1. The Principal, M.C.D. Pry. Co-ed School at Dariya Pur Khurd, New Delhi- 110073
2. Director of Education, Govt. of NCT of Delhi, Old Secretariat, New Delhi - 110054.

Following fire safety directives must be adhered to: -

1. All the fire safety arrangements provided therein shall be maintained in good working condition at all times.
2. The means of escape shall be kept unlocked and unobstructed for unhindered evacuation of occupants in case of emergency.
3. Any loss of life or property due to non-functional fire safety measures shall be at the risk and responsibility of the management.
4. The trained staff should be available round the clock.
5. Any deviations w.r.t. construction shall be verified by the concerned building sanctioning agency.
6. The certificate may not be treated in any case for the regularization of the unauthorized construction, if any.
7. The owner/occupier shall submit a declaration every year in the form 'K' provided in the first schedule of Delhi Fire Service Rules 2010, form is available on www.dfs.delhigovt.nic.in.
8. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in the Form 'J' [sub rule (1) of rule 37] along with a copy of this Certificate, six months prior to its expiry.

INSPECTION REPORT

- 1 Name & address of the building : M.C.D. Pry. Co-ed School at Dariya Pur Khurd, New Delhi- 110073.
- 2. Building is comprised of : Ground plus one upper floor
- 3. Type of Occupancy : Educational
- 4. Type of Case : Renewal
- 5. Details of Previous NOC : F.6/DFS/MS/school/SZ/2021/186 dated 05.03.2021
- 6. Fire Safety direction letter No : F.16/Estate/CC/Fire Safety/2011/3298 dated 01.03.2011
- 7. Date of Inspection : 28.06.2024
- 8. Name of the Inspecting Officers: : ADO R.K. YADAV
- 9. Name of the designation of Officer from the building side : Smt. Sushma (Principal)
- 10. Year of Construction : 2007
- 11. Applicant's letter No : Online email Id sdmcpsdariyaprudkhurd@gmail.com dt. 04.06.2024

| S. No. | Minimum Standards on fire prevention and fire safety requirements U/R 33 | DOE. Dated 1.3.2011 | CIR. | Provided at Site | Remarks MR/NMR |
|--------------|--|---------------------|-------------------|-----------------------------|----------------|
| 1 | Access to building | | | | |
| | Road width | 6 m | | 09 m | MR |
| | Gate width | 4.5 | | Direct accessible from road | MR |
| | Width of internal road | N.A. | | N.A. | N.A. |
| 2 | Number, Width, Type and Arrangement of Exits | | | | |
| | a. Number of Staircases | | | | |
| | Upper Floor | 01 nos. | | 01 nos. | MR |
| | Basement | N.A. | | N.A. | N.A. |
| | B. Width of Staircases | | | | |
| | Upper Floor | 1.5 m | | 1.5 m each | MR |
| | Basement | N.A. | | N.A. | N.A. |
| | c. Protection of exits | | | | |
| | Fire check door | N.A. | | N.A. | N.A. |
| | Pressurization | N.A. | | N.A. | N.A. |
| | e. No. of continuous staircases to terrace | N.A. | | N.A. | N.A. |
| | g. Width of Corridor | 1.5 m | | 2.10 m | MR |
| h. Door Size | 1 m | | 1 m (double door) | MR | |
| 3 | Compartmentation. | | | | |
| | Fire check door | N.A. | | N.A. | N.A. |
| | Sealing of electrical shafts | N.A. | | N.A. | N.A. |
| | Fire rating of shaft door | N.A. | | N.A. | N.A. |
| | Water curtain | N.A. | | N.A. | N.A. |
| | Fire Dampers | N.A. | | N.A. | N.A. |
| 4 | Smoke Management System. | | | | |
| | Basement | N.A. | | N.A. | N.A. |
| | Upper floor | Required | | Natural ventilation | MR |

f

h

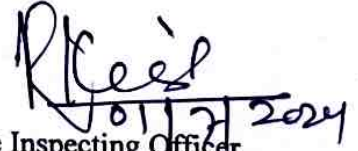
| | | | | |
|-----------|--|-----------------------|-----------------------|------|
| 5. | Fire Extinguisher | | | |
| | Total numbers | 05 Nos. | 05 Nos. | MR |
| | types | CO ₂ & ABC | CO ₂ & ABC | MR |
| | IS marking | ISI marked | ISI marked | MR |
| 6 | First-aid-Hose Reels. | | | |
| | Total numbers of each floor | N.A. | N.A. | N.A. |
| | Length of hose reel hose | N.A. | N.A. | N.A. |
| | Nozzle diameter | N.A. | N.A. | N.A. |
| 7 | Automatic fire detection and alarming system. | | | |
| | Type of detectors | N.A. | N.A. | N.A. |
| | Location of main panel | N.A. | N.A. | N.A. |
| | Location of repeater panel | N.A. | N.A. | N.A. |
| | Alternate source of power | N.A. | N.A. | N.A. |
| | Hooters | N.A. | N.A. | N.A. |
| 8 | MOEFA | N.A. | N.A. | N.A. |
| 9 | Public address System. | N.A. | Provided | MR |
| 10 | Automatic Sprinkler System. | | | |
| | basement | N.A. | N.A. | N.A. |
| | upper floor | N.A. | N.A. | N.A. |
| | sprinkler above false ceiling | N.A. | N.A. | N.A. |
| 11 | Internal Hydrants | | | |
| | size of riser/down-comer | N.A. | N.A. | N.A. |
| | Number of hydrants per floor | N.A. | N.A. | N.A. |
| | Hose Box | N.A. | N.A. | N.A. |
| 12 | Yard Hydrants. | | | |
| | Total number of hydrants | N.A. | N.A. | N.A. |
| | Hose Box | N.A. | N.A. | N.A. |
| 13 | Pumping Arrangements. | | | |
| | • Ground Level | N.A. | N.A. | N.A. |
| | ➤ Discharge of main Pump | N.A. | N.A. | N.A. |
| | ➤ Head of Main Pump | N.A. | N.A. | N.A. |
| | ➤ Number of main pumps | N.A. | N.A. | N.A. |
| | ➤ Jockey pump out put | N.A. | N.A. | N.A. |
| | ➤ Jockey pump head | N.A. | N.A. | N.A. |
| | ➤ Standby pump out put | N.A. | N.A. | N.A. |
| | ➤ Standby pump Head | N.A. | N.A. | N.A. |
| | ➤ Auto Starting /Manual stopping | N.A. | N.A. | N.A. |
| | ➤ Pump House Access | N.A. | N.A. | N.A. |
| | • Terrace Level | | | N.A. |
| | ➤ Discharge of pump | N.A. | N.A. | N.A. |
| | ➤ Head of the Pump | N.A. | N.A. | N.A. |
| | ➤ Power supply | N.A. | N.A. | N.A. |
| | ➤ Auto Starting of pump | N.A. | N.A. | N.A. |
| 14 | Captive Water Storage for Fire Fighting. | | | |
| | Underground tank capacity | N.A. | N.A. | N.A. |
| | Draw-off connection | N.A. | N.A. | N.A. |
| | Fire service inlet | N.A. | N.A. | N.A. |
| | Access to tank | N.A. | N.A. | N.A. |
| | Overhead Tank capacity | N.A. | N.A. | N.A. |
| 15 | Exit Signage. | N.A. | N.A. | N.A. |

N/18



| | | | | |
|-----------|---|------|------|------|
| 16 | Provision of Lifts. | | | |
| | Pressurization of Lift Shaft | N.A. | N.A. | N.A. |
| | Pressurization of Lift lobby | N.A. | N.A. | N.A. |
| | Communication in lift car | N.A. | N.A. | N.A. |
| | Firemen's grounding switch | N.A. | N.A. | N.A. |
| | Lift Signage | N.A. | N.A. | N.A. |
| 17 | Standby power supply | N.A. | N.A. | N.A. |
| 18 | Refuge Area. | | | |
| | Total area | N.A. | N.A. | N.A. |
| | Location | N.A. | N.A. | N.A. |
| 19 | Fire Control Room | | | |
| | Detector system panel | N.A. | N.A. | N.A. |
| | Flow switch panel | N.A. | N.A. | N.A. |
| | PA system panel | N.A. | N.A. | N.A. |
| | Batter backup | N.A. | N.A. | N.A. |
| | Building Floor Plans | N.A. | N.A. | N.A. |
| 20 | Special Fire Protection systems for protection of special Risks, if any: | N.A. | N.A. | N.A. |

The fire protection systems provided in the building were test checked and found functional at the time of inspection.

In view of the deemed compliance of the minimum standards of fire prevention and fire safety measures as required under the rules the Fire Safety Certificate issued vide letter no. F.6/DFS/MS/school/SZ/2021/186 dated 05.03.2021, renewal under the circular no. F.16/Estate/CC/Fire Safety/2011/3298 to 3398 dated 01.03.2011 is recommended.


 Signature of the Inspecting Officer
 Name- R.K. YADAV
 Designation- ADO (JKP)

DO (South West)


 C Fo/(SZ) 
 3/7/2021
 Director 