

C 8



No.F6/DFS/MS/School/SZ/2024/ 629

Dated: 08/07/2024

FIRE SAFETY CERTIFICATE

Certified that the **Dev Public School** located at **G -12/193A, Ratiya Marg, Sangam Vihar, New Delhi-62**, is running at **Ground + 1 upper floor** of the building which is comprised **Basement Ground + 02 upper floors**, owned & occupied by **Kishan Dev Education Society (Regd.)** have complied with the fire prevention and fire safety requirements in accordance with the circular no. F.16/Estate/CC/Fire Safety/2011/3298 to 3398 dated 01.03.2011 issued by the Directorate of Education and verified by officer concerned of Delhi Fire Service on 03.07.2024 in the presence of Mr. Dev Kishan (Manager) and found that the building/premises (**Ground + 01 upper floor**) is fit for occupancy of **Group B "Educational Building" (School)** with effect from **08/07/2024** for a period of three years in accordance with Rule 36 unless renewed under Rule 37 or sooner cancelled under Rule 40 and subject to conditions under Rule 38 of Delhi Fire Service Rules, 2010 printed below.

Issued on... **08/07/2024** ...at New Delhi by.

(Atul Garg)

Director

Delhi Fire Service

08/07/24

Copy to:-

1. The Directorate of Education, Center Zone: Lajpat Nagar, New Delhi-110024.
2. The Principal, Dev Public School located at G -12/193A, Ratiya Marg, Sangam Vihar, New Delhi-62.

Conditions for the validity of Fire Safety Certificate

1. **This Fire Safety Certificate is valid for Ground + 01 upper floor only.**
2. All the means of escape shall be kept free of all the type of obstruction all the time.
3. All the employees shall be acquainted with the use and maintenance of all fire equipments and method of smooth and speedy safe evacuation of occupants in case of emergency.
4. All the fire fighting equipments shall be maintained in perfect working condition all the time and any lapse rendering non-functional of fire safety measures, management shall be responsible.
5. The clarification with regards electrical installation, ventilation, structure stability set back areas, occupancy and constructional deviation in building etc .may be got verified from the authorities concerned.
6. This Fire Safety Certificate cannot be treated in any case for regularizations of unauthorized construction unauthorized use of land if any.
7. Basement shall be used as per UBBL/NBC.
8. The owner / occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rule 2010. The form is available on www.dfs.delhigovt.nic.in.
9. The owner /occupier shall apply for renewal of this fire safety certificate to the Director in form J' [sub Rule (1) of Rule 37] along with a copy of this certificate, six months prior to its expiry.

10/5

INSPECTION REPORT

1	Name & address of the building	Dev Public School located at G – 12/193 A, Ratiya Marg, Sangam Vihar, New Delhi.				
2	Building is comprised of	Basement + Ground + 02 upper floors (School running at Ground + 1 upper floor only) -Basement is being used as storage -2 nd floor is being used as residence				
3	Type of occupancy	Group B –Educational Building (School)				
4	Type of case	New case				
5	Details of previous FSC	Nil				
6	Fire safety direction letter no.	F.16/Estate/CC/Fire Safety/2011/3298 to 3398 dated 01.03.2011				
7	Date of inspection	03.07.2024				
8	Name of the inspecting officers	Rajesh Kumar Shukla, ADO (M. Road)				
9	Name of the designation of officer from the building side	Mr. Dev Kishan (Manager)				
10	Year of construction	2009				
11	Applicant's letter no.	Outdoor diary no. 13976 dated 07.03.2024				
S.No	Minimum standard of fire prevention and fire safety U/R 33	Requirement as per D.O.E Circular dated 01.03.2011	Provided at site	Remarks MR/NMR		
1	Access to Building:					
	A	Road width	Accessibility	Accessible	MR	
	B	Gate width	NA	NA	NA	
	C	Width of internal road	NA	NA	NA	
2	Number, Width, Type and Arrangement of Exits:					
	A	Number of staircases				
		a	Upper floor	02 nos.	2 nos.	MR
		b	Basement	02 nos.	2 nos.	MR
	B	Width of staircases				
		a	Upper floor	1 staircase of 1.5 mtrs or if main staircase width is < 1.5 mtrs an additional staircase of 0.75 mtrs width is required.	1.0 mtrs & 1.04 mtrs	MR
		b	Basement	1 staircase of 1.5 mtrs or if main staircase width is < 1.5 mtrs an additional staircase of 0.75 mtrs width is required.	0.93 mtrs & 0.88 mtrs	MR
	C	Protection of exits				
		a	Fire check door	NA	NA	NA
		b	Pressurization	NA	NA	NA
	D	No. of continuous staircases to terrace	Required		1 no.	MR
	E	Width of corridor	NA		NA	NA
	F	Door size	1.0 mtrs. (for class room)		1.0 mtrs. (for class room)	MR
3	Compartmentation:					
	A	Fire check door	NA	NA	NA	
	B	Sealing of electrical shafts	NA	NA	NA	
	C	Fire rating of shaft door	NA	NA	NA	
	D	Water curtain	NA	NA	NA	
	E	Fire dampers	NA	NA	NA	
4	Smoke Management System:					
	A	Basement	NA	NA	NA	
	B	Upper floor	NA	NA	NA	

✓ 04

5. Fire Extinguisher:					
	A	Total numbers	04 nos.	06 nos.	MR
	B	Types	CO ₂ & ABC	CO ₂ & ABC	MR
	C	ISI marking	Required	Provided	MR
6 First-Aid-Hose Reel:					
	A	Total numbers of each floor	NA	NA	NA
	B	Length of hose reel hose	NA	NA	NA
	C	Nozzle diameter	NA	NA	NA
7 Automatic Fire Detection and Alarming System:					
	A	Type of detectors	NA	NA	NA
	B	Location of main panel	NA	NA	NA
	C	Location of repeater panel	NA	NA	NA
	D	Alternate source of power	NA	NA	NA
	E	Hooters	NA	NA	NA
8	MOEFA:		NA	NA	NA
9	Public Address System:		NA	NA	NA
10 Automatic Sprinkler System:					
	A	Basement	NA	NA	NA
	B	Upper floor	NA	NA	NA
	C	Sprinkler above false ceiling	NA	NA	NA
11 Internal Hydrants:					
	A	Size of riser/down-comer	NA	NA	NA
	B	Number of hydrants per floor	NA	NA	NA
	C	Hose box	NA	NA	NA
12 Yard Hydrants:					
	A	Total number of hydrants	NA	NA	NA
	B	Hose box	NA	NA	NA
13 Pumping Arrangements:					
A Ground level					
	a	Discharge of main pump	NA	NA	NA
	b	Head of main pump	NA	NA	NA
	c	Number of main pumps	NA	NA	NA
	d	Jockey pump out put	NA	NA	NA
	e	Jockey pump head	NA	NA	NA
	f	Standby pump out put	NA	NA	NA
	g	Standby pump head	NA	NA	NA
	h	Auto starting /manual stopping	NA	NA	NA
	i	Pump house access	NA	NA	NA
B Terrace Level					
	a	Discharge of pump	NA	NA	NA
	b	Head of the pump	NA	NA	NA
	c	Power supply	NA	NA	NA
	d	Auto starting of pump	NA	NA	NA
14 Captive Water Storage for Fire Fighting:					
	A	Underground tank capacity	NA	NA	NA
	B	Draw-off connection	NA	NA	NA
	C	Fire service inlet	NA	NA	NA
	D	Access to tank	NA	NA	NA
	E	Overhead tank capacity	NA	NA	NA
15	Exit Signage:		Required	Provided	MR

Dev Public School located at G - 12/193 A, Ratiya Marg, Sangam Vihar, New Delhi.


16	Provision of Lifts:						
	A	Pressurization of lift shaft	NA	NA	NA		
	B	Pressurization of lift lobby	NA	NA	NA		
	C	Communication in lift car	NA	NA	NA		
	D	Firemen's grounding switch	NA	NA	NA		
	E	Lift signage	NA	NA	NA		
17	Standby Power Supply:				NA	NA	NA
18	Refuge Area:						
	A	Total area	NA	NA	NA		
	B	Location	NA	NA	NA		
19	Fire Control Room:						
	A	Detector system panel	NA	NA	NA		
	B	Flow switch panel	NA	NA	NA		
	C	PA system panel	NA	NA	NA		
	D	Battery backup	NA	NA	NA		
	E	Building floor plans	NA	NA	NA		
20	Special Fire Protection systems for protection of special Risks, if any:		NA		NA		


LEGENDS:-Meeting Requirement (MR), Not Meeting Requirement (NMR), Not Applicable (NA), Provided but Not Functional (PNF), Not Provided (NP).

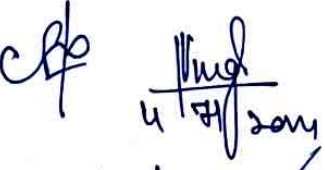
The fire protection systems provided in the building were tested checked and found properly functional at the time of inspection.


The shortcomings issued to the school by this department vide letter no. F6/DFS/MS/School/SZ/2024/188 dated 23.04.2024 has been rectified by the management.

Keeping in view of the deemed compliance of minimum standards of fire prevention and fire safety measures as required in Directorate of Education circular no. 3298 to 3398 dated 01.03.2011, it is recommended to grant Fire Safety Certificate.


 Signature of the Inspecting Officer
 Name Rajesh Kumar Shukla
 Designation ADO (M. Road)

DO (SD)

 4/7/24

CFD

 4/7/2024

Director

 5/7/24

M. K. S.