

c22

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE: CANNAUGHT PLACE
NEW DELHI- 110001

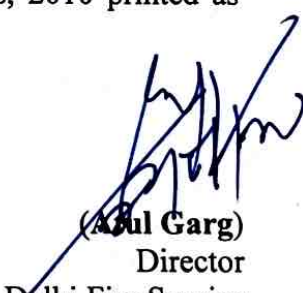
No. F6/DFS/MS/School/2024/SZ/ 694

Dated: 23/07/2024

FIRE SAFETY CERTIFICATE

Certified that the **Indira Ideal Sr. Sec. School, C-3, Janakpuri, New Delhi-110058**, comprised of ground plus three upper floors owned/occupied by Indira Ideal Sr. Sec. School was issued FSC by this department vide letter No. F.6/DFS/MS/School/2021/SZ/733 dated 09.09.2021. The School building was re-inspected by the officer concerned of this department on 10.07.2024 in the presence of Sh. Sandeep Kulshrestha (Manager) and found that the School building have deemed complied the fire prevention and fire safety requirements in accordance with Rule-33 of the Delhi Fire Service Rules, 2010 and that the building/ premises is fit for occupancy class "**Educational**" w.e.f 23/07/2024 for a period of **three years** in accordance with Rule 36 unless renewed under Rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under Rule-38 of the Delhi Fire Service Rules, 2010 printed as below.

Issued on 23/07/2024 at New Delhi.


(Abul Garg)
Director
Delhi Fire Service

Copy to:-

1. The Manager, Indira Ideal Sr. Sec. School at C-3, Janakpuri, New Delhi-110058.
2. Director of Education, Govt. of NCT of Delhi, Old Secretariat, New Delhi- 54.

Following fire safety directives must be adhered to: -

1. All the fire safety arrangements provided therein shall be maintained in good working condition at all times.
2. The means of escape shall be kept unlocked and unobstructed for unhindered evacuation of occupants in case of emergency.
3. Any loss of life or property due to non-functional fire safety measures shall be at the risk and responsibility of the management.
4. The trained staff should be available round the clock.
5. Any deviations w.r.t. construction shall be verified by the concerned building sanctioning agency.
6. The certificate may not be treated in any case for the regularization of the unauthorized construction, if any.
7. The owner/occupier shall submit a declaration every year in the form 'K' provided in the first schedule of Delhi Fire Service Rules 2010, form is available on www.dfs.delhigovt.nic.in.
8. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in the Form 'J' [sub rule (1) of rule 37] along with a copy of this Certificate, six months prior to its expiry.

N/2
INSPECTION REPORT

1. Name & address of the building : Indira Ideal Sr. Sec. School, C-3, Janakpuri, New Delhi-110058.
 2. Building is comprised of : Ground plus Three upper Floors
 3. Type of Occupancy : Educational
 4. Type of Case : Renewal
 5. Details of Previous NOC : F.6/DFS/MS/School/2021/SZ/733 dated 09.09.2021
 6. Fire Safety direction letter No : N/A
 7. Date of Inspection : 10.07.2024
 8. Name of the Inspecting Officers: : ADO R.K. YADAV
 9. Name of the designation of Officer from the building side : Sh. Sandeep Kulshrestha (Manager)
 10. Year of Construction : 2005-06
 11. Applicant's letter No : IISSS/JP/2024/12010 dated 20.06.2024

S. No.	Minimum Standards on fire prevention and fire safety requirements U/R 33	Requirement	Provided at Site	Remarks MR/NMR	
1	Access to building				
	Road width	6 m	06 m	MR	
	Gate width	4.5 m	4.5 m	MR	
	Width of internal road	N.A.	N.A.	N.A.	
2	Number, Width, Type and Arrangement of Exits				
	a. Number of Staircases	Upper Floor	04 no.	05 no.	MR
		Basement	N.A.	N.A.	N.A.
	b. Width of Staircases	Upper Floor	1.50 m & less than	3x1.40 m, .92 & .82 m	MR old case
		Basement	N.A.	N.A.	N.A.
	c. Protection of exits	Fire check door	N.A.	N.A.	N.A.
		Pressurization	03 no.	Provided	MR
	e. No. of continuous staircases to terrace	1.50 m	1.70 m	MR	
	g. Width of Corridor	1.20 m	1.20 m	MR	
	h. Door Size				
	3	Compartmentation			
		Fire check door	N.A.	N.A.	N.A.
		Sealing of electrical shafts	N.A.	N.A.	N.A.
Fire rating of shaft door		N.A.	N.A.	N.A.	
Water curtain		N.A.	N.A.	N.A.	
Fire Dampers		N.A.	N.A.	N.A.	
4	Smoke Management System.				
	Basement	N.A.	N.A.	N.A.	
	Upper floor	Required	Natural Ventilation	MR	

12

h

h

5.	Fire Extinguisher			
	Total numbers types IS marking	06 Nos.	12 Nos.	MR
		CO ₂ & ABC	CO ₂ & ABC	MR
		ISI marked	ISI marked	MR
6	First-aid-Hose Reels.			
	Total numbers of each floor Length of hose reel hose Nozzle diameter	03 Nos.	03 Nos.	MR
		30 m	30 m	MR
		05 mm	05 mm	MR
7	Automatic fire detection and alarming system.			
	Type of detectors	N.A.	N.A.	N.A.
	Location of main panel	N.A.	N.A.	N.A.
	Location of repeater panel	N.A.	N.A.	N.A.
	Alternate source of power	N.A.	N.A.	N.A.
	Hooters	N.A.	N.A.	N.A.
	MOEFA	N.A.	N.A.	N.A.
8	MOEFA	N.A.	N.A.	N.A.
9	Public address System.	N.A.	Provided	MR
10	Automatic Sprinkler System.			
	basement	N.A.	N.A.	N.A.
	upper floor	N.A.	N.A.	N.A.
	sprinkler above false ceiling	N.A.	N.A.	N.A.
11	Internal Hydrants			
	size of riser/down-comer	100 mm	100 mm	MR
	Number of hydrants per floor	3 nos.	3 nos.	MR
	Hose Box	3 nos.	3 nos.	MR
12	Yard Hydrants.			
	Total number of hydrants	N.A.	N.A.	N.A.
	Hose Box	N.A.	N.A.	N.A.
13	Pumping Arrangements.			
	<ul style="list-style-type: none"> • Ground Level ➤ Discharge of main Pump ➤ Head of Main Pump ➤ Number of main pumps ➤ Jockey pump out put ➤ Jockey pump head ➤ Standby pump out put ➤ Standby pump Head ➤ Auto Starting /Manual stopping ➤ Pump House Access • Terrace Level ➤ Discharge of pump ➤ Head of the Pump ➤ Power supply ➤ Auto Starting of pump 	N.A.	N.A.	N.A.
		N.A.	N.A.	N.A.
		N.A.	N.A.	N.A.
		N.A.	N.A.	N.A.
		N.A.	N.A.	N.A.
		N.A.	N.A.	N.A.
		N.A.	N.A.	N.A.
		N.A.	N.A.	N.A.
		N.A.	N.A.	N.A.
		N.A.	N.A.	N.A.
		N.A.	N.A.	N.A.
		N.A.	N.A.	N.A.
		450 LPM	450 LPM	MR
	40 m	40 m	MR	
Required	Provided	MR		
Required	Provided	MR		
14	Captive Water Storage for Fire Fighting.			
	Underground tank capacity	N.A.	N.A.	N.A.
	Draw-off connection	N.A.	N.A.	N.A.
	Fire service inlet	N.A.	N.A.	N.A.
	Access to tank	N.A.	N.A.	N.A.
	Overhead Tank capacity	10,000 ltrs	10,000 ltrs	MR
15	Exit Signage.	Required	Provided	MR

45

TR
R
r

16	Provision of Lifts.	N.A.	N.A.	N.A.
	Pressurization of Lift Shaft	N.A.	N.A.	N.A.
	Pressurization of Lift lobby	N.A.	N.A.	N.A.
	Communication in lift car	N.A.	N.A.	N.A.
	Firemen's grounding switch	N.A.	N.A.	N.A.
	Lift Signage	N.A.	N.A.	N.A.
17	Standby power supply	N.A.	N.A.	N.A.
18	Refuge Area.			
	Total area	N.A.	N.A.	N.A.
	Location	N.A.	N.A.	N.A.
19	Fire Control Room			
	Detector system panel	N.A.	N.A.	N.A.
	Flow switch panel	N.A.	N.A.	N.A.
	PA system panel	N.A.	N.A.	N.A.
	Batter backup	N.A.	N.A.	N.A.
	Building Floor Plans	N.A.	N.A.	N.A.
20	Special Fire Protection systems for protection of special Risks, if any:	N.A.	N.A.	N.A.

The fire protection systems provided in the building were tested, checked and found functional at the time of inspection.

In view of the deemed compliance of the minimum standards of fire prevention and fire safety measures as required under the rules the Fire Safety Certificate issued vide letter number F.6/DFS/MS/School/2021/SZ/733 dated 09.09.2021, renewal under rule 37 of the Delhi Fire Service Rules 2010 is recommended.

R. K. Yadav
11/2/2024

Signature of the Inspecting Officer
Name- R K YADAV
Designation- ADO (JKP)

DO (South West)
[Signature]
12/2/24

CFO (SZ)
[Signature]
18/7/2024

Director
[Signature]
18/07/24

[Signature]

RFO