

c-11

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE, CONNAUGHT PLACE

NEW DELHI- 110001

No.F.6/DFS/MS/EH/2024/SZ/264

Dated: 20/08/2024

FIRE SAFETY CERTIFICATE

Certified that the M/s. KFC, A unit of Sapphire Foods India Ltd., located at Shop No. 29/2, GF & FF, Near Tilak Nagar Metro Station, Ashok Nagar, Double Story, New Delhi- 110018, running at ground floor (Kitchen) and first floor (Seating area of Restaurant) only of a building comprised of Ground plus three upper floors, owned/occupied by A unit of Sapphire Foods India Ltd. The restaurant/eating house building was inspected by the officer concerned of this department on dated 07.08.2024 in the presence of Sh. Mathur Sharma (Senior Manager) and found that the restaurant building have complied with the fire prevention and fire safety requirements in accordance with the fire prevention and fire safety requirements in accordance with Rule 33 of the Delhi Fire Service Rules, 2010 and that the premises is fit for occupancy Class "D" "Assembly Building" (for ground and first floor only) w.e.f. the date of issue of this certificate for a period of three years in accordance with Rule 36 unless renewed under Rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under Rule-38 of the Delhi Fire Service Rules, 2010 printed below.

Issued on 20/08/2024 at New Delhi.


(ATUL GARG)
DIRECTOR
DELHI FIRE SERVICE

Online application Id 2024071511035 dated 15.07.2024

Conditions for the validity of fire safety certificate: -

1. This NOC is valid only for ground and first floor.
2. All the means of escape shall be kept free of all type of obstruction all the time.
3. All the employees shall be acquainted with the use and maintenance of all fire equipment's and method of smooth and speedy safe evacuation of occupants in case of emergency.
4. All the firefighting equipment's shall be maintained in perfect working condition all the time and any lapse rendering non-functional of fire safety measures, management shall be responsible.
5. Any deviation, with regards to construction, ventilation, occupancy, electric installation etc. may be got verified from the concerned authorities.
6. This Fire Safety Certificate may not be treated in any case for regularizations of unauthorized construction /unauthorized use of land if any.
7. The owner / occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rule 2010. The form is available on www.dfs.delhigovt.nic.in.
8. The owner / occupier shall apply for renewal of this Fire Safety Certificate to the Director in Form 'J' [sub rule (1) of rule (37)] along with a copy of this Certificate, six months prior to its expiry.

INSPECTION REPORT

1. Name & address of the building : KFC, A unit of Sapphire Foods India Ltd., located at Shop No. 29/2, GF & FF, Near Tilak Nagar Metro Station, Ashok Nagar, Double Story, New Delhi- 110018,
2. Type of Occupancy : Assembly (Restaurant)
3. Building Composition : Said restaurant is running at ground floor & 1st floor of a building comprised of Ground plus three upper floors
4. Type of Case : New Case
5. Details of previous NOC : N/A
6. Fire Safety directives letter No : N/A
7. Date of inspection : 07.08.2024
8. Name of the Inspecting Officers : R.K. Yadav, ADO (JKP)
9. Name and designation of officers from the building side : Sh. Mathur Sharma (Senior Manager)
9. Year of Construction : 2000
10. Applicant's letter No. : Online Application Id 2024071511035 dated 15.07.2024

S. No.	Minimum Standards on fire prevention and fire safety U/R 33	Requirement as per NBC/BBL	Provided at site	Remarks MR/NMR
1	Access to building			MR
	<ul style="list-style-type: none"> • Road width • Gate width • Width of internal road 	06 mts	Provided	MR
		4.5 mts	Directly accessible from the road	MR
		N/A	N/A	N/A
2	Number, Width, Type & Arrangement of Exits			-
	a. Number of staircases	-	-	MR
	• Upper Floors	02	03	MR
	• Basements	N/A	N/A	N/A
	b. Width of staircases	-	-	-
	• Upper Floors	1.50 mts each	1.50, 1.50 & 0.80 mts	MR
	• Basements	N/A	N/A	N/A
	c. Protection of exits	-	-	-
	• Fire check door	N/A	N/A	N/A
	• Pressurization	N/A	N/A	N/A
	e. No. of continuous staircases to terrace	N/A	N/A	N/A
	g. Width of Corridor	1.5 mts each	1.5 mts each	MR
	h. Door Size	2.2 x 2.2	2.2 x 2.2	MR
3	Compartmentation.			
	• Fire check door	N/A	N/A	N/A
	• Sealing of electrical shafts	N/A	N/A	N/A
	• Fire Rating of shaft door	N/A	N/A	N/A
	• Water Curtain	N/A	N/A	N/A
	• Fire Dampers	N/A	N/A	N/A
4	Smoke Management System.			
	• Basements	30 a/c per hour	N/A	N/A
	• Upper floors (Restaurant)	12 a/c per hour	Provided	MR
5	Fire Extinguishers			
	• Total numbers	10	Provided	MR
	• Types	CO ₂ , ABC type	Provided	MR
	• IS marking	ISI marked	Provided	MR

N/A				
6	First-Aid Hose Reels.			
	• Total numbers on G. floor (Rest.)	01	Provided	MR
	• Length of hose reel hose	30 m	Provided	MR
	• Nozzle diameter	5 mm	Provided	MR
7	Automatic fire detection and alarming system.			
	• Type of detectors	Heat/Smoke	Provided	MR
	• Location of Main Panel	N/A	N/A	N/A
	• Location of Repeater Panel	N/A	N/A	N/A
	• Alternate source of power	Required	Provided	MR
	• Hooters' Location	N/A	N/A	N/A
8	MOEFA	Required	Provided	MR
9	Public Address System.	N/A	N/A	N/A
10	Automatic Sprinkler System.			
	• Basement	N/A	N/A	N/A
	• Entire Restaurant	Required	Provided	MR
	• Sprinkler above false ceiling	N/A	N/A	N/A
11	Internal Hydrants			
	• Size of riser/down-comer	100 mm	100 mm	MR
	• Number of hydrants per floor	01	01	MR
	• Hose Box	01	01	MR
12	Yard Hydrants.			
	• Total number of hydrants	N/A	N/A	N/A
	• Hose Box	N/A	N/A	N/A
13	Pumping Arrangements.			
	• Ground Level	---	---	---
	➤ Discharge of main Pump	N/A	N/A	N/A
	➤ Head of Main pump	N/A	N/A	N/A
	➤ Number of main pumps	N/A	N/A	N/A
	➤ Jockey Pump out put	N/A	N/A	N/A
	➤ Jockey pump head	N/A	N/A	N/A
	➤ Standby Pump out put	N/A	N/A	N/A
	➤ Standby Pump Head	N/A	N/A	N/A
	➤ Auto Starting/ Manual stopping	N/A	N/A	N/A
	➤ Pump House Access	N/A	N/A	N/A
	• Terrace level	-----	-----	-----
	➤ Discharge of pump	450 LPM	450 LPM	MR
	➤ Head of the pump	40 mts	Provided	MR
	➤ Power Supply	Required	Provided	MR
	➤ Auto Starting of pump	Required	Provided	MR
14	Captive Water Storage for fire fighting.			
	• Underground tank capacity	N/A	N/A	N/A
	➤ Draw-off connection	N/A	N/A	N/A
	➤ Fire service inlet	N/A	N/A	N/A
	➤ Access to tank	N/A	N/A	N/A
	• Overhead Tank capacity	20,000 lts	Provided	MR
15	Exit Signage.	Required	Provided	MR
16	Provision of Lifts.			

N-13


	<ul style="list-style-type: none"> • Pressurization of Lift Shaft • Pressurization of Lift lobby • Communication In lift Car • Fireman's Grounding Switch • Lift Signage 	N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	MR
17	Standby power supply	Required	Provided	
18	Refuge Area.			N/A
	➤ Total Area	N/A	N/A	N/A
	➤ Location	N/A	N/A	
19	Fire Control Room			N/A
	• Detector System Panel	N/A	N/A	N/A
	• Flow Switch Panel	N/A	N/A	N/A
	• PA System Panel	N/A	N/A	N/A
	• Battery backup	N/A	N/A	N/A
	• Building Floor Plans	N/A	N/A	N/A
20	Special Fire Protection Systems for Protection of special Risks, if any:	N/A	N/A	N/A


The fire protection systems provided in the building were test checked at random and found not functional at the time of inspection.


Note:- The total covered area of restaurant as per MHA CAF portal is 102 Sq mtr., so sitting capacity comes $(102/1.8 = 57)$ 57 persons. Restaurant running at ground floor (Kitchen) and first floor (seating area of restaurant) of a building comprised of ground plus three upper floors, second floor (offices) is other property and third floor is vacant.

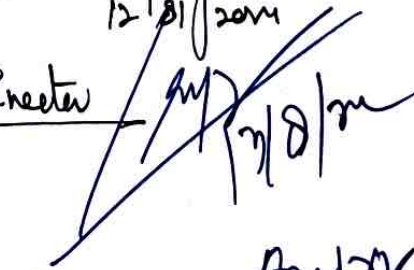
Keeping in view the compliance of the minimum standards on fire prevention and fire safety required under the rules it is recommended to grant Fire Safety Certificate under Rule 35 of the Delhi Fire Service Rule 2010.

Accordingly, reply letter is put up for approval & signature please.


 Signature of the inspecting officer
 Name- R.K. Yadav
 Designation- ADO (JKP)

DO (SW)  9/8/24

CFD (S2)  12/8/2024

Director  17/8/24

R.K. Yadav