



GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE, NEW DELHI-110001

No. F.6/DFS/MS/2024/SZ/ E4/261

Dated: 16/08/2024

FIRE SAFETY CERTIFICATE

Certified that M/s **Fun & Food Village Polo Amusement Park Ltd.**, Old Gurgaon Road, Kapashera, New Delhi-110037, comprised of ground floor only has already been issued Fire Safety Certificate by this office vide letter No. F6/DFS/MS/2021/SZ/178 dated 17/03/2021. The premise was re-inspected by the officers concerned of this department on 05/08/2024 in the presence of Sh. Santokh Singh Chawla and found that said amusement park premises have deemed complied with the fire prevention and fire safety requirements in accordance with rule 33 of the Delhi Fire Service Rules, 2010 and that the premises is fit for occupancy class "**Assembly**" Group-D with effect from 16/08/2024 for a period of **three years** in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under Rule 40 and subject to compliance of conditions under 38 of the Delhi Fire Service Rules, 2010.

Issued on 16/08/2024 at New Delhi by

(ATUL GARG)
DIRECTOR
DELHI FIRE SERVICE

Copy to: -

1. The Joint Commissioner of Police, Licensing Unit, First Floor, Police Station Defence Colony, New Delhi-110049
2. Authorized Signatory M/s Fun & Food Village Polo Amusement Park Ltd. located at Old Gurgaon Road, Kapashera, New Delhi-110037

Conditions for the validity of Fire Safety Certificate:

1. **The owner/occupier shall ensure that the electrical cables/wires are sealed properly and laid through conduit. The trained fire-fighting staff shall be available during public visiting hours.**
2. All the means of escape / entry / exit shall be kept free from any obstruction.
3. All the fire safety arrangement provided therein shall be maintained in good working conditions at all time as seen during inspection. Any loss of life property due to non-functional fire safety measures shall be at the responsibility of the management.
4. All the staff members must know the correct method of operation of firefighting system.
5. Any deviation, with regards to construction, ventilation, occupancy, electric installation etc. may be got verified from the concerned authorities.
6. The owner/occupier shall submit a declaration every year in form "K" provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on www.dfs.delhigovt.nic.in
7. This fire safety certificate may not in any way be treated as regularization (Clause 2.8 of UBBL-2016) of unauthorized construction or alteration (Clause 1.4.3 of UBBL-2016), if any.
8. "The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in Form 'J' [sub rule (1) of rule 37] along with a copy of this Certificate, six months prior to its expiry".

N-39

INSPECTION REPORT

1.	Name & address of the building	M/s Fun & Food Village Polo Amusement Park Ltd. Old Gurgaon Road, Kapashera, New Delhi-110037		
2.	Type of Occupancy	Assembly		
3.	Building Comprised of	Ground floor only.		
4.	Type of Case	Renewal		
5.	Details of previous NOC No.	F.6/DFS/MS/2021/SZ/178 dated 17/03/2021		
6.	Fire Safety directives Letter No.	Nil		
7.	Date of inspection	05/08/2024		
8.	Name of the Inspecting Officer	DO (SD) and ADO (SJ)		
9.	Name and designation of Officer from the building side	Sh. Santokh Singh Chawla		
10.	Year of Construction	1992		
11.	Applicant's letter No.	Outdoor Diary No. 4714 dated 30/07/2024		
S. No.	Minimum standards on fire prevention and fire safety U/R 33	Old NOC Requirement	Provided at site	Remarks MR/NMR
1.	Access of building			
	• Road width	12m	Provided	MR
	• Gate width	5m	Provided (2nos)	MR
	• Width of internal road	N/A	N/A	N/A
2.	Number, width, Type & Arrangements of exits			
	a. Number of staircases			
	• Upper floors	N/A	N/A	N/A
	• Basements	N/A	N/A	N/A
	b. Width of staircases			
	• Upper floors	N/A	N/A	N/A
	• Basements	N/A	N/A	N/A
	c. Protection of exits			
	• Fire check door	N/A	N/A	N/A
	• Pressurization	N/A	N/A	N/A
	d. No of continuous staircase to terrace	N/A	N/A	N/A
	e. Width of Corridor	N/A	N/A	N/A
	f. Door Size (Classroom)	N/A	N/A	N/A
3.	Compartmentation			
	• Fire check door	N/A	N/A	N/A
	• Sealing of electrical shafts	N/A	N/A	N/A
	• Fire Rating of shaft door	N/A	N/A	N/A
	• Water Curtain	N/A	N/A	N/A
	• Fire Dampers	N/A	N/A	N/A
4.	Smoke Managements System			
	• Basements	N/A	N/A	N/A
	• Upper floors	N/A	N/A	N/A
5.	Fire Extinguishers			
	• Total numbers	ISI marked	25 Nos	MR
	• Types		ABC & CO ₂	MR
	• ISI marking		Provided	MR
6.	First-Aid Hose Reels			
	• Total numbers on each floor	7 Nos	Provided	MR
	• Length of hose reel hose	30m	Provided	MR
	• Nozzle diameter	5mm	Provided	MR

80

w

7.	Automatic fire detection and alarming system			
	• Type of detector	N/A	N/A	N/A
	• Location of Main Panel	N/A	N/A	N/A
	• Location of Repeater Panel	N/A	N/A	N/A
	• Alternate source of power	N/A	N/A	N/A
	• Hooters' Location	N/A	N/A	N/A
8.	MOEFA	Required	Provided	MR
9.	Public Address System	Required	Provided	MR
10.	Automatic Sprinkler System			
	• Basements	N/A	N/A	N/A
	• Upper Floor	N/A	N/A	N/A
	• Sprinkler above false ceiling	N/A	N/A	N/A
11.	Internal Hydrants			
	• Size of riser/down- comer	N/A	N/A	N/A
	• Number of hydrants per floor	N/A	N/A	N/A
	• Hose Box	N/A	N/A	N/A
12.	Yard Hydrants			
	• Total number of hydrants	Required	02 Nos	MR
	• Hose Box	Required	02 Nos	MR
13.	Pumping Arrangements			
	• Ground Level			
	➤ Discharge of main pump	450 LPM	450 LPM	MR
	➤ Head of main pump	40m	40m	MR
	➤ Number of main pumps	One	One	MR
	➤ Jockey pump out put	225 LPM	225 LPM	MR
	➤ Jockey pump head	40m	40m	MR
	➤ Standby Pump out put	N/A	N/A	N/A
	➤ Standby Pump Head	N/A	N/A	N/A
	➤ Auto Staring/Manual's stopping	Required	Provided	MR
	➤ Pump House Access	Required	Provided	MR
	• Terrace level			
	➤ Discharge of pump	N/A	N/A	N/A
	➤ Head of the pump	N/A	N/A	N/A
	➤ Power supply	N/A	N/A	N/A
	➤ Auto starting of pump	N/A	N/A	N/A
14.	Captive water Storage for fire fighting			
	• Underground tank capacity	N/A	N/A	N/A
	➤ Draw of connection	N/A	N/A	N/A
	➤ Fire service inlet	N/A	N/A	N/A
	➤ Access to tank	N/A	N/A	N/A
	• Overhead Tank capacity	100,000 ltrs	100,000 ltrs	MR
15	Exit Signage	Required	Found removed	MR
16.	Provision of Lifts			
	➤ Pressurization of Lift Shaft	N/A	N/A	N/A
	➤ Pressurization of lift lobby	N/A	N/A	N/A
	➤ Communication in lift Car	N/A	N/A	N/A
	➤ Fireman's Grounding Switch	N/A	N/A	N/A
	➤ Lift Signage	N/A	N/A	N/A
17.	Standby power supply	Required	Provided	MR
18.	Refuge Area			
	➤ Total area	N/A	N/A	N/A
	➤ Location	N/A	N/A	N/A

80


N-41


19.	Fire control room			
	➤ Detector system panel	N/A	N/A	N/A
	➤ Flow Switch Panel	N/A	N/A	N/A
	➤ PA System Panel	N/A	N/A	N/A
	➤ Battery backup	N/A	N/A	N/A
	➤ Building Floor Plans	N/A	N/A	N/A
20.	Special Fire Protection Systems for Protection of special Risks, if any;	N/A	N/A	N/A

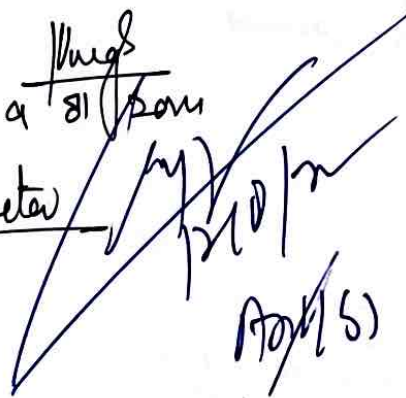
The fire protection systems provided in the premises were checked, tested at random and found functional at the of inspection. The shortcomings communicated by this department vide letter No. F.6/DFS/MS/2024/SZ/275 dated 05/07/2024 found complied.

Keeping in view of the deemed compliance of the minimum standard on fire prevention and fire safety measures as required under the rules, the fire safety certificate issued vide letter No. F.6/DFS/MS/2021/SZ/178 dated 17/03/2021, renewal under rule 37 of the Delhi Fire Service Rules, 2010 is recommended.

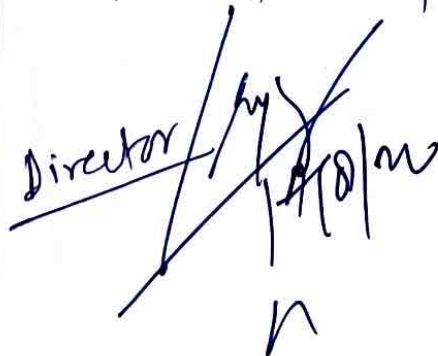
Accordingly, DFA is put up for approval and signature please.


Signature of the Inspecting Officer
Name: Manoj Kumar Sharma
Designation: DO (SD)


Signature of the Inspecting Officer
Name: Santosh Kumar
Designation: ADO (SJ)

CFO(HQ)

a/si (Person)
Director
ADP(S)

Sir,
F.T letter is put up for your sig. pl


Director
ADP(S)


14/08/24