

243



GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE: NEW DELHI- 110001




No. F6/DFS/MS/2024/School/ 861

Dated: 04/09/2024

FIRE SAFETY CERTIFICATE

Certified that the Govt. Girls Sr. Sec. School (I.D No. 1309263) located at Gali No-15, Bhatta Raod, Libaspur (Swaroop Nagar), Delhi-110042 comprised of 05 Blocks, Ground & First Floor Each only owned/occupied by Govt. Girls Sr. Sec. School was granted FSC by this department vide letter no. F6/DFS/MS/School//2021/WZ/675 dated: 31.08.2021. The premises was inspected by the officer concerned of this department on 17.08.2024 in presence of Sh. Devdutt Chauhan (Teacher) and observed that all the fire safety arrangements as provided in the premises found in good working condition. The premises have deemed complied with requirements of circular issued by Director of Education vide letter no 3298-3398 dated 01.03.2011 and the building/ premise is fit for occupancy class Group B Educational with effect from04/09/24... for a period of three years, subject to compliance of the conditions mentioned below:

Issued on04/09/2024... at New Delhi


(Atul Garg)
Director
Ph:-011-23414000
of c Cp

Copy to :-

1. The Director of Education, Government of N.C.T of Delhi. Old Sectt. Delhi - 110054.
2. The Principal, Govt. Girls Sr. Sec. School (I.D No. 1309263) located at Gali No-15, Bhatta Road, Libaspur (Swaroop Nagar), Delhi-110042.

Conditions for the validity of Fire Safety Certificate:

1. All the means of escape shall be kept free from any type of obstruction all the time.
2. All the employees shall be acquainted with the use and maintenance of all fire equipment and method of smooth and speedy safe evacuation of occupants in case of emergency
3. All the fire safety arrangements provided therein shall be maintained in good working condition at all time as seem during inspection. Any loss of life or property due to non-functional fire safety measures shall be at the responsibility of the management.
4. Any deviation, with regards to construction, ventilation, occupancy, electric installation etc. may be got verified from the concerned authorities. This Fire Safety Certificate is valid only for permanent building structure as per plan.
5. This fire safety certificate may not be treated in any case of regularizations of unauthorized construction/unauthorized use of land or activities, if any.
6. The owner / occupier shall submit a declaration every year in Form "K" provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on the official website of Delhi Fire Service i.e. www.dfs.delhigovt.nic.in.
7. "The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in Form 'J' [sub rule (1) of rule 37] along with a copy of this Certificate, six months prior to its expiry".

INSPECTION REPORT

1. Name & address of the building : Govt. Girls Sr. Sec. School at Gali No-15, Libaspur (Swaroop Nagar), Delhi-42.
2. Type of Occupancy : Educational
3. Type of Case : Renewal
4. Composition of building : 05 Blocks, Ground & First Floor each only (School ID No-1309263)
5. Details of previous NOC : F6/DFS/MS/School//2021/WZ/675 dated: 31.08.2021
6. Fire Safety directives letter No : Director of Education Circular dated 01.03.2011
7. Date of inspection : 17.08.2024
8. Name of the Inspecting Officers : ADO (RN)
9. Name and designation of officers from the building side : Sh. Devdutt Chauhan (Teacher)
10. Year of Construction : 1994
11. Applicant's letter No. : Online e-mail dated: 02.08.2024


	Minimum Standards on fire prevention and fire safety U/R 33	Director of Education Circular dated 01.03.2011	Provided at site	Remarks MR/NMR
1	Access to building			
	<ul style="list-style-type: none"> • Road width • Gate width • Width of internal road 	06m 4.5m NA	06m 4.5m NA	MR MR NA
2	Number, Width, Type & Arrangement of Exits			
	a. Number of staircases			
	<ul style="list-style-type: none"> • Upper Floors • Basements 	Block-A-02 Block-b-01 Block-c-01 Block-d-01 Block-e-02 NA	Provided NA	MR NA
	b. Width of staircases			
	<ul style="list-style-type: none"> • Upper Floors • Basements 	1.5m each NA	1.5m each NA	MR NA
	c. Protection of exits			
	<ul style="list-style-type: none"> • Fire check door • Pressurization 	NA NA	NA NA	NA NA
	d. No. of continuous staircases to terrace	NA	NA	NA
	e. Width of Corridor	1.50m	2.50m	MR
	f. Door Size	1m each	1m each	MR
3	Compartmentation.			
	<ul style="list-style-type: none"> • Fire check door • Sealing of electrical shafts • Fire Rating of shaft door • Water Curtain • Fire Dampers 	NA NA NA NA NA	NA NA NA NA NA	NA NA NA NA NA
4	Smoke Management System.			
	<ul style="list-style-type: none"> • Basements • Upper floors 	NA Required	NA Natural Ventilated	NA MR
5	Fire Extinguishers			
	<ul style="list-style-type: none"> • Total numbers • Types 	09nos ABC/Co2	16nos ABC-16	MR MR

	ISI marking	ISI Marked	Yes	M
6	First-Aid Hose Reels.			
	• Total numbers on each floor	NA	NA	NA
	• Length of hose reel hose	NA	NA	NA
	• Nozzle diameter	NA	NA	NA
7	Automatic fire detection and alarming system.			
	• Type of detectors	NA	NA	NA
	• Location of Main Panel	NA	NA	NA
	• Location of Repeater Panel	NA	NA	NA
	• Alternate source of power	NA	NA	NA
	• Hooters' Location	NA	NA	NA
8	MOEFA	NA	NA	NA
9	Public Address System.	NA	NA	NA
10	Automatic Sprinkler System.			
	• Basement	NA	NA	NA
	• Upper Floor	NA	NA	NA
	• Sprinkler above false ceiling	NA	NA	NA
11	Internal Hydrants			
	• Size of riser/down-comer	NA	NA	NA
	• Number of hydrants per floor	NA	NA	NA
	• Hose Box	NA	NA	NA
12	Yard Hydrants.			
	• Total number of hydrants	NA	NA	NA
	• Hose Box	NA	NA	NA
13	Pumping Arrangements.			
	• Ground Level			
	➤ Discharge of main Pump	N/A	N/A	N/A
	➤ Head of Main pump	N/A	N/A	N/A
	➤ Number of main pumps	N/A	N/A	N/A
	➤ Jockey Pump out put	N/A	N/A	N/A
	➤ Jockey pump head	N/A	N/A	N/A
	➤ Standby Pump out put	N/A	N/A	N/A
	➤ Standby Pump Head	N/A	N/A	N/A
	➤ Auto Starting/ Manual stopping	N/A	N/A	N/A
	➤ Pump House Access	N/A	N/A	N/A
	• Terrace level	N/A	N/A	N/A
	➤ Discharge of pump			
	➤ Head of the pump	NA	N/A	NA
➤ Power Supply	NA	N/A	NA	
➤ Auto Starting of pump	N/A	N/A	N/A	
	N/A	N/A	N/A	
14	Captive Water Storage for fire fighting.			
	• Underground tank capacity	NA	Provided	NA
	➤ Draw-off connection	NA	NA	NA

	<ul style="list-style-type: none"> ➤ Fire service inlet ➤ Access to tank • Overhead Tank capacity 	NA	NA	NA
15	Exit Signage.	NA	NA	NA
16	Provision of Lifts.			
	<ul style="list-style-type: none"> • Pressurization of Lift Shaft • Pressurization of Lift lobby • Communication In lift Car • Fireman's Grounding Switch • Lift Signage 	N/A	N/A	N/A
17	Standby power supply	N/A	N/A	N/A
18	Refuge Area.			
	<ul style="list-style-type: none"> ➤ Total Area ➤ Location 	N/A	N/A	N/A
19	Fire Control Room			
	<ul style="list-style-type: none"> • Detector System Panel • Flow Switch Panel • PA System Panel • Batter backup • Building Floor Plans 	N/A	N/A	N/A
20	Special Fire Protection Systems for Protection of special Risks, if any:	N/A	N/A.	N/A


The fire protection systems provided in the building were tested/ checked randomly and found in working condition at the time of inspection.


Keeping in view the satisfactory compliance of the minimum standards on fire prevention and fire safety required as stipulated in Director of Education Circular issued vide letter of even no. F6/DFS/MS/School//2021/WZ/675 dated: 31.08.2021 renewal under rule 35(6) of the Delhi Fire Service Rules, 2010 is recommended.



 Signature of the Inspecting Officer
 Name:- C.L. Meena
 Designation:- Asst. Div. Officer (RN)

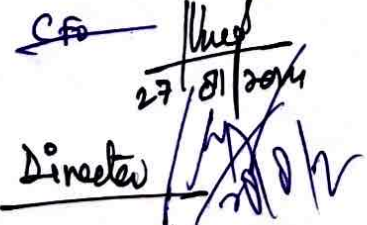
Dated: 27/08/2024
 27/08/2024


DO (NW)


 20/08/2024


 27/8/2024


 27/8/2024


 Director


 Asst. Div. Officer

Conf.. P.T.O.