

C 91

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE, NEW DELHI - 110001

No. F6/DFS/MS/GH/NDZ/2024/362

Dated: 04/09/2024

FIRE SAFETY CERTIFICATE

Certified that the M/s Rizwan Guest House located at 953, Gali Shyam Lal, Bazar Matia Mahal, Jama Masjid, Delhi, comprised of Ground + 04 upper floors: Ground floor- (03 guest rooms + reception), 1st floor - (04 guest rooms), 2nd floor - (04 guest rooms), 3rd floor - (04 guest rooms) & 4th floor - (not in use), total 15 guest rooms upto 3rd floor was granted FSC by this department vide letter no. F6/DFS/MS/GH/NDZ/2021/462 dated 01.10.2021. The building/premises was re-inspected by the officer concerned from this department on 16.08.2024 in presence of Mohd. Rizwan (Owner) and found that the building has deemed complied with the fire prevention and fire safety requirements in accordance with Rule 33 of Delhi Fire Service Rules, 2010. The owner has submitted an affidavit on 22.08.2024 stating not to use any floor above third floor for any purpose. Accordingly, the premises is fit for occupancy of (Group A-1) "Residential", Ground floor - (03 guest rooms), 1st floor - (04 guest rooms), 2nd floor - (04 guest rooms) & 3rd floor - (04 guest rooms) for total 15 guest rooms upto 3rd floor only, with effect from04/09/2024 for a period of three years in accordance with Rule 36 unless renewed under Rule 37 or sooner cancelled under Rule 40 and subject to conditions under Rule 38 of Delhi Fire service Rules, 2010 printed below.

Issued on04/09/2024.....at New Delhi by


(Anil Garg)
Director
Delhi Fire Service
Tel: 011-23414000
8/31

Copy to:-

1. The Commissioner, MCD:- to kindly ensure the occupancy as detailed above & deviation, if any.
2. The Joint Commissioner of Police (Licensing), 1st Floor, Police Station Defence Colony, New Delhi. w.r.to ID No. 2024080912466 dated 09.08.2024.
3. The Licensee, M/s Rizwan Guest House at 953, Gali Shyam Lal, Bazar Matia Mahal, Jama Masjid, Delhi.

Conditions for the validity of fire safety certificate

1. All the fire safety arrangements provided therein shall be maintained in good working conditions at all times.
2. Any loss of life or property due to non functional fire safety measures shall be at the responsibility of the management.
3. The trained fire fighting staff should be available round the clock.
4. Any deviation w.r.t. construction etc. shall be verified by the concerned building sanctioning authority.
5. This fire safety certificate may not be treated in any case for regularization of unauthorized construction, if any.
6. The owner / occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on www.dfs.delhigovt.nic.in
7. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in form 'J' [sub rule (I) of rule 37] along with a copy of this Certificate, six month prior to its expiry".
8. Any change in the occupancy shall be intimated to this Deptt. and approval shall be obtained thereto before occupancy of the same.
9. The occupancy of above 3rd floor not allowed as per clause 7.31 in UBBL-2016.
10. Basement found sealed with brick wall at the time of inspection.

INSPECTION REPORT

1	Name & address of the building	M/s Rizwan Guest House located at 953, Gali Shyam Lal, Bazar Matia Mahal, Jama Masjid, Delhi.		
2	Building is comprised of	Ground + 04 upper floors Ground floor - (03 guest rooms + reception) 1 st floor - (04 guest rooms) 2 nd floor - (04 guest rooms) 3 rd floor - (04 guest rooms) 4 th floor - (not in use as per affidavit dated 22.08.2024)		
3	Type of Occupancy	Residential Group A-1		
4	Type of Case	Renewal (old case)		
5	Details of Previous FSC	F6/DFS/MS/GH/NDZ/2021/462 dated 01.10.2021		
6	Fire Safety direction letter No	Nil		
7	Date of Inspection	16.08.2024		
8	Name of the Inspecting Officers	Sumit Kumar, ADO (SPM)		
9	Name of the designation of Officer from the building side	Mohd. Rizwan (Owner's)		
10	Year of Construction	Old		
11	Applicant's letter No	Online application I.D.2024080912466 dated 09.08.2024		
S.No	Minimum Standards on fire Prevention and fire safety requirements U/R 33	Requirement/ Existing fire safety arrangements	Provided at Site	Remarks MR/NMR
1	Access to building			
	A Road width	NA (Spl. Area)	02 mtrs. ✓	NA
	B Gate width	NA	NA	NA
	C Width of internal road	NA	NA	NA
2	Number, Width, Type and Arrangement of Exits			
	A. Number of Staircases			
	a Upper Floor	01 no.	01 no.	MR
	b Basement	NA	NA	NA
	B. Width of Staircases			
	a Upper Floor	80 cms	1 to 118 cms ✓	MR
	b Basement	NA	NA	NA
	C. Protection of exits			
	Fire check door	NA	NA	NA
	D. Pressurization	NA	NA	NA
	E. No. of continuous staircases to terrace	NA	NA	NA
	F. Width of Corridor	NA	NA	NA
	G. Door size	1.0 m	1.0 m	MR
3	Compartmentation			
	A Fire check door	NA	NA	NA
	B Sealing of electrical shafts	NA	NA	NA
	C Fire rating of shaft door	NA	NA	NA
	D Water curtain	NA	NA	NA
	E Fire Dampers	NA	NA	NA
4	Smoke Management System.			
	A Basement	NA	NA	NA
	B Upper floor	Mechanical/Natural	Natural	MR

5.	Fire Extinguisher				
	A	Total numbers	08 nos.	08 nos.	MR
	B	types	CO ₂ & ABC	CO ₂ & ABC	MR
	C	IS marking	Required	Provided	MR
6	First-aid-Hose Reels.				
	A	Total numbers of each floor	01 no.	Provided at 1 st & 3 rd floor	MR
	B	Length of hose reel hose	30 mtrs.	30 mtrs.	MR
	C	Nozzle diameter	5 mm	5 mm	MR
7	Automatic fire detection and alarming system.				
	A	Type of detectors	Required	Provided	MR
	B	Location of main panel	Required	Provided at ground floor	MR
	C	Location of repeater panel	NA	NA	NA
	D	Alternate source of power	Required	Provided	MR
	E	Hooters	Required	Provided	MR
8	MOEFA		NA	NA	NA
9	Public address System.		Required	Provided	MR
10	Automatic Sprinkler System.				
	A	Basement	NA	NA	NA
	B	Upper floor	NA	NA	NA
	C	Sprinkler above false ceiling	NA	NA	NA
11	Internal Hydrants				
	A	Size of riser/down-comer	NA	NA	NA
	B	Number of hydrants per floor	NA	NA	NA
	C	Hose Box	NA	NA	NA
12	Yard Hydrants.				
	A	Total number of hydrants	NA	NA	NA
	B	Hose Box	NA	NA	NA
13	Pumping Arrangements.				
	A	Ground Level			
	a	Discharge of main Pump	NA	NA	NA
	b	Head of Main Pump	NA	NA	NA
	c	Number of main pumps	NA	NA	NA
	d	Jockey pump out put	NA	NA	NA
	e	Jockey pump head	NA	NA	NA
	f	Standby pump out put	NA	NA	NA
	g	Standby pump Head	NA	NA	NA
	h	Auto Starting /Manual stopping	NA	NA	NA
	i	Pump House Access	NA	NA	NA
	B	Terrace Level			
	a	Discharge of pump	225 LPM	225 LPM.	MR
	b	Head of the Pump	30 mtrs.	40 mtrs.	MR
	c	Power supply	Required	Provided	MR
	d	Auto starting of pump	Required	Provided	MR


14	Captive Water Storage for Fire Fighting.				
	A	Underground tank capacity	NA	NA	NA
	B	Draw-off connection	NA	NA	NA
	C	Fire service inlet	NA	NA	NA
	D	Access to tank	NA	NA	NA
	E	Overhead tank capacity	2,500 ltrs	2,500 ltrs	MR
15	Exit Signage.		Required	Provided	MR
16	Provision of Lifts.				
	A	Pressurization of lift shaft	NA	NA	NA
	B	Pressurization of lift lobby	NA	NA	NA
	C	Communication in lift car	NA	NA	NA
	D	Firemen's grounding switch	NA	NA	NA
	E	Lift signage	NA	NA	NA
17	Standby power supply		Required	Provided	MR
18	Refuge Area.				
	A	Total area	N.A	N.A	N.A
	B	Location	N.A	N.A	N.A
19	Fire Control Room				
	A	Detector system panel	NA	NA	NA
	B	Flow switch panel	NA	NA	NA
	C	PA system panel	NA	NA	NA
	D	Battery backup	NA	NA	NA
	E	Building floor Plans	NA	NA	NA
20	Special Fire Protection systems for protection of special Risks, if any:			NA	NA

During inspection it was observed that the building is comprised of ground + 04 upper floors. The same is also on record in the inspection report dated 02.11.2017 placed on file at N/19. There is also mention of basement in the building in initial inspections which was found sealed by masonry construction during this inspection.

The owner has submitted an affidavit dated 22.08.2024 stating the floor wise occupancy of the building and also stating that they shall not use any floor above 3rd floor for any purpose whatsoever.


The fire protection systems provided in the building were tested, checked at random and found functional at the time of inspection.

In view of the deemed compliance of minimum standards of fire prevention and fire safety measures as required under the Rules, the FSC issued vide letter No. F6/DFS/MS/GH/NDZ/2021/462 dated 01.10.2021 is recommended to be renewed upto 3rd floor only, under Rule 35 of the Delhi Fire Service Rules 2010.

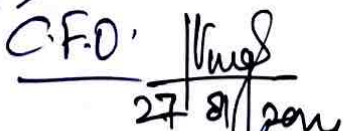

 Signature of the Inspecting Officer
 Name Sumit Kumar
 Designation ADO (SPM)


DO (CD)

23/8/24


C.F.O.


R.V.P.
23/08/24


Director
27/8/2024


Director